

OIL ANALYSIS REPORT

Sample Rating Trend







Machine Id 742006

Component Natural Gas Engine

PETRO CANADA DURON GEO LD 15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

Metal levels are typical for a components first oil change.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition


The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.


SAMPLE INFORI	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		GFL0108347		
Sample Date		Client Info		15 Mar 2024		
Machine Age	hrs	Client Info		391		
Oil Age	hrs	Client Info		391		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINAT	ION	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METAL	S	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	23		
Chromium	ppm	ASTM D5185m	>4	3		
Nickel	ppm	ASTM D5185m	>2	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>3	0		
Aluminum	ppm	ASTM D5185m	>9	2		
Lead	ppm	ASTM D5185m	>30	3		
Copper	ppm	ASTM D5185m	>35	1		
Tin	ppm	ASTM D5185m	>4	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	50	11		
Barium	ppm	ASTM D5185m	5	0		
Molybdenum	ppm	ASTM D5185m	50	70		
Manganese	ppm	ASTM D5185m	0	<1		
Magnesium	ppm	ASTM D5185m	560	671		
Calcium	ppm	ASTM D5185m	1510	1925		
Phosphorus	ppm	ASTM D5185m	780	876		
Zinc	ppm	ASTM D5185m	870	1155		
Sulfur	ppm	ASTM D5185m	2040	3318		
CONTAMINAN	TS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+100	6		
Sodium	ppm	ASTM D5185m		10		
Potassium	ppm	ASTM D5185m	>20	4		
INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0		
Nitration	Abs/cm	*ASTM D7624	>20	12.8		
Sulfation	Abs/.1mm	*ASTM D7415	>30	22.7		
FLUID DEGRAD	DATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	18.4		
Base Number (BN)	mg KOH/g	ASTM D2896	10.2	5.2		




OIL ANALYSIS REPORT





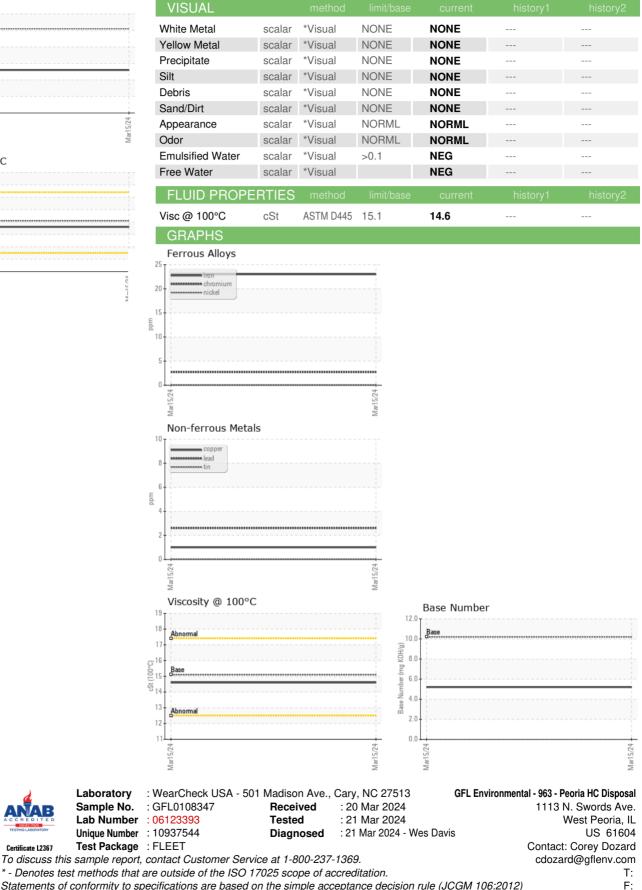



Certificate L2367