


# OIL ANALYSIS REPORT

Sample Rating Trend



**DEGRADATION**

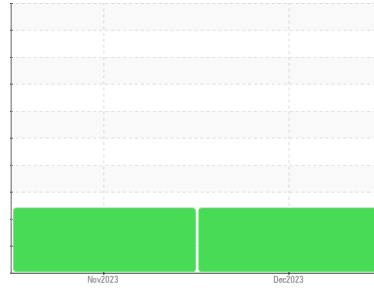

Machine Id  
**RESIDUE 2**  
Component  
**Biogas Engine**  
Fluid  
**{not provided} (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition.

### Wear

All component wear rates are normal.

### Contamination

Fuel content negligible. There is no indication of any contamination in the oil.

### ▲ Fluid Condition

The AN level is above the recommended limit. The BN level is low.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>PCA0118697</b>	PCA0118694	---
Sample Date	Client Info	<b>27 Dec 2023</b>	29 Nov 2023	---
Machine Age	hrs Client Info	<b>0</b>	0	---
Oil Age	hrs Client Info	<b>0</b>	0	---
Oil Changed	Client Info	<b>N/A</b>	N/A	---
Sample Status		<b>ABNORMAL</b>	ABNORMAL	---

## CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.1	<b>NEG</b>	NEG	---
Glycol	WC Method	<b>NEG</b>	NEG	---

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >45	<b>17</b>	17	---
Chromium	ppm ASTM D5185m >2	<b>0</b>	0	---
Nickel	ppm ASTM D5185m >2	<b>0</b>	0	---
Titanium	ppm ASTM D5185m	<b>0</b>	0	---
Silver	ppm ASTM D5185m >5	<b>0</b>	0	---
Aluminum	ppm ASTM D5185m >10	<b>1</b>	1	---
Lead	ppm ASTM D5185m >5	<b>0</b>	0	---
Copper	ppm ASTM D5185m >14	<b>2</b>	2	---
Tin	ppm ASTM D5185m >13	<b>0</b>	0	---
Vanadium	ppm ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	<b>0</b>	0	---
Barium	ppm ASTM D5185m	<b>0</b>	0	---
Molybdenum	ppm ASTM D5185m	<b>0</b>	0	---
Manganese	ppm ASTM D5185m	<b>0</b>	0	---
Magnesium	ppm ASTM D5185m	<b>3</b>	4	---
Calcium	ppm ASTM D5185m	<b>1477</b>	1460	---
Phosphorus	ppm ASTM D5185m	<b>298</b>	294	---
Zinc	ppm ASTM D5185m	<b>343</b>	342	---
Sulfur	ppm ASTM D5185m	<b>3659</b>	3697	---

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >200	<b>&lt;1</b>	<1	---
Sodium	ppm ASTM D5185m	<b>2</b>	2	---
Potassium	ppm ASTM D5185m >20	<b>0</b>	0	---
Fuel	% ASTM D3524 >4.0	<b>0.3</b>	0.3	---





## INFRA-RED

method	limit/base	current	history1	history2
Soot %	% *ASTM D7844	<b>0.1</b>	0.1	---
Nitration	Abs/cm *ASTM D7624 >20	<b>15.7</b>	15.7	---
Sulfation	Abs/.1mm *ASTM D7415 >30	<b>28.8</b>	28.9	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414 >25	<b>35.4</b>	35.5	---
Acid Number (AN)	mg KOH/g ASTM D8045	<b>▲ 5.617</b>	▲ 6.14	---
Base Number (BN)	mg KOH/g ASTM D2896	<b>▲ 1.52</b>	▲ 1.36	---









# OIL ANALYSIS REPORT

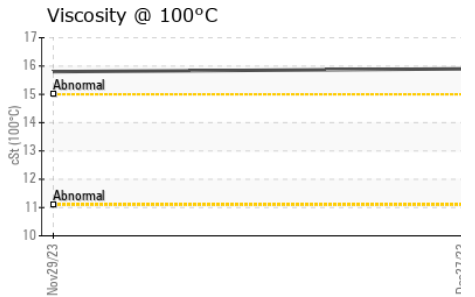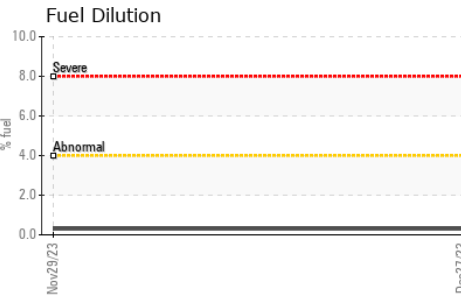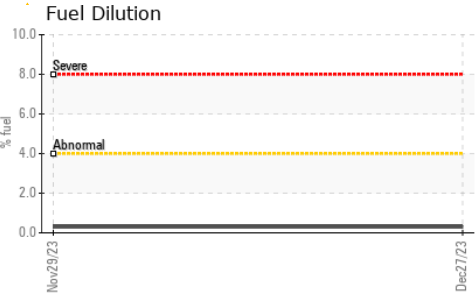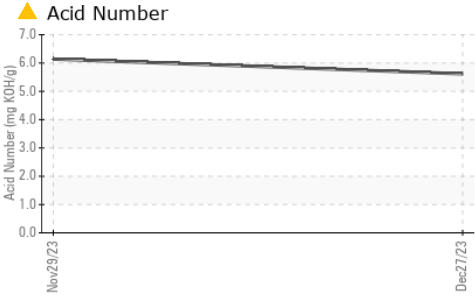

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.9	15.8	---

## GRAPHS

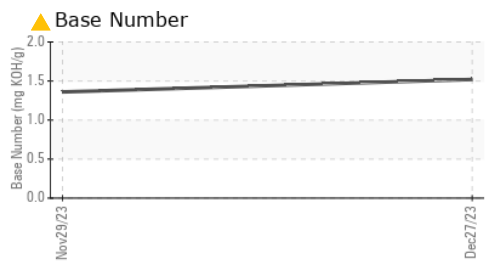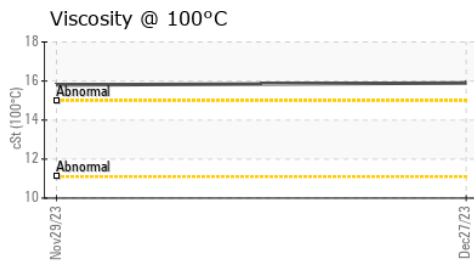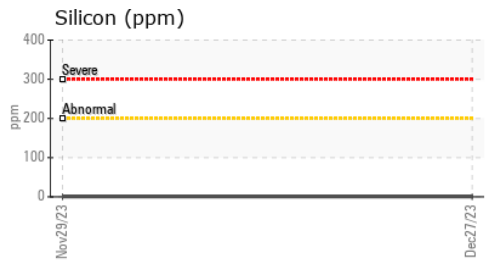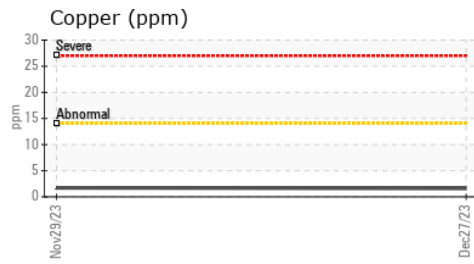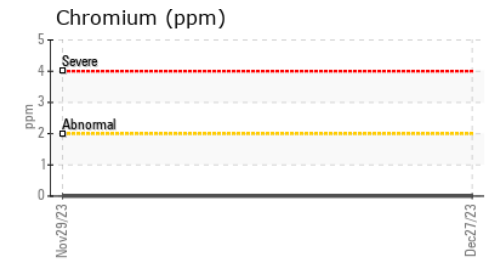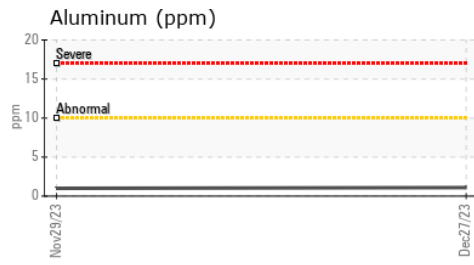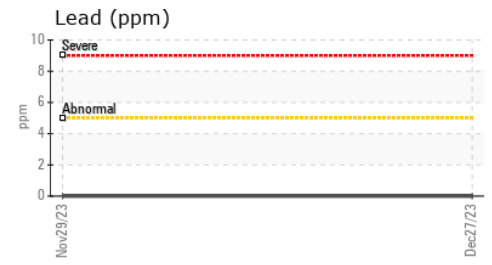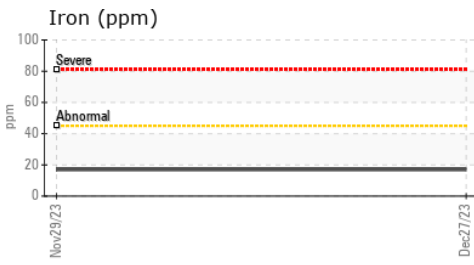

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0118697 **Received** : 25 Mar 2024  
**Lab Number** : **06128804** **Tested** : 28 Mar 2024  
**Unique Number** : 10942955 **Diagnosed** : 28 Mar 2024 - Jonathan Hester  
**Test Package** : MOB 2 ( Additional Tests: FuelDilution, PercentFuel )

**DIVERSIFIED ENERGY - FRIERSON**  
 1716 FRIENDSHIP RD  
 FRIERSON, LA  
 US 71027  
 Contact: KORRY SHELTON  
 kshelton@dgoc.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)