


OIL ANALYSIS REPORT

Sample Rating Trend

VISUAL METAL

Area
Irvington
 Machine Id
Unit 02 DB060102E
 Component
Natural Gas Engine
 Fluid
PETRO CANADA DURON MONOGRADE HD 40W (250 GAL)

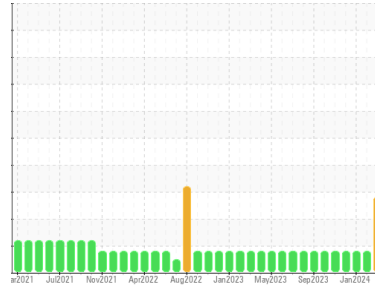

DIAGNOSIS

Recommendation
 We advise that you check the fuel injection system. Resample at the next service interval to monitor. (Customer Sample Comment: Top Up Amount: 14 GAL Top Up Amount: 14 GAL)

Wear
 Moderate concentration of visible metal present. All component wear rates are normal.

Contamination
 There is a moderate amount of fuel present in the oil.

Fluid Condition
 The BN result indicates that there is suitable alkalinity remaining in the oil. Fuel is present in the oil and is lowering the viscosity. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PCA0105162	PCA0105154	PCA0105165
Sample Date	Client Info	25 Mar 2024	01 Feb 2024	04 Jan 2024
Machine Age	hrs	0	27325	26783
Oil Age	hrs	0	18897	18355
Oil Changed	Client Info	N/A	Oil Added	Oil Added
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.1	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >50	16	15	15
Chromium	ppm ASTM D5185m >4	<1	<1	<1
Nickel	ppm ASTM D5185m >2	<1	0	<1
Titanium	ppm ASTM D5185m	0	0	<1
Silver	ppm ASTM D5185m >3	0	0	0
Aluminum	ppm ASTM D5185m >9	1	2	2
Lead	ppm ASTM D5185m >30	14	13	13
Copper	ppm ASTM D5185m >35	12	13	13
Tin	ppm ASTM D5185m >4	3	2	3
Vanadium	ppm ASTM D5185m	0	0	0
Cadmium	ppm ASTM D5185m	0	0	<1

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	13	14	14
Barium	ppm ASTM D5185m	0	5	0
Molybdenum	ppm ASTM D5185m	5	4	5
Manganese	ppm ASTM D5185m	<1	0	<1
Magnesium	ppm ASTM D5185m	819	850	826
Calcium	ppm ASTM D5185m	1121	1109	1166
Phosphorus	ppm ASTM D5185m	942	906	858
Zinc	ppm ASTM D5185m	1205	1226	1201
Sulfur	ppm ASTM D5185m	2488	2148	2304

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >+100	3	1	3
Sodium	ppm ASTM D5185m	7	<1	2
Potassium	ppm ASTM D5185m >20	2	2	2
Fuel	% ASTM D3524 >4.0	4.4	4.1	4.8

INFRA-RED


method	limit/base	current	history1	history2
Soot %	% *ASTM D7844	0.1	0.1	0.1
Nitration	Abs/cm *ASTM D7624 >20	6.9	6.8	6.8
Sulfation	Abs/.1mm *ASTM D7415 >30	17.5	17.1	16.8

FLUID DEGRADATION


method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414 >25	11.7	11.3	11.1
Acid Number (AN)	mg KOH/g ASTM D8045	1.24	1.12	1.08
Base Number (BN)	mg KOH/g ASTM D2896 8.5	7.80	7.22	7.44

OIL ANALYSIS REPORT


▲ Fuel Dilution

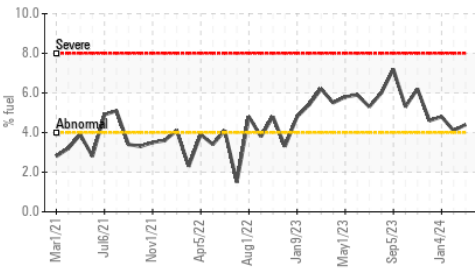


● Non-ferrous Metals

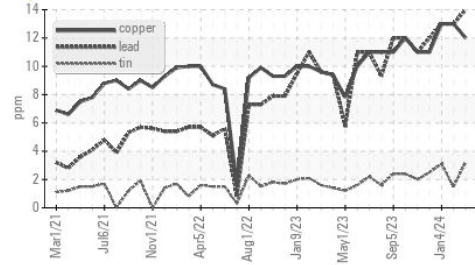


Acid Number

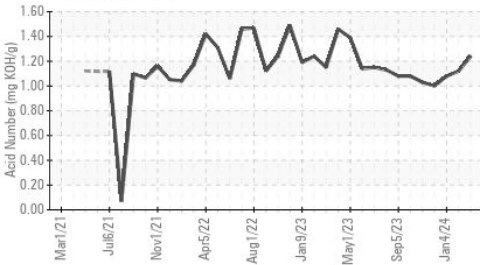

Viscosity @ 40°C

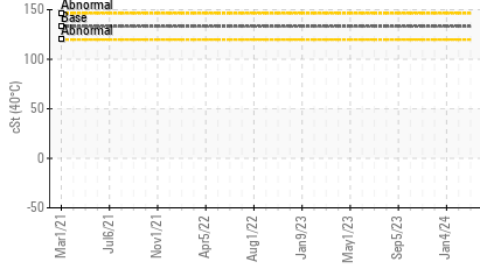

Viscosity @ 100°C

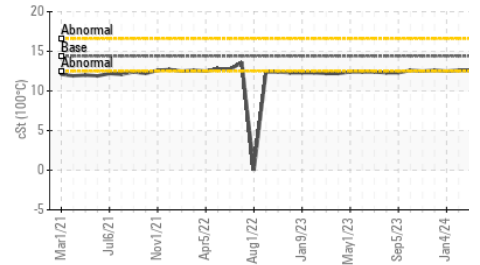


VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	▲ MODER	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	14.4	12.6	12.6	12.5

GRAPHS


Iron (ppm)

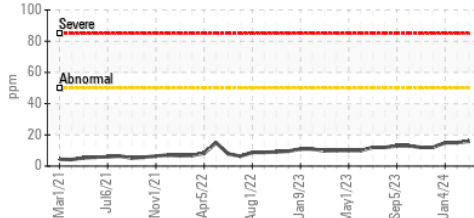


Lead (ppm)

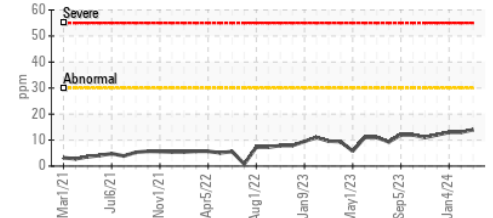


Aluminum (ppm)

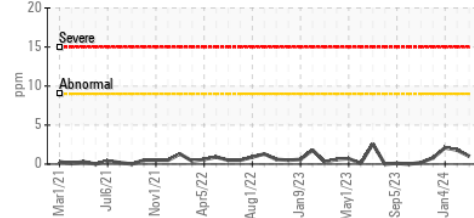


Chromium (ppm)

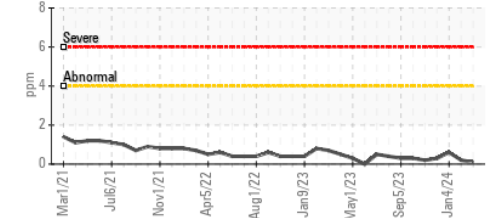


Copper (ppm)

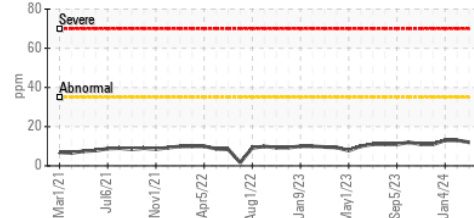


Silicon (ppm)

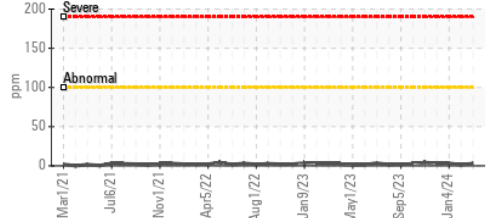

Viscosity @ 100°C

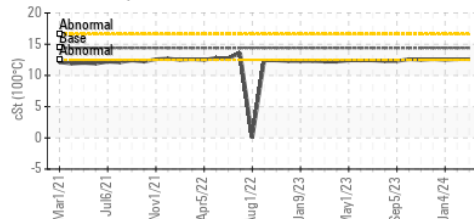

Base Number

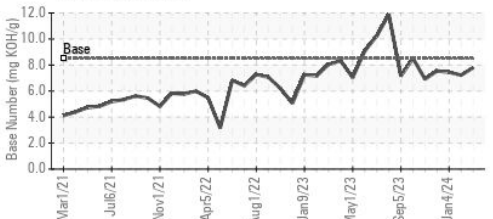

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0105162 **Received** : 26 Mar 2024
Lab Number : 06129541 **Tested** : 29 Mar 2024
Unique Number : 10943692 **Diagnosed** : 29 Mar 2024 - Jonathan Hester
Test Package : MOB 2 (Additional Tests: FuelDilution, KV40, PercentFuel)

Magellan Midstream LP - Omaha
 9405 Bennington Road
 Omaha, NE
 US 68122
 Contact: Zach Jones
 zach.jones@magellanlp.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: