


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

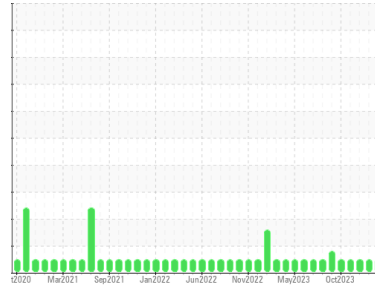

Area
GRIND ROOM [98827289]
 Machine Id
KR-GR-003073 - DUMPER 7A - SOUTH (S/N GRIND A - 11513014)
 Component
Hydraulic System
 Fluid
AW HYDRAULIC OIL ISO 68 (10 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. (Customer Sample Comment: 98827289)

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PCA0115888	PCA0106508	PCA0110823
Sample Date	Client Info	13 Mar 2024	20 Dec 2023	29 Nov 2023
Machine Age	hrs	0	0	0
Oil Age	hrs	0	0	0
Oil Changed	Client Info	N/A	Not Chngd	N/A
Sample Status		NORMAL	NORMAL	NORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.05	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >20	0	0	0
Chromium	ppm ASTM D5185m >20	<1	0	0
Nickel	ppm ASTM D5185m >20	0	0	0
Titanium	ppm ASTM D5185m	<1	0	0
Silver	ppm ASTM D5185m	0	0	0
Aluminum	ppm ASTM D5185m >20	3	0	0
Lead	ppm ASTM D5185m >20	<1	0	0
Copper	ppm ASTM D5185m >20	<1	0	0
Tin	ppm ASTM D5185m >20	<1	0	0
Vanadium	ppm ASTM D5185m	<1	0	0
Cadmium	ppm ASTM D5185m	<1	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m 5	0	0	0
Barium	ppm ASTM D5185m 5	0	0	0
Molybdenum	ppm ASTM D5185m 5	0	0	0
Manganese	ppm ASTM D5185m	0	<1	0
Magnesium	ppm ASTM D5185m 25	<1	0	0
Calcium	ppm ASTM D5185m 200	4	0	<1
Phosphorus	ppm ASTM D5185m 300	354	286	310
Zinc	ppm ASTM D5185m 370	5	0	0
Sulfur	ppm ASTM D5185m 2500	409	194	398

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >15	2	1	1
Sodium	ppm ASTM D5185m	0	3	0
Potassium	ppm ASTM D5185m >20	1	1	0

FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	9501	3170	2682
Particles >6µm	ASTM D7647 >2500	1243	214	450
Particles >14µm	ASTM D7647 >640	64	20	54
Particles >21µm	ASTM D7647 >160	20	4	13
Particles >38µm	ASTM D7647 >40	2	0	1
Particles >71µm	ASTM D7647 >10	0	0	0
Oil Cleanliness	ISO 4406 (c) >20/18/16	20/17/13	19/15/11	19/16/13

FLUID DEGRADATION


method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045 0.57	0.27	0.25	0.25

OIL ANALYSIS REPORT


Particle Trend

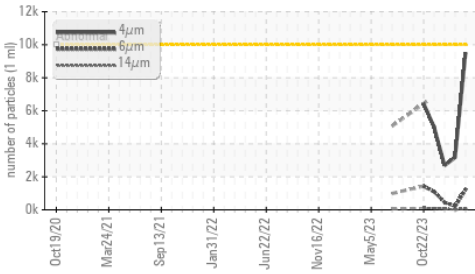


Acid Number

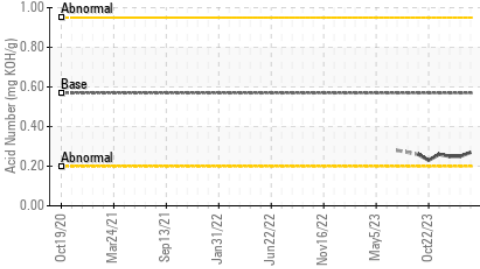

Viscosity @ 40°C

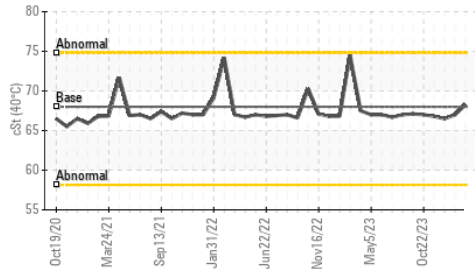

Particle Trend

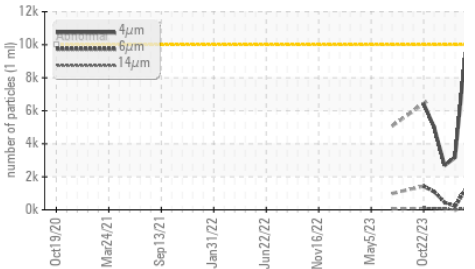


PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	68	68.3	67.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom

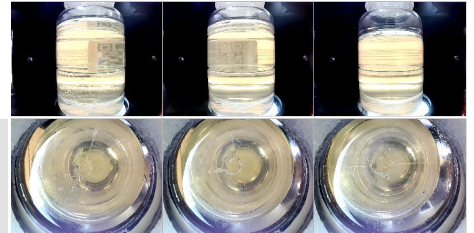


GRAPHS


Ferrous Alloys

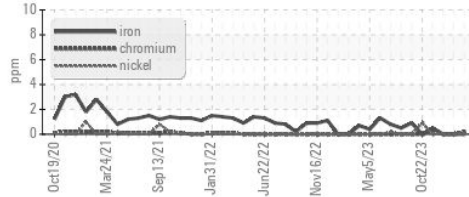


Non-ferrous Metals

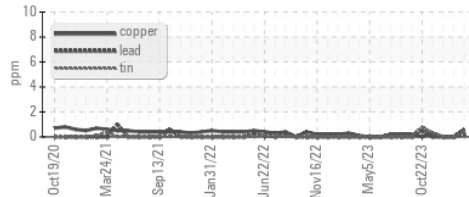


Viscosity @ 40°C

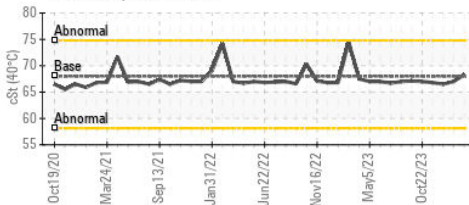

Particle Count

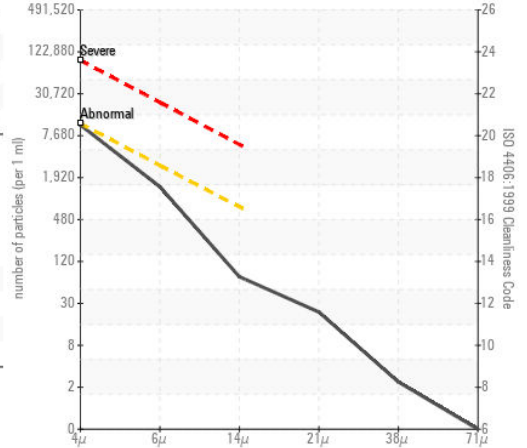

Acid Number

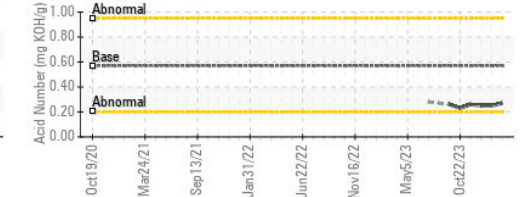

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0115888
Lab Number : 06133230
Unique Number : 10952695
Test Package : IND 2

Received : 29 Mar 2024
Tested : 01 Apr 2024
Diagnosed : 03 Apr 2024 - Jonathan Hester

KraftHeinz - Kirksville - Plant 8333 PCA
 2504 INDUSTRIAL DR
 KIRKSVILLE, MO
 US 63501

Contact: Wilberto Pacheco Garcia
 Wilberto.PachecoGarcia@kraftheinz.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
 F: (660)627-5887