


# OIL ANALYSIS REPORT

Sample Rating Trend



ISO

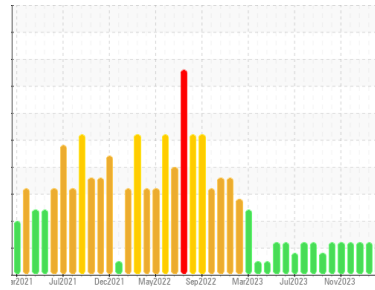

Area

**MIX ROOM D [98763417]**

Machine Id

**KR-GR-003114 - EAST DUMPER (S/N MIX D - 11513073)**

Component

**Hydraulic System**

Fluid

**AW HYDRAULIC OIL ISO 68 (--- GAL)**

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. ( Customer Sample Comment: 98763417 )

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>PCA0116070</b>	PCA0120388	PCA0114829
Sample Date	Client Info			<b>14 Mar 2024</b>	11 Mar 2024	02 Jan 2024
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	<b>7</b>	1	1
Chromium	ppm	ASTM D5185m	>20	<b>2</b>	<1	<1
Nickel	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	<1
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>20	<b>3</b>	3	1
Lead	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	0
Copper	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	0
Tin	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	5	<b>0</b>	<1	10
Molybdenum	ppm	ASTM D5185m	5	<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	25	<b>&lt;1</b>	<1	0
Calcium	ppm	ASTM D5185m	200	<b>8</b>	4	4
Phosphorus	ppm	ASTM D5185m	300	<b>416</b>	423	399
Zinc	ppm	ASTM D5185m	370	<b>2</b>	<1	0
Sulfur	ppm	ASTM D5185m	2500	<b>436</b>	453	419

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>2</b>	2	1
Sodium	ppm	ASTM D5185m		<b>0</b>	0	0
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	1	2
Water	%	ASTM D6304	>0.05	<b>0.046</b>	---	---
ppm Water	ppm	ASTM D6304	>500	<b>460</b>	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<b>▲ 198107</b>	▲ 188767	▲ 123688
Particles >6µm		ASTM D7647	>2500	<b>▲ 42614</b>	▲ 20199	▲ 24079
Particles >14µm		ASTM D7647	>640	<b>148</b>	117	75
Particles >21µm		ASTM D7647	>160	<b>8</b>	22	10
Particles >38µm		ASTM D7647	>40	<b>0</b>	1	0
Particles >71µm		ASTM D7647	>10	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/16	<b>▲ 25/23/14</b>	▲ 25/22/14	▲ 24/22/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.57	<b>0.18</b>	0.13	0.16


# OIL ANALYSIS REPORT

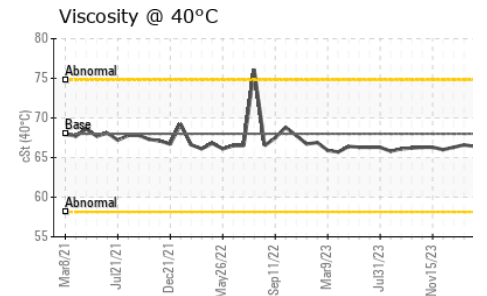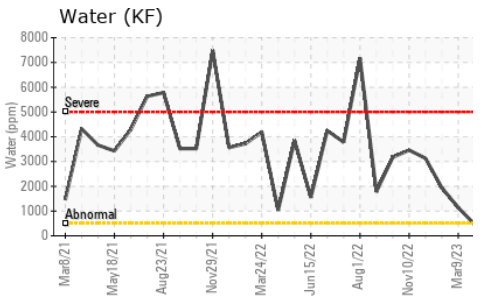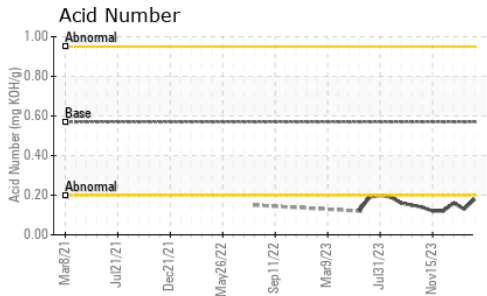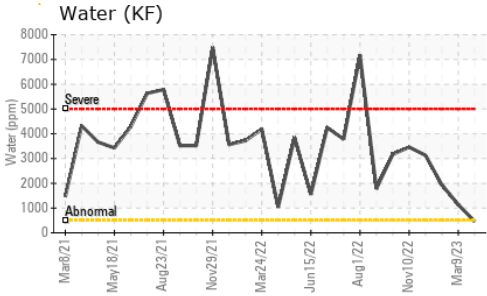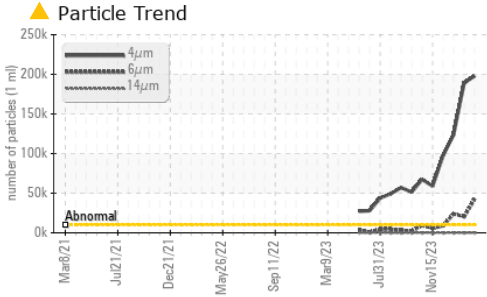






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	68	66.4	66.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

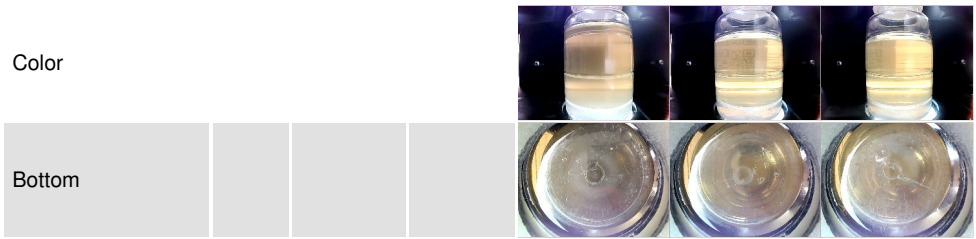

## GRAPHS

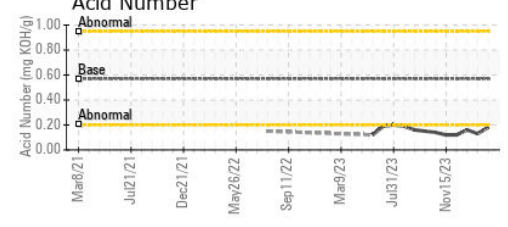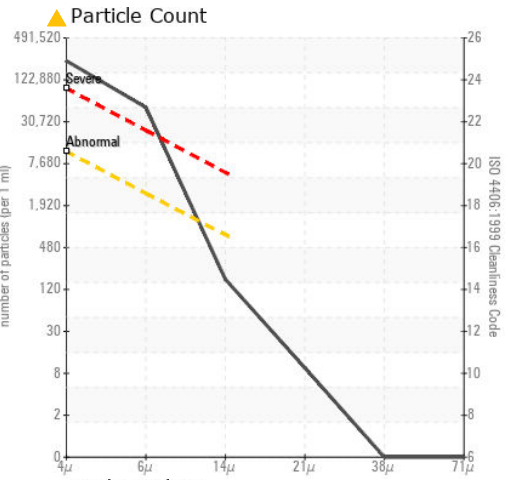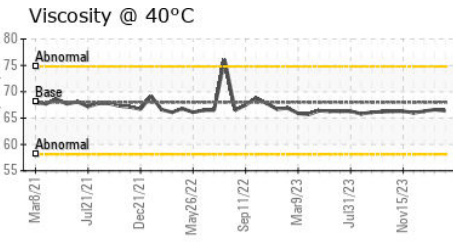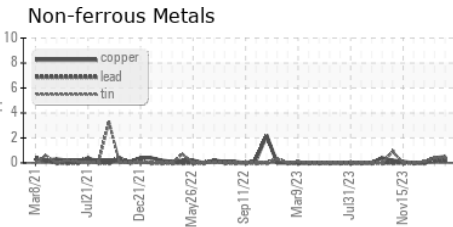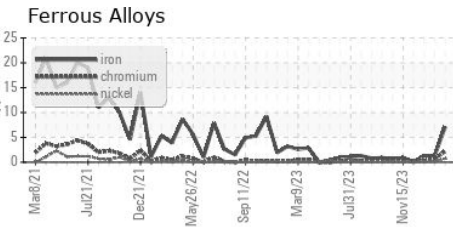

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0116070 **Received** : 29 Mar 2024  
**Lab Number** : 06133246 **Tested** : 05 Apr 2024  
**Unique Number** : 10952711 **Diagnosed** : 05 Apr 2024 - Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF )

**KraftHeinz - Kirksville - Plant 8333 PCA**  
 2504 INDUSTRIAL DR  
 KIRKSVILLE, MO  
 US 63501  
 Contact: WALLACE WARD  
 wallace.ward@kraftheinzcompany.com  
 T: (660)627-1031  
 F: (660)627-5887

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)