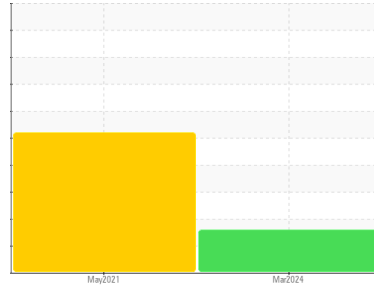


OIL ANALYSIS REPORT

Sample Rating Trend

VISCOSITY


Area
MIX ROOM E [98842809]
 Machine Id
KR-GR-003473 (S/N MIX E - 11535132)
 Component
Pump
 Fluid
SCHAEFFER 294 SUPREME GEAR LUBE ISO 320 (44 GAL)

DIAGNOSIS
Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. (Customer Sample Comment: 98842809)

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

Viscosity of sample indicates oil is within ISO 460 range, advise investigate. Confirm oil type. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PCA0120392	PCA0039020	---
Sample Date	Client Info	14 Mar 2024	16 May 2021	---
Machine Age	hrs	0	0	---
Oil Age	hrs	0	0	---
Oil Changed	Client Info	N/A	N/A	---
Sample Status		ABNORMAL	SEVERE	---

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >.1	NEG	NEG	---

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >90	2	15	---
Chromium	ppm ASTM D5185m >5	<1	<1	---
Nickel	ppm ASTM D5185m >5	0	0	---
Titanium	ppm ASTM D5185m >3	<1	<1	---
Silver	ppm ASTM D5185m >3	0	0	---
Aluminum	ppm ASTM D5185m >7	3	<1	---
Lead	ppm ASTM D5185m >12	<1	0	---
Copper	ppm ASTM D5185m >30	<1	0	---
Tin	ppm ASTM D5185m >9	<1	<1	---
Antimony	ppm ASTM D5185m	---	0	---
Vanadium	ppm ASTM D5185m	<1	0	---
Cadmium	ppm ASTM D5185m	<1	0	---

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	0	2	---
Barium	ppm ASTM D5185m	<1	0	---
Molybdenum	ppm ASTM D5185m	14	<1	---
Manganese	ppm ASTM D5185m	0	<1	---
Magnesium	ppm ASTM D5185m	<1	<1	---
Calcium	ppm ASTM D5185m	6	6	---
Phosphorus	ppm ASTM D5185m	842	367	---
Zinc	ppm ASTM D5185m	4	0	---
Sulfur	ppm ASTM D5185m	1467	922	---





CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >60	3	20	---
Sodium	ppm ASTM D5185m	<1	6	---
Potassium	ppm ASTM D5185m >20	1	0	---

FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	▲ 80594	---	---
Particles >6µm	ASTM D7647 >2500	▲ 17628	---	---
Particles >14µm	ASTM D7647 >640	487	---	---
Particles >21µm	ASTM D7647 >160	75	---	---
Particles >38µm	ASTM D7647 >40	2	---	---
Particles >71µm	ASTM D7647 >10	0	---	---
Oil Cleanliness	ISO 4406 (c) >20/18/16	▲ 24/21/16	---	---

OIL ANALYSIS REPORT

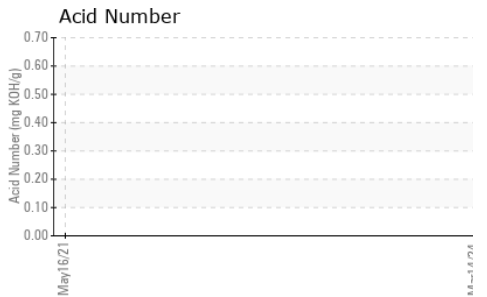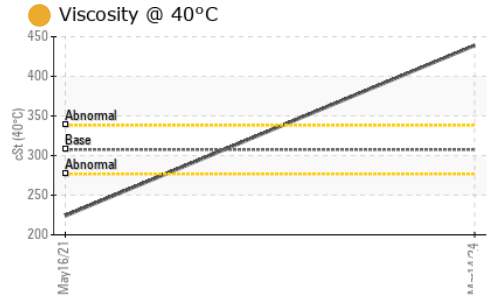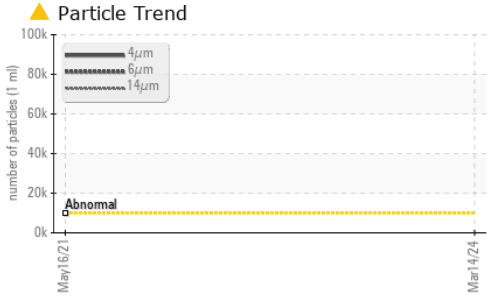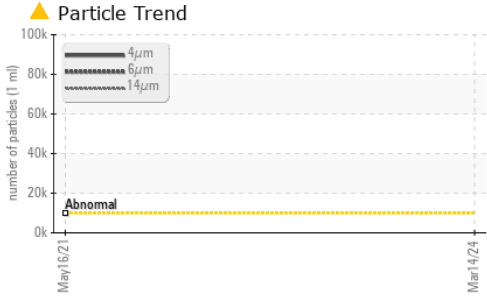





FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.64	---	---

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	▲ MODER	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	▲ MODER	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>.1	NEG	▲ 0.2%	---
Free Water	scalar	*Visual		NEG	NEG	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	307.5	● 439	● 224	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						no image
Bottom						no image

GRAPHS

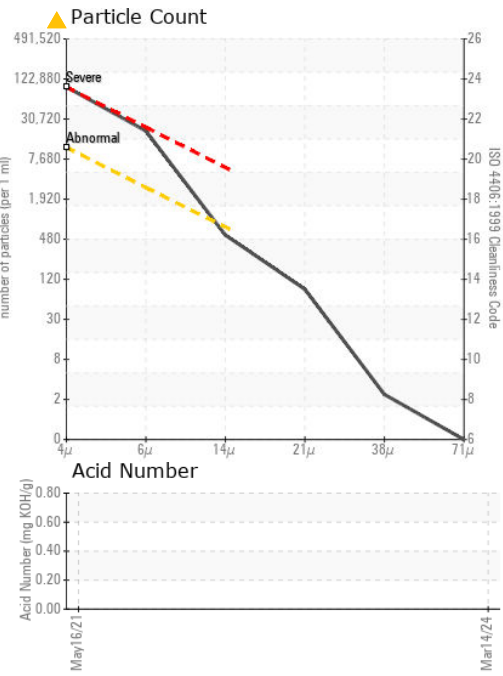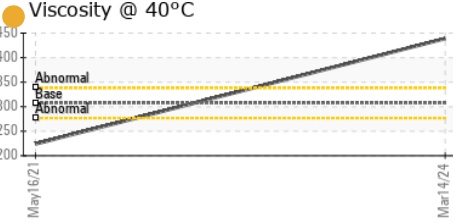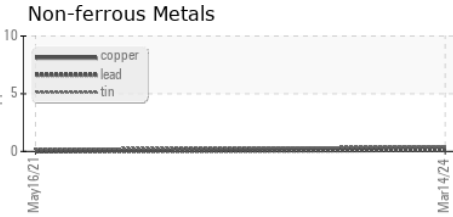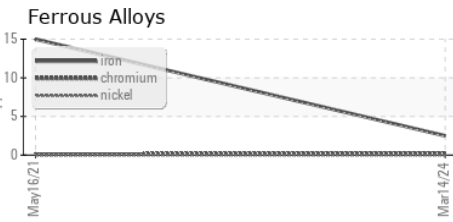

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0120392 **Received** : 29 Mar 2024
Lab Number : **06133268** **Tested** : 01 Apr 2024
Unique Number : 10952733 **Diagnosed** : 03 Apr 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: PrtCount)

KraftHeinz - Kirksville - Plant 8333 PCA
 2504 INDUSTRIAL DR
 KIRKSVILLE, MO
 US 63501
 Contact: WALLACE WARD
 wallace.ward@kraftheinzcompany.com
 T: (660)627-1031
 F: (660)627-5887

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)