


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

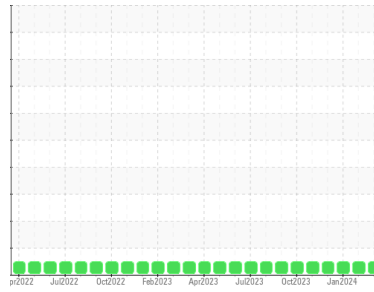

Area
WILLMAR
 Machine Id
Unit 01 DB040101E
 Component
Natural Gas Engine
 Fluid
DISEL ENGINE OIL SAE 40 (250 GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. (Customer Sample Comment: 33 Gallons Make-up Oil)

Wear

All component wear rates are normal.

Contamination

Fuel content negligible. There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			PCA0105949	PCA0105948	PCA0105947
Sample Date	Client Info			28 Mar 2024	26 Feb 2024	29 Jan 2024
Machine Age	hrs	Client Info		6198	6026	5905
Oil Age	hrs	Client Info		6198	6026	5905
Oil Changed		Client Info		Filtered	Filtered	Filtered
Sample Status				NORMAL	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	6	2	3
Chromium	ppm	ASTM D5185m	>4	0	<1	0
Nickel	ppm	ASTM D5185m	>2	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>9	2	1	1
Lead	ppm	ASTM D5185m	>30	2	2	2
Copper	ppm	ASTM D5185m	>35	2	2	2
Tin	ppm	ASTM D5185m	>4	2	<1	1
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	250	1	0	0
Barium	ppm	ASTM D5185m	10	0	0	0
Molybdenum	ppm	ASTM D5185m	100	<1	1	<1
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	450	908	874	888
Calcium	ppm	ASTM D5185m	3000	1109	978	962
Phosphorus	ppm	ASTM D5185m	1150	1096	1091	1103
Zinc	ppm	ASTM D5185m	1350	1326	1313	1257
Sulfur	ppm	ASTM D5185m	4250	3728	3024	3007


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+100	3	2	2
Sodium	ppm	ASTM D5185m	>216	3	2	2
Potassium	ppm	ASTM D5185m	>20	3	3	3
Fuel	%	ASTM D3524	>4.0	1.4	1.4	1.2

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0.1	0	0.1
Nitration	Abs/cm	*ASTM D7624	>20	4.1	4.1	4.0
Sulfation	Abs/.1mm	*ASTM D7415	>30	13.0	13.0	13.1


FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	7.0	7.1	6.9
Acid Number (AN)	mg KOH/g	ASTM D8045		1.46	0.65	1.45
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	8.48	8.46	8.56

OIL ANALYSIS REPORT


Fuel Dilution

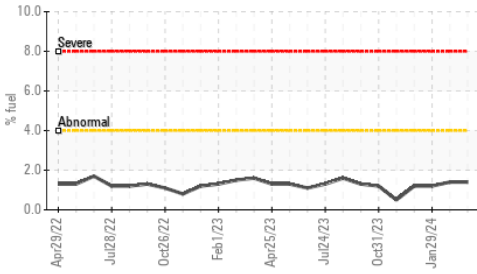


FT-IR (Direct Trend)

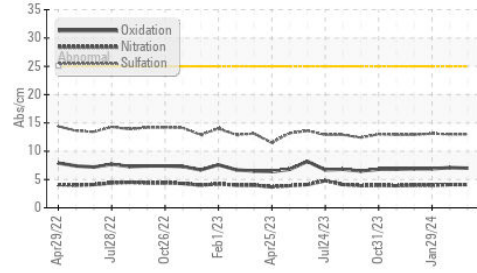


Acid Number

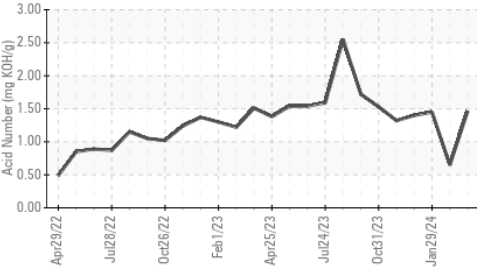

Base Number

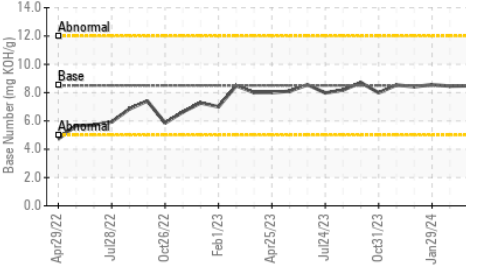









Viscosity @ 100°C

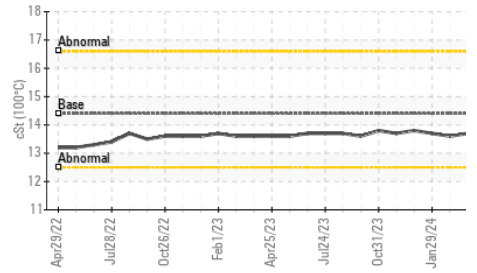

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	13.7	13.6

GRAPHS

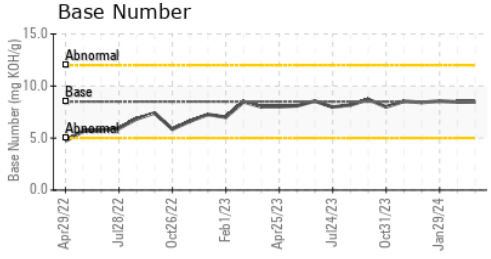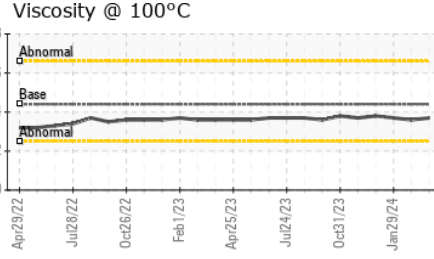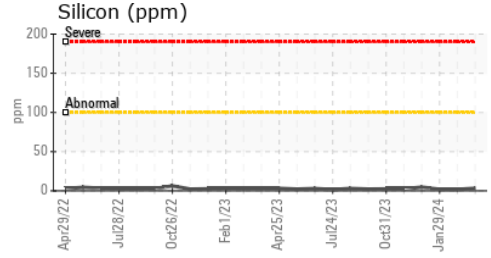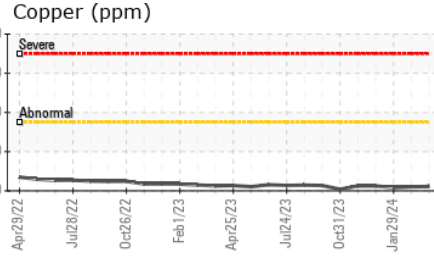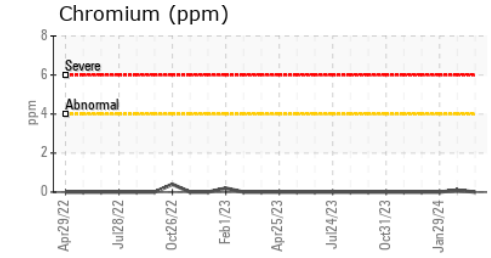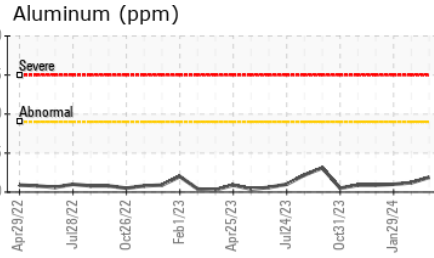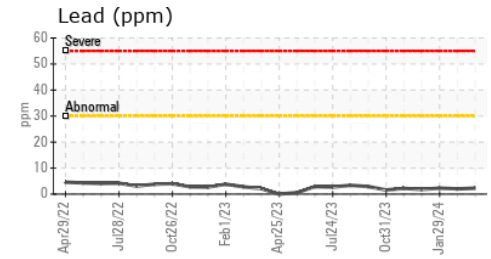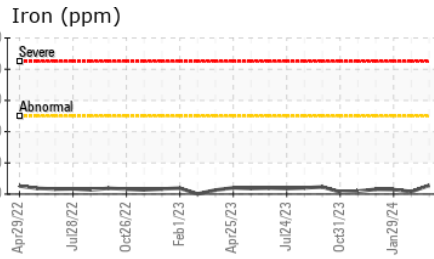

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0105949 **Received** : 02 Apr 2024
Lab Number : 06136941 **Tested** : 05 Apr 2024
Unique Number : 10956406 **Diagnosed** : 05 Apr 2024 - Don Baldrige
Test Package : MOB 2 (Additional Tests: FuelDilution, PercentFuel)

Magellan Midstream LP - Willmar
 2131 30th Stree SW
 Willmar, MN
 US 56201

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Contact: Andrew Lauer
 andrew.lauer@magellanlp.com

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

T: (320)808-4364

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: