




# OIL ANALYSIS REPORT

Sample Rating Trend

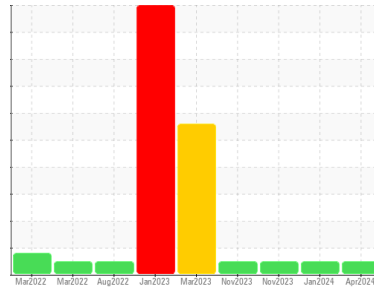

**NORMAL**



Machine Id  
**946021-260304**

Component  
**Natural Gas Engine**

Fluid  
**PETRO CANADA DURON GEO LD 15W40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

Metal levels are typical for a new component breaking in.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	<b>GFL0106746</b>	GFL0092124	GFL0092007	
Sample Date	Client Info	<b>01 Apr 2024</b>	26 Jan 2024	28 Nov 2023	
Machine Age	hrs	Client Info	<b>89722</b>	89679	89380
Oil Age	hrs	Client Info	<b>600</b>	20000	600
Oil Changed	Client Info	<b>Changed</b>	Changed	Changed	
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL	

## CONTAMINATION

method	limit/base	current	history1	history2	
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>50	<b>6</b>	21	17
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	2	3
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	1	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>9	<b>4</b>	4	2
Lead	ppm	ASTM D5185m	>30	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>35	<b>5</b>	2	3
Tin	ppm	ASTM D5185m	>4	<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m	50	<b>118</b>	30	11
Barium	ppm	ASTM D5185m	5	<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185m	50	<b>118</b>	55	48
Manganese	ppm	ASTM D5185m	0	<b>2</b>	<1	<1
Magnesium	ppm	ASTM D5185m	560	<b>648</b>	568	557
Calcium	ppm	ASTM D5185m	1510	<b>1305</b>	1525	1459
Phosphorus	ppm	ASTM D5185m	780	<b>668</b>	785	739
Zinc	ppm	ASTM D5185m	870	<b>869</b>	957	882
Sulfur	ppm	ASTM D5185m	2040	<b>3311</b>	2498	2197

## CONTAMINANTS

method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>+100	<b>10</b>	9	10
Sodium	ppm	ASTM D5185m		<b>2</b>	44	36
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	22	12

## INFRA-RED

method	limit/base	current	history1	history2		
Soot %	%	*ASTM D7844		<b>0</b>	0.1	0
Nitration	Abs/cm	*ASTM D7624	>20	<b>3.7</b>	10.9	11.1
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>20.0</b>	18.1	21.4


## FLUID DEGRADATION

method	limit/base	current	history1	history2		
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>13.2</b>	17.1	17.4
Base Number (BN)	mg KOH/g	ASTM D2896	10.2	<b>8.1</b>	9.7	5.8




# OIL ANALYSIS REPORT


FT-IR (Direct Trend)

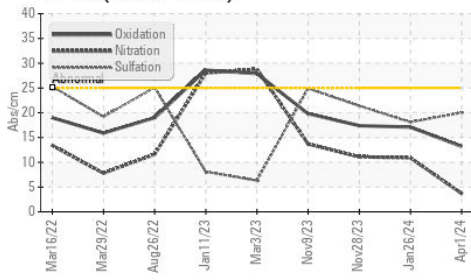

Base Number

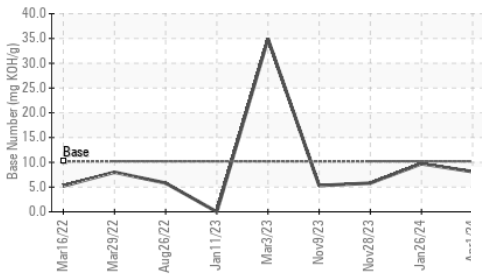





Viscosity @ 100°C

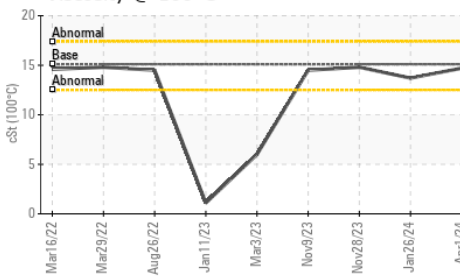

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.1	14.7	13.7

## GRAPHS

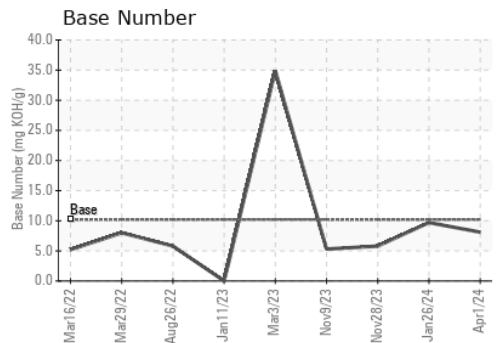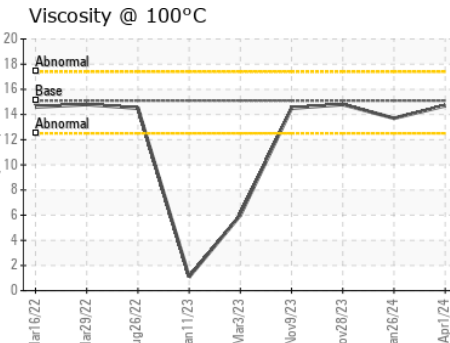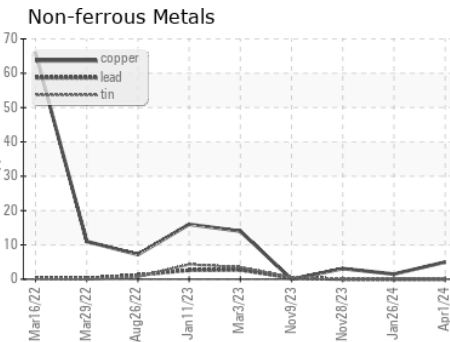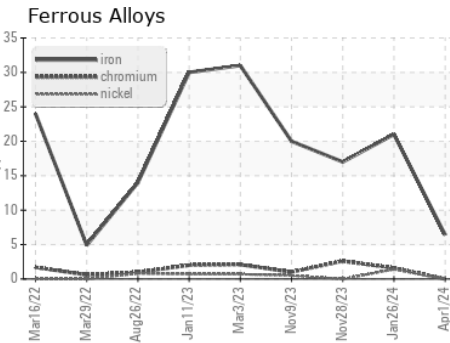

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : GFL0106746  
**Lab Number** : 06138391  
**Unique Number** : 10963199  
**Test Package** : FLEET

**Received** : 04 Apr 2024  
**Tested** : 05 Apr 2024  
**Diagnosed** : 05 Apr 2024 - Wes Davis

**GFL Environmental - 856 - Houston South**  
 8515 Highway 6 South  
 Houston, TX  
 US 77083  
 Contact: Apolinar Zacarias  
 pzacariascano@gflenv.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)