


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

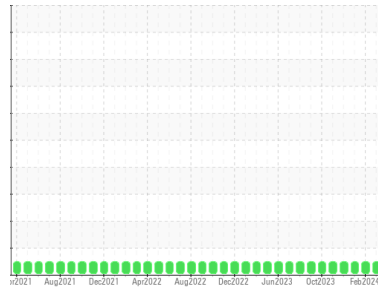

Area
ALBERT LEA
 Machine Id
Unit 04 DB010104E
 Component
Natural Gas Engine
 Fluid
PETRO CANADA DURON MONOGRADE HD 40W (350 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. (Customer Sample Comment: 223 gallons of lube oil added this month.)

Wear

All component wear rates are normal.

Contamination

Fuel content negligible. There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		PCA0098890	PCA0106490	PCA0106489
Sample Date	Client Info		29 Feb 2024	28 Feb 2024	25 Jan 2024
Machine Age	hrs	Client Info	15137	15137	14810
Oil Age	hrs	Client Info	42	15137	14810
Oil Changed	Client Info		Not Chngd	Not Chngd	Oil Added
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	<1	3
Chromium	ppm	ASTM D5185m >4	0	<1	<1
Nickel	ppm	ASTM D5185m >2	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m >3	0	0	0
Aluminum	ppm	ASTM D5185m >9	<1	2	2
Lead	ppm	ASTM D5185m >30	<1	0	0
Copper	ppm	ASTM D5185m >35	0	1	<1
Tin	ppm	ASTM D5185m >4	<1	<1	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1
Barium	ppm	ASTM D5185m	0	0	5
Molybdenum	ppm	ASTM D5185m	<1	2	<1
Manganese	ppm	ASTM D5185m	<1	0	0
Magnesium	ppm	ASTM D5185m	904	955	986
Calcium	ppm	ASTM D5185m	990	1034	1076
Phosphorus	ppm	ASTM D5185m	1125	1077	1186
Zinc	ppm	ASTM D5185m	1297	1385	1369
Sulfur	ppm	ASTM D5185m	3162	3190	3528

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >+100	26	3	2
Sodium	ppm	ASTM D5185m	1	0	0
Potassium	ppm	ASTM D5185m >20	0	1	1
Fuel	%	ASTM D3524 >4.0	0.7	1.1	1.0

INFRA-RED


	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0	0.1	0.1
Nitration	Abs/cm	*ASTM D7624 >20	2.9	3.7	3.7
Sulfation	Abs/.1mm	*ASTM D7415 >30	12.0	13.1	13.0

FLUID DEGRADATION


	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	5.6	6.7	6.7
Acid Number (AN)	mg KOH/g	ASTM D8045	1.76	1.79	1.55
Base Number (BN)	mg KOH/g	ASTM D2896 8.5	7.83	8.56	8.53

OIL ANALYSIS REPORT


Fuel Dilution

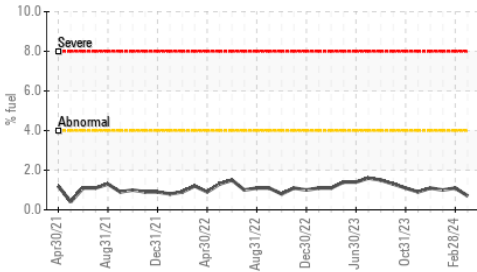


FT-IR (Direct Trend)

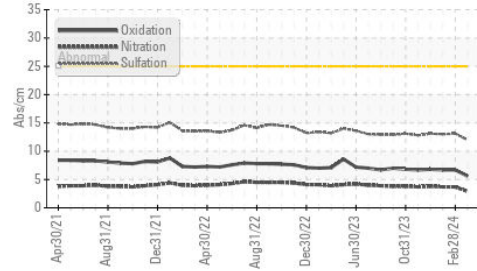


Acid Number

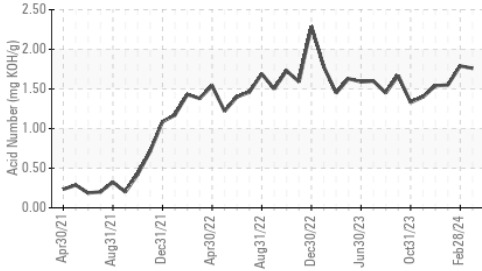

Base Number

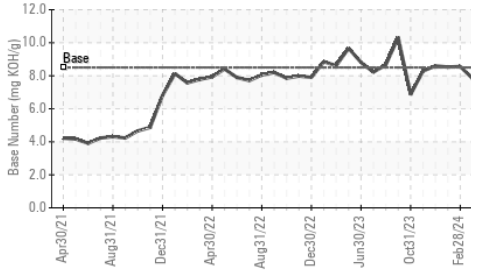

Viscosity @ 100°C

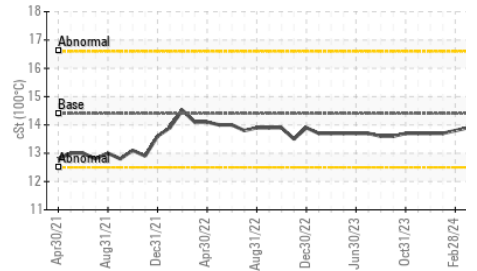

VISUAL


	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES


	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	13.9	13.8

GRAPHS


Iron (ppm)

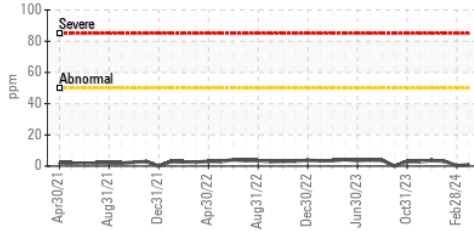


Aluminum (ppm)

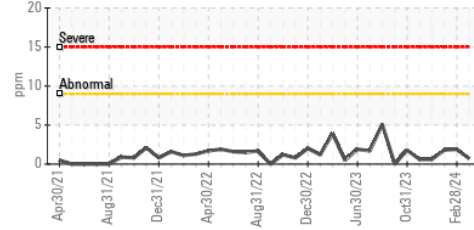


Copper (ppm)

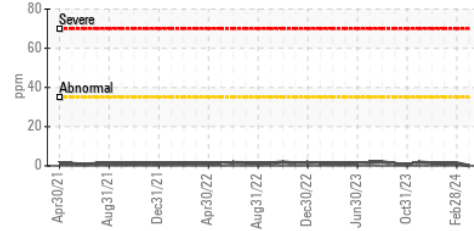


Viscosity @ 100°C

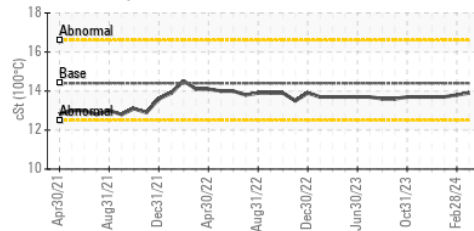


Lead (ppm)

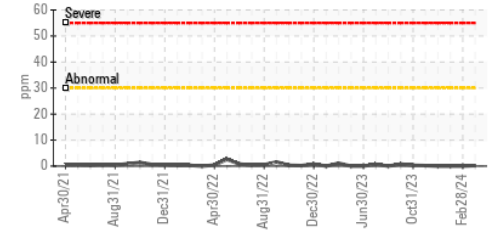


Chromium (ppm)

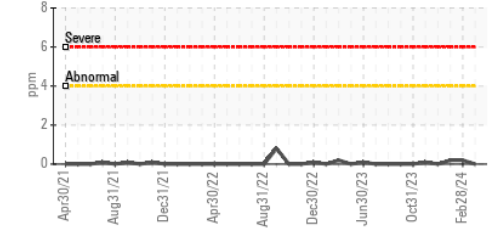

Silicon (ppm)

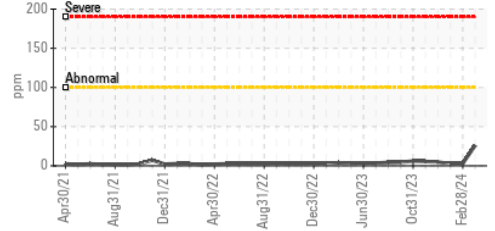

Base Number

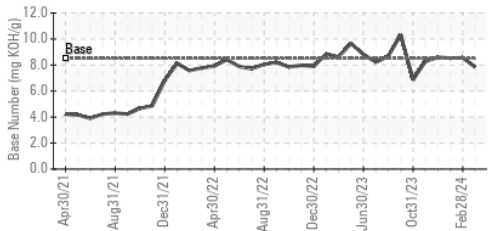

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : PCA0098890

Lab Number : 06142450

Unique Number : 10967258

Test Package : MOB 2 (Additional Tests: FuelDilution, PercentFuel)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 08 Apr 2024

Tested : 11 Apr 2024

Diagnosed : 11 Apr 2024 - Jonathan Hester

Magellan Midstream LP - Albert Lea

11406 755th Avenue

Glenville, MN

US 56036

Contact: Shawn Duren

shawn.duren@magellanlp.com

T: (641)231-6666

F: