

OIL ANALYSIS REPORT









TALLASSEE 814046 Component Diesel Engine

PETRO CANADA DURON SHP 15W40 (--- GAL

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

The copper level is abnormal. In the absence of other significant wear metals, suspect copper due to sources other than wear (i.e. cooling core). All other metal levels are typical for a new component breaking in.

Contamination

Fuel content negligible. Elemental level of silicon (Si) above normal indicating ingress of seal material.


Fluid Condition

The oil viscosity is lower than normal. The BN result indicates that there is suitable alkalinity remaining in the oil. Confirm oil type.

| N SHP 15W40 (| - GAL) | | | Apr2024 | | |
|---|---|---|---|--|-------------------------------------|----------------------------|
| · | | | | | | |
| SAMPLE INFOR | MATION | method | limit/base | current | history1 | history2 |
| Sample Number | | Client Info | | GFL0081850 | | |
| Sample Date | | Client Info | | 01 Apr 2024 | | |
| Machine Age | hrs | Client Info | | 640 | | |
| Oil Age | hrs | Client Info | | 640 | | |
| Oil Changed | | Client Info | | N/A | | |
| Sample Status | | | | ABNORMAL | | |
| CONTAMINAT | ION | method | limit/base | current | history1 | history2 |
| Water | | WC Method | >0.2 | NEG | | |
| Glycol | | WC Method | | NEG | | |
| WEAR METAL | S | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | \120 | 45 | | |
| Chromium | ppm | ASTM D5185m | >20 | <1 | | |
| Nickel | ppm | ASTM D5185m | >5 | 12 | | |
| Titanium | | ASTM D5185m | >2 | <1 | | |
| Silver | ppm | ASTM D5185m | >2 | <1 | | |
| Aluminum | ppm | ASTM D5185m | >20 | 7 | | |
| | ppm | ASTM D5185m | >40 | 0 | | |
| Lead | ppm | | | ∆ 349 | | |
| Copper | ppm | ASTM D5185m | >330 | | | |
| Tin Vanadium | ppm | ASTM D5185m | >15 | 3 | | |
| | ppm | ASTM D5185m | | 0 | | |
| Cadmium | ppm | ASTM D5185m | | 0 | | |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | 0 | 180 | | |
| Barium | | ACTM DE10Em | 0 | 0 | | |
| | ppm | ASTM D5185m | - | • | | |
| Molybdenum | ppm | ASTM D5185m | 60 | 123 | | |
| Molybdenum Manganese | | | | | | |
| - | ppm | ASTM D5185m | 60 | 123 | | |
| Manganese | ppm | ASTM D5185m ASTM D5185m | 60 | 123 5 | | |
| Manganese Magnesium | ppm ppm | ASTM D5185m ASTM D5185m ASTM D5185m | 60 0 1010 | 123 5 720 | | |
| Manganese Magnesium Calcium | ppm ppm ppm | ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m | 60 0 1010 1070 | 123 5 720 1462 | | |
| Manganese Magnesium Calcium Phosphorus | ppm ppm ppm ppm | ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m | 60 0 1010 1070 1150 | 123 5 720 1462 682 | | |
| Manganese Magnesium Calcium Phosphorus Zinc | ppm ppm ppm ppm ppm ppm | ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m | 60 0 1010 1070 1150 1270 | 123 5 720 1462 682 803 | | |
| Manganese Magnesium Calcium Phosphorus Zinc Sulfur | ppm ppm ppm ppm ppm ppm | ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m | 60 0 1010 1070 1150 1270 2060 | 123 5 720 1462 682 803 2295 | | |
| Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN | ppm ppm ppm ppm ppm ppm ppm | ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m | 60 0 1010 1070 1150 1270 2060 | 123 5 720 1462 682 803 2295 | history1 | |
| Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon | ppm ppm ppm ppm ppm ppm ppm ppm | ASTM D5185m Method ASTM D5185m | 60 0 1010 1070 1150 1270 2060 | 123 5 720 1462 682 803 2295 current 81 | history1 | history2 |
| Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium | ppm | ASTM D5185m | 60 0 1010 1070 1150 1270 2060 limit/base >25 | 123 5 720 1462 682 803 2295 current 81 2 | history1 | history2 |
| Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium | ppm | ASTM D5185m | 60 0 1010 1070 1150 1270 2060 limit/base >25 | 123 5 720 1462 682 803 2295 current 81 2 12 | history1 | history2 |
| Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium Fuel | ppm | ASTM D5185m | 60 0 1010 1070 1150 1270 2060 limit/base >25 >20 >3.0 | 123 5 720 1462 682 803 2295 current 81 2 12 0.4 | history1 | history2 |
| Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium Fuel INFRA-RED | ppm | ASTM D5185m | 60 0 1010 1070 1150 1270 2060 limit/base >25 >20 >3.0 limit/base | 123 5 720 1462 682 803 2295 current | history1 history1 | history2 history2 |
| Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium Fuel INFRA-RED Soot % | ppm | ASTM D5185m ASTM D7844 | 60 0 1010 1070 1150 1270 2060 limit/base >25 >20 >3.0 limit/base | 123 5 720 1462 682 803 2295 current 81 2 12 0.4 current 0.5 | history1 history1 history1 | history2 history2 history2 |
| Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium Fuel INFRA-RED Soot % Nitration | ppm | ASTM D5185m ASTM D3524 method *ASTM D7844 *ASTM D7624 *ASTM D76145 | 60 0 1010 1070 1150 1270 2060 limit/base >25 >20 >3.0 limit/base >4 >20 | 123 5 720 1462 682 803 2295 current 81 2 12 0.4 current 0.5 10.5 | history1 history1 | history2 history2 |
| Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium Fuel INFRA-RED Soot % Nitration Sulfation | ppm | ASTM D5185m ASTM D3524 method *ASTM D7844 *ASTM D7624 *ASTM D76145 | 60 0 1010 1070 1150 1270 2060 limit/base >25 >20 >3.0 limit/base >4 >20 >30 | 123 5 720 1462 682 803 2295 | history1 history1 | history2 history2 |
| Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium Fuel INFRA-RED Soot % Nitration Sulfation FLUID DEGRAI | ppm | ASTM D5185m ASTM D3524 method *ASTM D7844 *ASTM D7844 *ASTM D7844 *ASTM D7844 | 60 0 1010 1070 1150 1270 2060 limit/base >25 >20 >3.0 limit/base >4 >20 >30 limit/base | 123 5 720 1462 682 803 2295 current 81 2 12 0.4 current 0.5 10.5 24.3 current | history1 history1 history1 history1 | history2 history2 |



OIL ANALYSIS REPORT

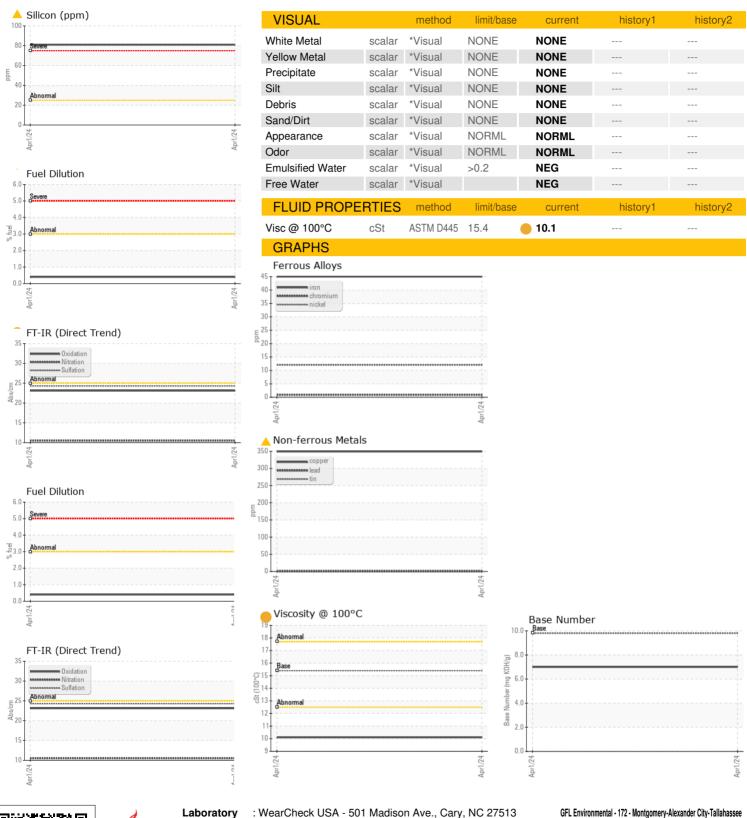



Certificate 12367

Laboratory Sample No.

: GFL0081850 Lab Number : 06144930 Unique Number : 10969738

Received : 10 Apr 2024 **Tested**

: 15 Apr 2024 Diagnosed : 15 Apr 2024 - Jonathan Hester Test Package: FLEET (Additional Tests: FuelDilution, PercentFuel)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

US 36108 Contact: BRANDON HURST brandonhurst@gflenv.com T:

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: GFL172 [WUSCAR] 06144930 (Generated: 04/15/2024 10:58:05) Rev: 1

Submitted By: Lisa Reeves

F:

Multiple Sites

Montgomery, AL