


# OIL ANALYSIS REPORT

## Sample Rating Trend



**NORMAL**

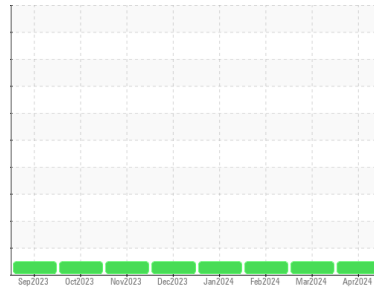

Machine Id

**45**  
Component  
**Compressor**  
Fluid

**PETRO CANADA SENTRON LD 3000 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the component.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PCA0111988</b>	PCA0103463	PCA0117177
Sample Date	Client Info		<b>02 Apr 2024</b>	05 Mar 2024	01 Feb 2024
Machine Age	hrs	Client Info	<b>97165</b>	96584	95823
Oil Age	hrs	Client Info	<b>6356</b>	5773	5012
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>4</b>	<1	1
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>1</b>	1	1
Lead	ppm	ASTM D5185m >25	<b>4</b>	3	3
Copper	ppm	ASTM D5185m >50	<b>6</b>	4	3
Tin	ppm	ASTM D5185m >15	<b>2</b>	2	1
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 1	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 2	<b>2</b>	<1	0
Manganese	ppm	ASTM D5185m 1	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m 5	<b>9</b>	10	11
Calcium	ppm	ASTM D5185m 1220	<b>1248</b>	1197	1218
Phosphorus	ppm	ASTM D5185m 298	<b>285</b>	273	288
Zinc	ppm	ASTM D5185m 350	<b>329</b>	337	337
Sulfur	ppm	ASTM D5185m 1995	<b>2500</b>	2263	2336

## CONTAMINANTS


	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>2</b>	1	1
Sodium	ppm	ASTM D5185m	<b>0</b>	2	2
Potassium	ppm	ASTM D5185m >20	<b>2</b>	<1	2

## FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.86	<b>0.542</b>	0.17	0.13

# OIL ANALYSIS REPORT


Viscosity @ 40°C

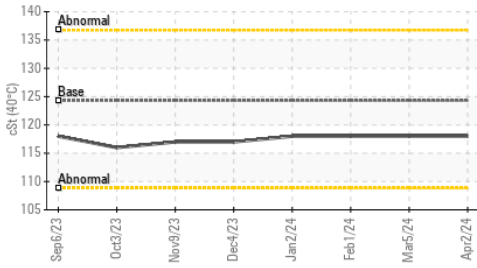


Acid Number

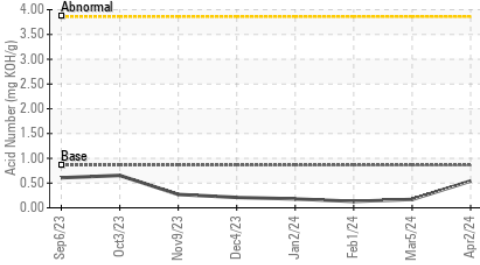

Acid Number

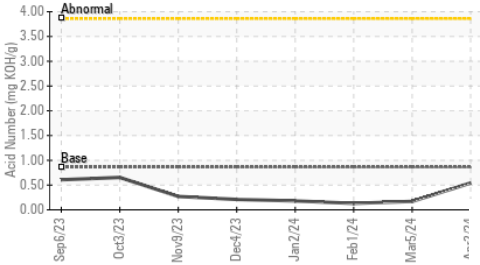


Base Number

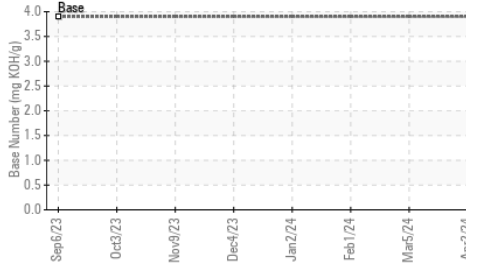









VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	124.3	118	118

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color	no image	no image			
Bottom	no image	no image			

## GRAPHS

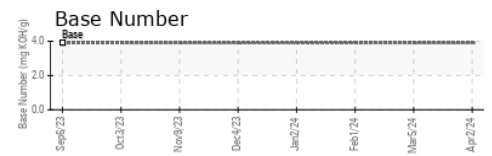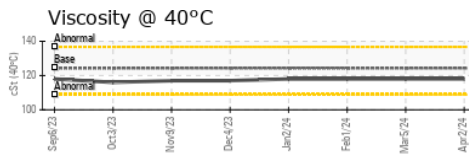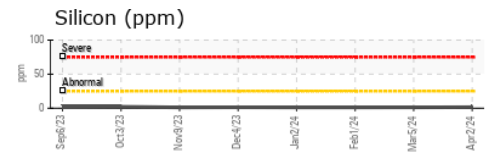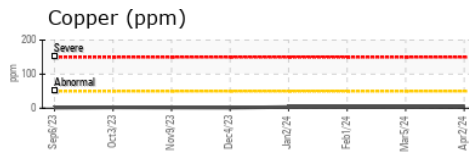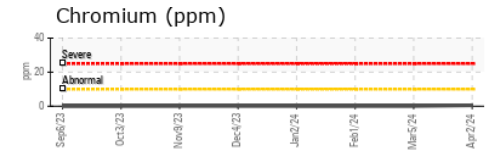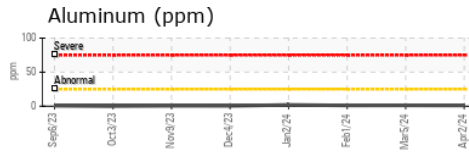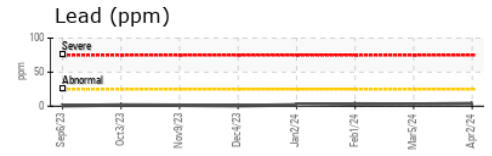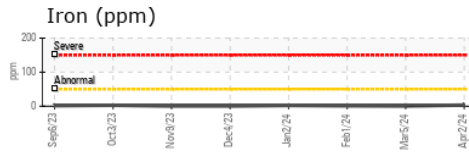

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513

**Sample No.** : PCA0111988

**Lab Number** : 06146007

**Unique Number** : 10976085

**Test Package** : MOB 2 ( Additional Tests: FuelDilution, PercentFuel, TBN )

**Received** : 11 Apr 2024

**Tested** : 15 Apr 2024

**Diagnosed** : 15 Apr 2024 - Doug Bogart

**ENERVEST OPERATING - HAYSİ BOOSTER**

1705 BREAKS PARK ROAD

HAYSİ, VA

US 24256

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: