


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

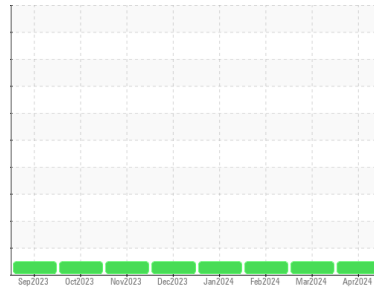

Machine Id

41
Component
Compressor
Fluid

PETRO CANADA SENTRON LD 3000 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		PCA0111989	PCA0103466	PCA0117173
Sample Date	Client Info		02 Apr 2024	05 Mar 2024	01 Feb 2024
Machine Age	hrs	Client Info	102419	101731	100961
Oil Age	hrs	Client Info	4915	4227	3457
Oil Changed	Client Info		Not Changed	Not Changed	Not Changed
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	3	0	3
Chromium	ppm	ASTM D5185m >10	<1	0	0
Nickel	ppm	ASTM D5185m	<1	<1	<1
Titanium	ppm	ASTM D5185m	<1	0	0
Silver	ppm	ASTM D5185m	<1	0	<1
Aluminum	ppm	ASTM D5185m >25	1	1	2
Lead	ppm	ASTM D5185m >25	2	2	6
Copper	ppm	ASTM D5185m >50	6	4	14
Tin	ppm	ASTM D5185m >15	2	2	7
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	1	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5	0	0	0
Barium	ppm	ASTM D5185m 1	0	0	0
Molybdenum	ppm	ASTM D5185m 2	2	0	<1
Manganese	ppm	ASTM D5185m 1	<1	<1	<1
Magnesium	ppm	ASTM D5185m 5	8	10	19
Calcium	ppm	ASTM D5185m 1220	1238	1192	1385
Phosphorus	ppm	ASTM D5185m 298	294	272	311
Zinc	ppm	ASTM D5185m 350	332	338	372
Sulfur	ppm	ASTM D5185m 1995	2606	2264	2620





CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	2	1	1
Sodium	ppm	ASTM D5185m	0	2	3
Potassium	ppm	ASTM D5185m >20	2	<1	5

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.86	0.537	0.639	0.766

OIL ANALYSIS REPORT

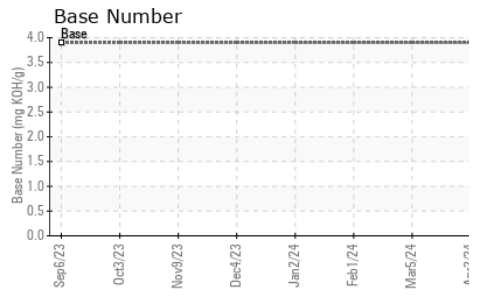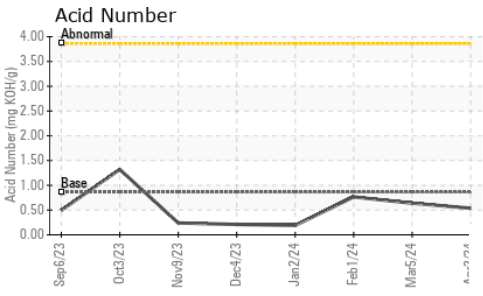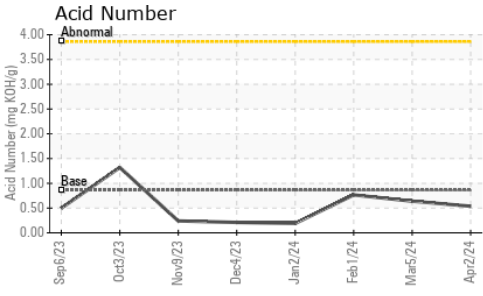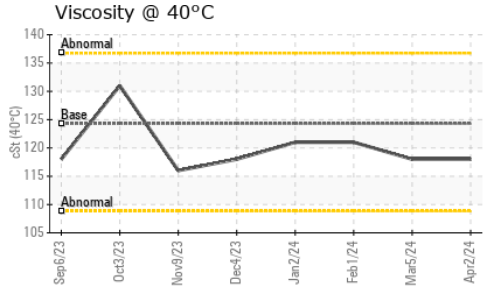









VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	124.3	118	121

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color	no image	no image	
Bottom	no image	no image	

GRAPHS

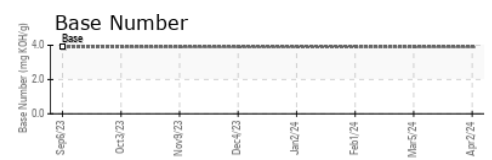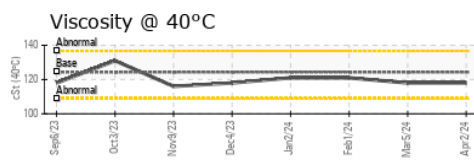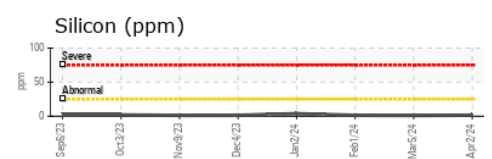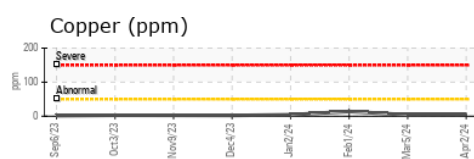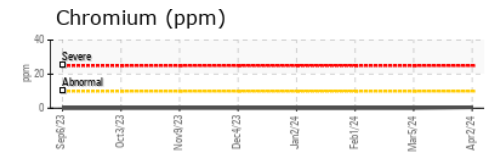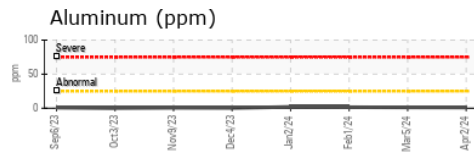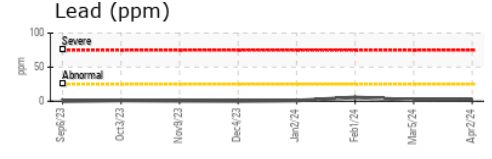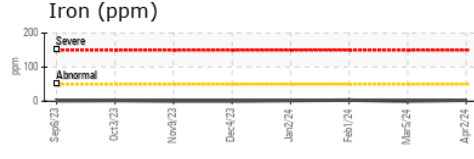

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0111989 **Received** : 11 Apr 2024
Lab Number : **06146008** **Tested** : 15 Apr 2024
Unique Number : 10976086 **Diagnosed** : 15 Apr 2024 - Doug Bogart
Test Package : MOB 2 (Additional Tests: FuelDilution, PercentFuel, TBN)

ENERVEST OPERATING - HAYSI BOOSTER
 1705 BREAKS PARK ROAD
 HAYSI, VA
 US 24256
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: