


OIL ANALYSIS REPORT



Machine Id
Ramsey Ridge 1
Component
Natural Gas Engine
Fluid
PETRO CANADA SENTRON LD 3000 (--- GAL)

Sample Rating Trend

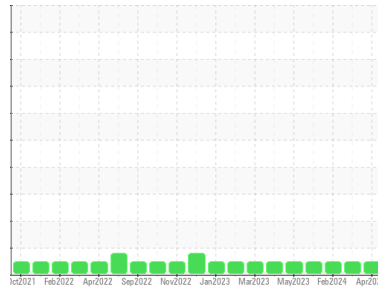

NORMAL



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

Fuel content negligible. There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		PCA0117206	PCA0111944	PCA0111945
Sample Date	Client Info		10 Apr 2024	29 Feb 2024	06 Feb 2024
Machine Age	hrs	Client Info	134461	133645	123096
Oil Age	hrs	Client Info	3353	2537	2068
Oil Changed	Client Info		N/A	Not Changd	Not Changd
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	1	0	1
Chromium	ppm	ASTM D5185m >4	<1	0	<1
Nickel	ppm	ASTM D5185m >2	<1	0	<1
Titanium	ppm	ASTM D5185m	<1	0	<1
Silver	ppm	ASTM D5185m >3	0	0	<1
Aluminum	ppm	ASTM D5185m >9	1	1	<1
Lead	ppm	ASTM D5185m >30	2	0	<1
Copper	ppm	ASTM D5185m >35	<1	0	<1
Tin	ppm	ASTM D5185m >4	1	<1	<1
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	<1	0	<1

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5	0	0	<1
Barium	ppm	ASTM D5185m 1	0	0	5
Molybdenum	ppm	ASTM D5185m 2	2	0	2
Manganese	ppm	ASTM D5185m 1	<1	<1	<1
Magnesium	ppm	ASTM D5185m 5	6	8	6
Calcium	ppm	ASTM D5185m 1220	1288	1214	1179
Phosphorus	ppm	ASTM D5185m 298	300	274	245
Zinc	ppm	ASTM D5185m 350	346	345	319
Sulfur	ppm	ASTM D5185m 1995	2600	2238	2360

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >+100	2	1	2
Sodium	ppm	ASTM D5185m >20	0	1	0
Potassium	ppm	ASTM D5185m >20	1	1	<1
Fuel	%	ASTM D3524 >4.0	0.1	0.2	0.2






INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0	0	0
Nitration	Abs/cm	*ASTM D7624 >15	3.8	3.8	3.8
Sulfation	Abs/.1mm	*ASTM D7415 >25	14.2	14.3	14.3

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >20	8.1	8.2	8.1
Acid Number (AN)	mg KOH/g	ASTM D8045 0.86	0.809	0.21	0.33
Base Number (BN)	mg KOH/g	ASTM D2896 3.9	3.63	3.57	4.12









OIL ANALYSIS REPORT

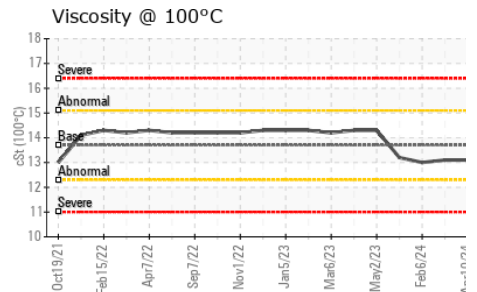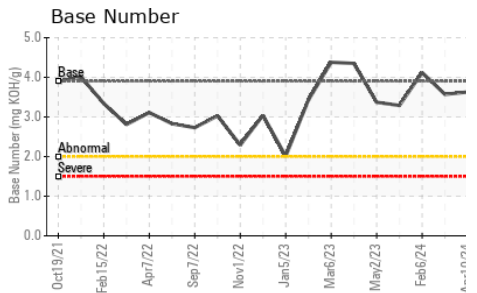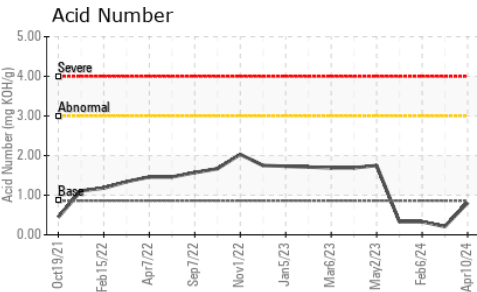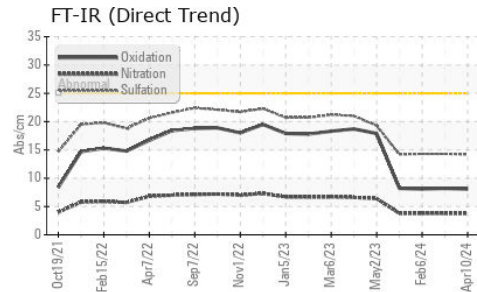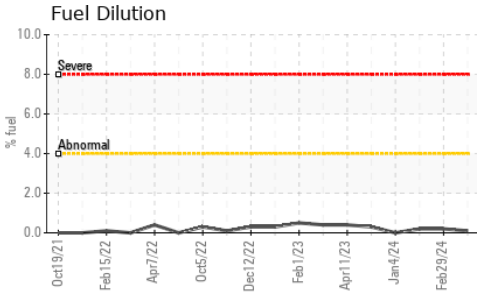

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.7	13.1	13.0

GRAPHS

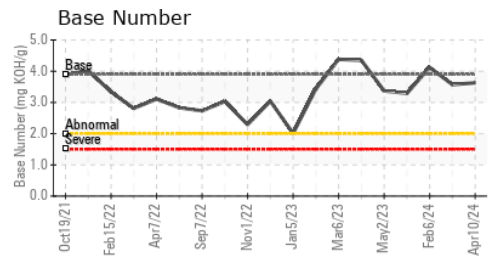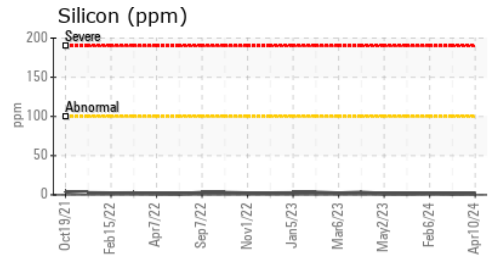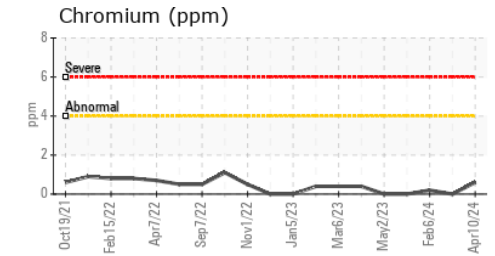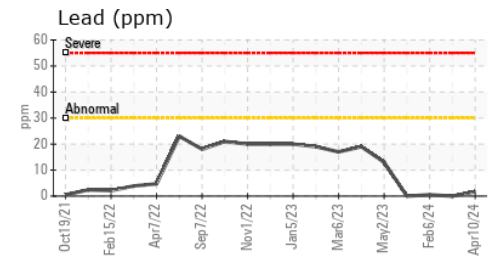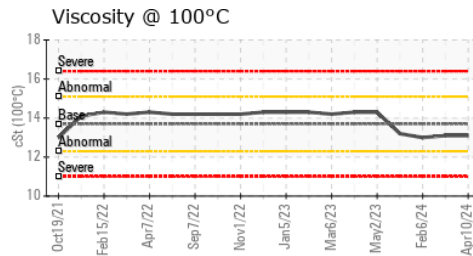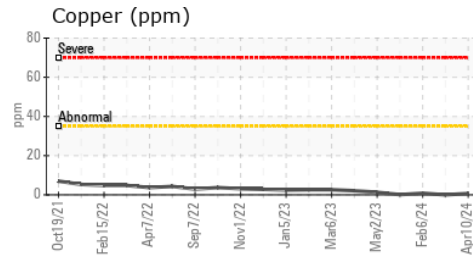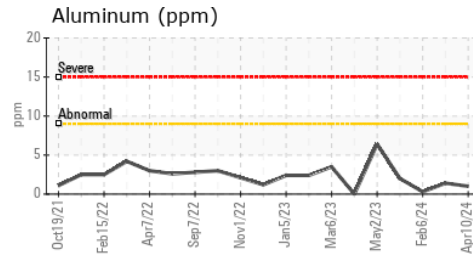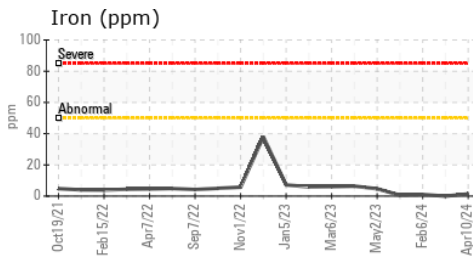

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : PCA0117206

Lab Number : 06146040

Unique Number : 10976118

Test Package : MOB 2 (Additional Tests: FuelDilution, PercentFuel)

Received : 11 Apr 2024

Tested : 16 Apr 2024

Diagnosed : 16 Apr 2024 - Jonathan Hester

ENERVEST OPERATING - RAMSEY RIDGE

2368 RAMSEY RIDGE

CLINCHCO, VA

US 24226

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: