


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

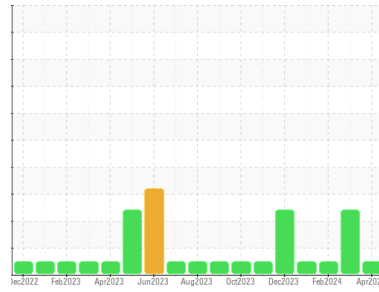

Machine Id
Poplar Gap B
 Component
Natural Gas Engine
 Fluid
PETRO CANADA SENTRON LD 3000 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

Fuel content negligible. There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	PCA0117151	PCA0112036	PCA0117164	
Sample Date	Client Info	01 Apr 2024	04 Mar 2024	01 Feb 2024	
Machine Age	hrs	Client Info	86998	86332	85570
Oil Age	hrs	Client Info	427	4563	3801
Oil Changed	Client Info	Not Changed	Not Changed	Not Changed	
Sample Status		NORMAL	ABNORMAL	NORMAL	

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.1	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	2	4	6
Chromium	ppm	ASTM D5185m >4	<1	<1	<1
Nickel	ppm	ASTM D5185m >2	<1	<1	<1
Titanium	ppm	ASTM D5185m	<1	0	0
Silver	ppm	ASTM D5185m >3	0	0	0
Aluminum	ppm	ASTM D5185m >9	1	2	1
Lead	ppm	ASTM D5185m >30	1	4	3
Copper	ppm	ASTM D5185m >35	<1	1	1
Tin	ppm	ASTM D5185m >4	1	<1	<1
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 5	0	0	0
Barium	ppm	ASTM D5185m 1	0	0	0
Molybdenum	ppm	ASTM D5185m 2	4	3	2
Manganese	ppm	ASTM D5185m 1	<1	<1	<1
Magnesium	ppm	ASTM D5185m 5	21	17	17
Calcium	ppm	ASTM D5185m 1220	1324	1516	1573
Phosphorus	ppm	ASTM D5185m 298	311	309	338
Zinc	ppm	ASTM D5185m 350	352	410	412
Sulfur	ppm	ASTM D5185m 1995	2681	2491	2669

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >+100	2	2	2
Sodium	ppm	ASTM D5185m >20	0	2	2
Potassium	ppm	ASTM D5185m >20	1	1	2
Fuel	%	ASTM D3524 >4.0	0.0	0.3	0.4






INFRA-RED

method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844	0	0	0
Nitration	Abs/cm	*ASTM D7624 >15	4.6	10.4	9.7
Sulfation	Abs/.1mm	*ASTM D7415 >25	14.0	22.1	20.4

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414 >20	8.6	21.8	18.1
Acid Number (AN)	mg KOH/g	ASTM D8045 0.86	0.53	▲ 2.81	2.13
Base Number (BN)	mg KOH/g	ASTM D2896 3.9	3.97	▲ 2.25	2.47









OIL ANALYSIS REPORT

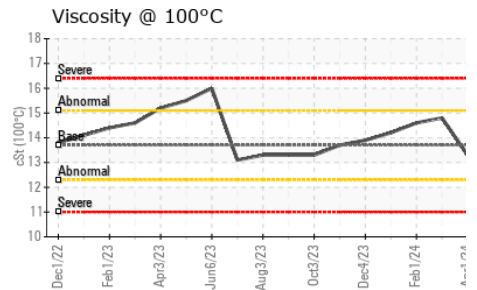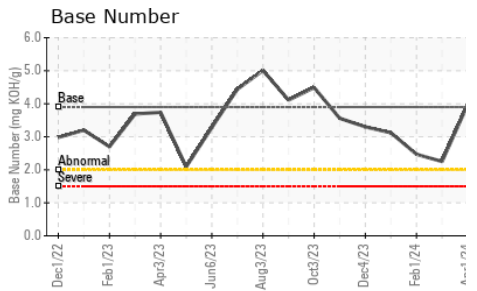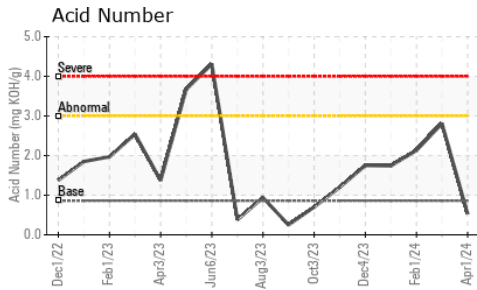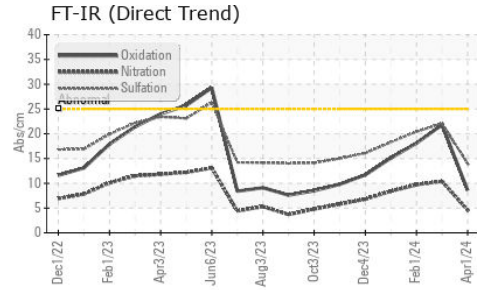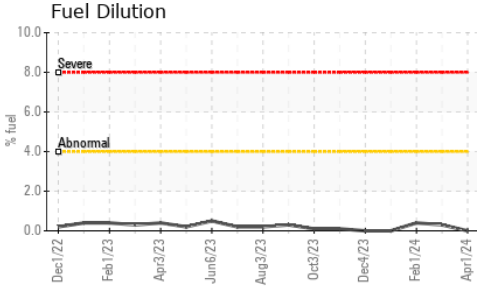

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.7	13.3	14.8

GRAPHS

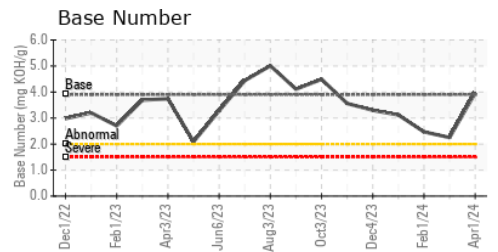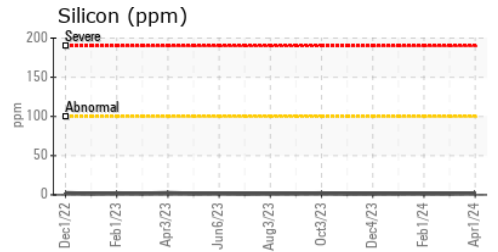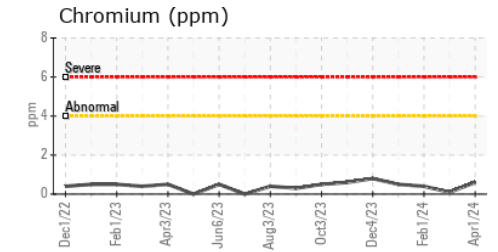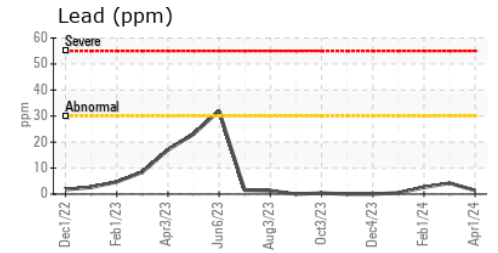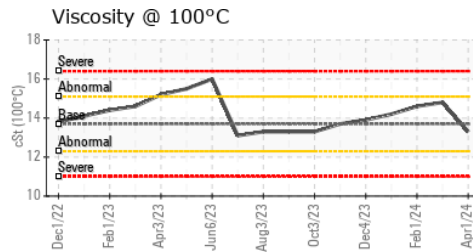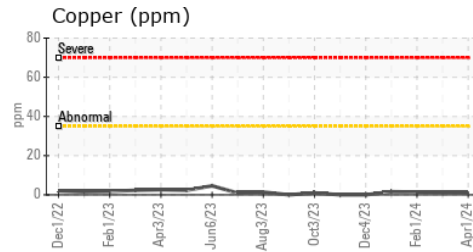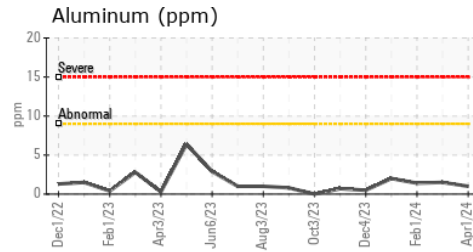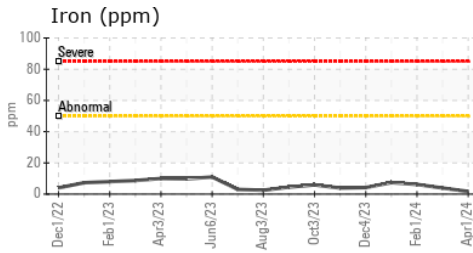

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : PCA0117151

Lab Number : 06146069

Unique Number : 10976147

Test Package : MOB 2 (Additional Tests: FuelDilution, PercentFuel)

Received : 11 Apr 2024

Tested : 16 Apr 2024

Diagnosed : 16 Apr 2024 - Jonathan Hester

ENERVEST OPERATING - POPLAR GAP B

1663 CRESCENT ROAD

GRUNDY, VA

US 24614

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: