

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

944005

Component Natural Gas Engine Fluid PETRO CANADA DURON GEO LD 15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition


The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORI	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		GFL0115512	GFL0106979	GFL0094261
Sample Date		Client Info		10 Apr 2024	06 Jan 2024	03 Oct 2023
Machine Age	hrs	Client Info		27267	26223	25876
Oil Age	hrs	Client Info		27267	347	705
Oil Changed		Client Info		Changed	N/A	Changed
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINAT	ION	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	NEG
WEAR METAL	S	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	17	19	9
Chromium	ppm	ASTM D5185m	>4	0	<1	<1
Nickel	ppm	ASTM D5185m	>2	0	0	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>9	<1	1	3
Lead	ppm	ASTM D5185m	>30	0	<1	1
Copper	ppm	ASTM D5185m	>35	0	<1	<1
Tin	ppm	ASTM D5185m	>4	0	<1	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	50	3	3	8
Barium	ppm	ASTM D5185m	5	0	0	0
Molybdenum	ppm	ASTM D5185m	50	56	57	48
Manganese	ppm	ASTM D5185m	0	0	<1	<1
Magnesium	ppm	ASTM D5185m	560	831	860	513
Calcium	ppm	ASTM D5185m	1510	1046	1041	1342
Phosphorus	ppm	ASTM D5185m	780	990	1049	733
Zinc	ppm	ASTM D5185m	870	1148	1239	949
Sulfur	ppm	ASTM D5185m	2040	3060	2960	2531
CONTAMINAN	TS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+100	2	3	4
Sodium	ppm	ASTM D5185m		17	15	5
Potassium	ppm	ASTM D5185m	>20	6	8	2
INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		1.5	1.5	0
Nitration	Abs/cm	*ASTM D7624	>20	10.5	9.9	9.4
Sulfation	Abs/.1mm	*ASTM D7415	>30	20.8	20.6	22.0
FLUID DEGRA	DATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	16.6	16.4	18.2
Base Number (BN)	mg KOH/g	ASTM D2896	10.2	8.9	8.6	4.7




OIL ANALYSIS REPORT



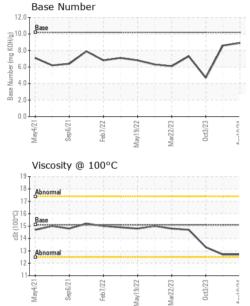

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPE	RTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.1	12.7	12.7	13.3
GRAPHS						

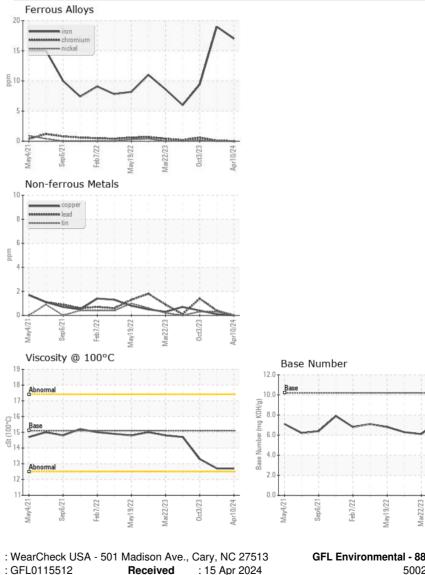

Laboratory GFL Environmental - 882 - Gainesville Sample No. : GFL0115512 Received : 15 Apr 2024 5002 SW 41st Blvd 5 Lab Number : 06148291 Tested : 16 Apr 2024 Gainesville, FL Unique Number : 10978369 Diagnosed : 17 Apr 2024 - Sean Felton US 32608 Test Package : FLEET Contact: ROBERT CLARK Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369. robert.clark@gflenv.com * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F:

Submitted By: CARL MIMS Page 2 of 2

Apr10/24