




OIL ANALYSIS REPORT

Sample Rating Trend

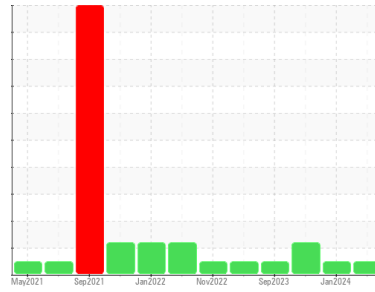

NORMAL



Machine Id

944028

Component

Natural Gas Engine

Fluid

PETRO CANADA DURON GEO LD 15W40 (--- LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		GFL0115507	GFL0106984	GFL0094267
Sample Date	Client Info		10 Apr 2024	06 Jan 2024	22 Sep 2023
Machine Age	hrs	Client Info	25246	25250	24594
Oil Age	hrs	Client Info	25246	656	39
Oil Changed	Client Info		Changed	N/A	Changed
Sample Status			NORMAL	NORMAL	ATTENTION

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	22	19	10
Chromium	ppm	ASTM D5185m >4	<1	<1	<1
Nickel	ppm	ASTM D5185m >2	<1	0	0
Titanium	ppm	ASTM D5185m	<1	0	0
Silver	ppm	ASTM D5185m >3	0	0	0
Aluminum	ppm	ASTM D5185m >9	2	<1	4
Lead	ppm	ASTM D5185m >30	1	<1	0
Copper	ppm	ASTM D5185m >35	<1	<1	4
Tin	ppm	ASTM D5185m >4	<1	<1	<1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 50	2	3	6
Barium	ppm	ASTM D5185m 5	0	0	0
Molybdenum	ppm	ASTM D5185m 50	67	57	57
Manganese	ppm	ASTM D5185m 0	<1	<1	<1
Magnesium	ppm	ASTM D5185m 560	942	877	600
Calcium	ppm	ASTM D5185m 1510	1180	1038	1592
Phosphorus	ppm	ASTM D5185m 780	1046	1037	713
Zinc	ppm	ASTM D5185m 870	1257	1238	1003
Sulfur	ppm	ASTM D5185m 2040	3173	2940	2436

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >+100	5	3	3
Sodium	ppm	ASTM D5185m	19	15	124
Potassium	ppm	ASTM D5185m >20	10	8	35

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	1.5	1.5	0
Nitration	Abs/cm	*ASTM D7624 >20	10.5	10.0	11.1
Sulfation	Abs/.1mm	*ASTM D7415 >30	20.8	20.7	23.7


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	16.6	16.5	19.5
Base Number (BN)	mg KOH/g	ASTM D2896 10.2	8.9	8.6	4.2




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

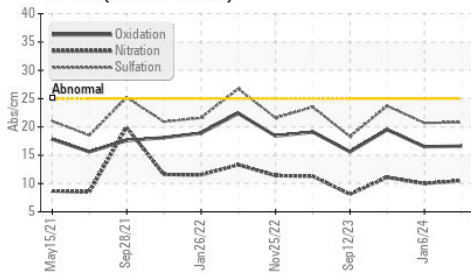

Base Number

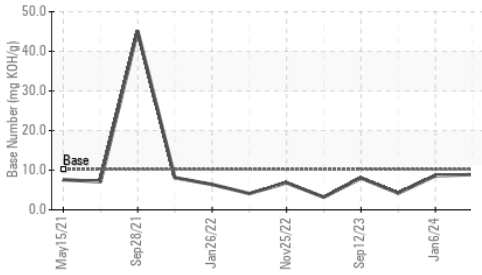

Viscosity @ 100°C

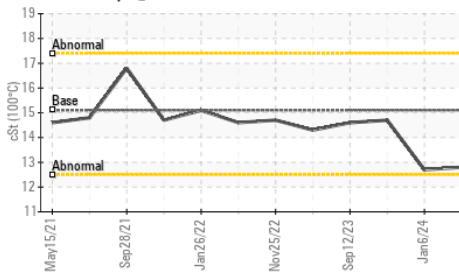


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.1	12.8	12.7

GRAPHS


Ferrous Alloys

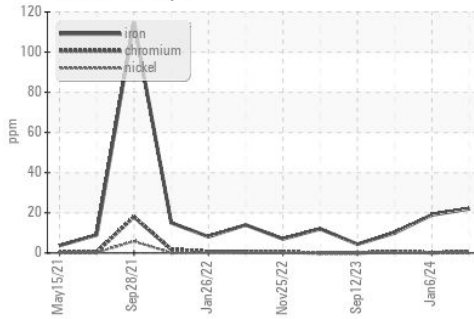


Non-ferrous Metals

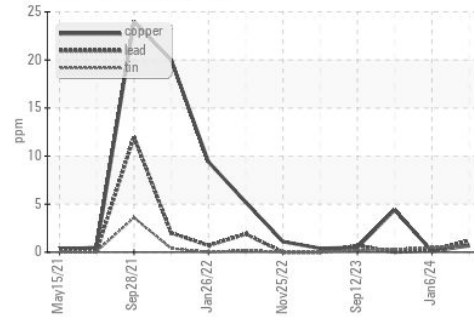

Viscosity @ 100°C

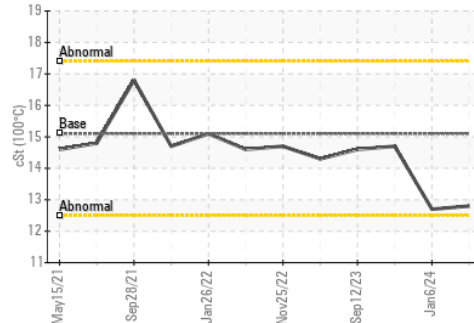

Base Number

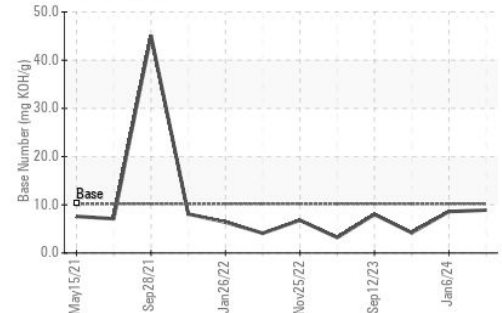

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : GFL0115507
 Lab Number : 06148296
 Unique Number : 10978374
 Test Package : FLEET

Received : 15 Apr 2024
 Tested : 16 Apr 2024
 Diagnosed : 17 Apr 2024 - Sean Felton

GFL Environmental - 882 - Gainesville
 5002 SW 41st Blvd
 Gainesville, FL
 US 32608
 Contact: ROBERT CLARK
 robert.clark@gflenv.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)