




OIL ANALYSIS REPORT

Sample Rating Trend

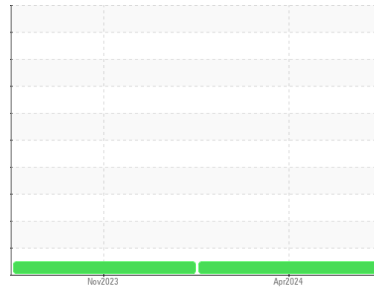

NORMAL



Machine Id

940000

Component

Natural Gas Engine

Fluid

PETRO CANADA DURON GEO LD 15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		GFL0113951	GFL0086731	---
Sample Date	Client Info		15 Apr 2024	14 Nov 2023	---
Machine Age	hrs	Client Info	12029	10931	---
Oil Age	hrs	Client Info	1098	10931	---
Oil Changed	Client Info		Changed	Changed	---
Sample Status			NORMAL	NORMAL	---

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	16	21	---
Chromium	ppm	ASTM D5185m >4	3	4	---
Nickel	ppm	ASTM D5185m >2	<1	<1	---
Titanium	ppm	ASTM D5185m	<1	<1	---
Silver	ppm	ASTM D5185m >3	<1	0	---
Aluminum	ppm	ASTM D5185m >9	4	2	---
Lead	ppm	ASTM D5185m >30	4	6	---
Copper	ppm	ASTM D5185m >35	4	5	---
Tin	ppm	ASTM D5185m >4	<1	<1	---
Vanadium	ppm	ASTM D5185m	<1	0	---
Cadmium	ppm	ASTM D5185m	<1	<1	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 50	21	11	---
Barium	ppm	ASTM D5185m 5	0	8	---
Molybdenum	ppm	ASTM D5185m 50	76	59	---
Manganese	ppm	ASTM D5185m 0	<1	1	---
Magnesium	ppm	ASTM D5185m 560	818	647	---
Calcium	ppm	ASTM D5185m 1510	2377	1855	---
Phosphorus	ppm	ASTM D5185m 780	1176	785	---
Zinc	ppm	ASTM D5185m 870	1470	1072	---
Sulfur	ppm	ASTM D5185m 2040	3978	2625	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >+100	12	12	---
Sodium	ppm	ASTM D5185m	11	5	---
Potassium	ppm	ASTM D5185m >20	3	3	---

INFRA-RED




	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0.1	0.1	---
Nitration	Abs/cm	*ASTM D7624 >20	11.8	13.1	---
Sulfation	Abs/.1mm	*ASTM D7415 >30	25.4	27.5	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	22.2	24.5	---
Base Number (BN)	mg KOH/g	ASTM D2896 10.2	3.9	3.1	---







OIL ANALYSIS REPORT

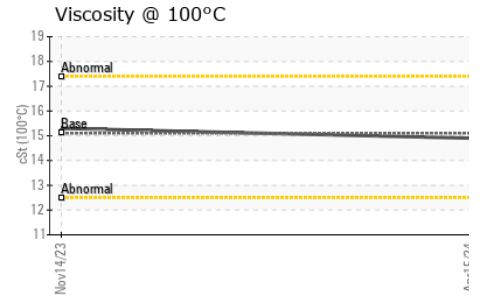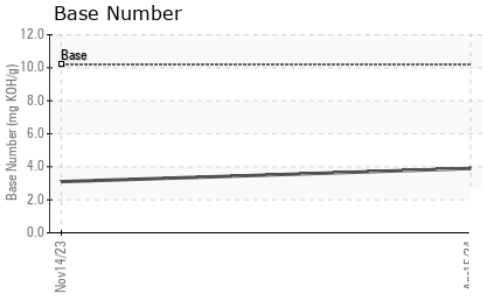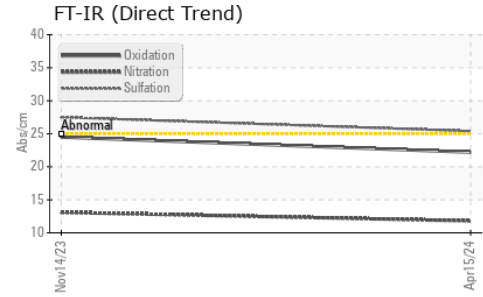

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.1	14.9	15.3

GRAPHS

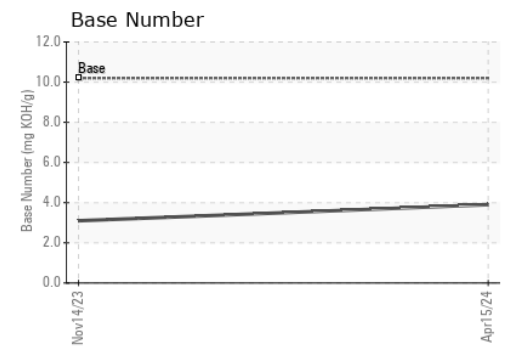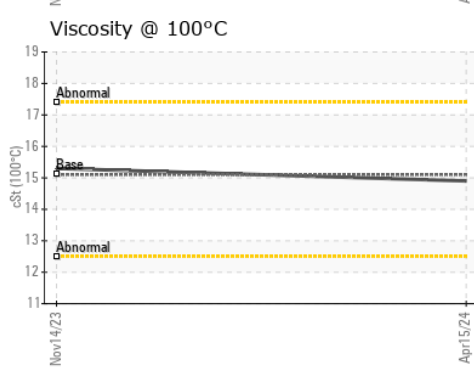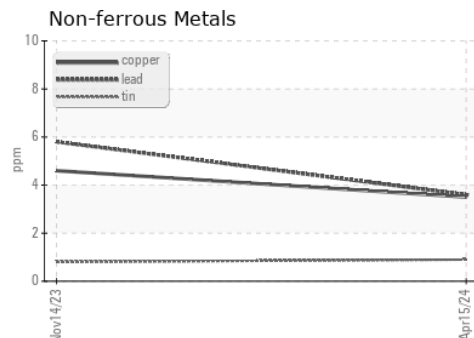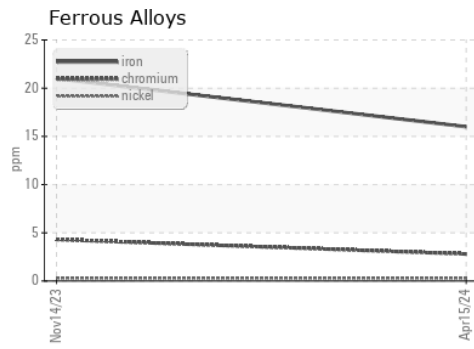

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : GFL0113951 **Received** : 19 Apr 2024
Lab Number : 06153966 **Tested** : 22 Apr 2024
Unique Number : 10989389 **Diagnosed** : 23 Apr 2024 - Don Baldrige
Test Package : FLEET

GFL Environmental - 932 - Muskego HC
 W144 S6400 College Ct.
 Muskego, WI
 US 53150
 Contact: Brian Schlomann
 brian.schlomann@gflenv.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)