


OIL ANALYSIS REPORT

Sample Rating Trend



ISO

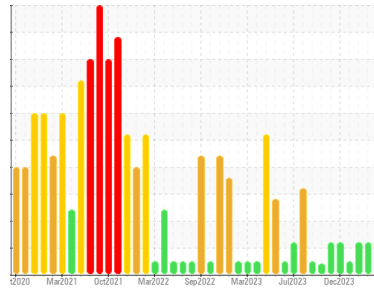

Area

MIX ROOM A [98938389]

Machine Id
KR-GR-003108 - W DUMPER 14A (S/N MIX A - 11513051)

Component

Hydraulic System

Fluid

AW HYDRAULIC OIL ISO 68 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. (Customer Sample Comment: 98938389)

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PCA0055959	PCA0119603	PCA0116072
Sample Date	Client Info	17 Apr 2024	20 Mar 2024	14 Mar 2024
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	Not Chngd	N/A	N/A
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

CONTAMINATION

method	limit/base	current	history1	history2	
Water	WC Method	>0.05	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>20	7	6	8
Chromium	ppm	ASTM D5185m	>20	2	3	3
Nickel	ppm	ASTM D5185m	>20	0	<1	<1
Titanium	ppm	ASTM D5185m		0	<1	<1
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>20	1	3	3
Lead	ppm	ASTM D5185m	>20	0	<1	<1
Copper	ppm	ASTM D5185m	>20	<1	<1	<1
Tin	ppm	ASTM D5185m	>20	0	<1	<1
Vanadium	ppm	ASTM D5185m		<1	<1	<1
Cadmium	ppm	ASTM D5185m		0	<1	<1

ADDITIVES

method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m	5	0	0	0
Barium	ppm	ASTM D5185m	5	0	0	0
Molybdenum	ppm	ASTM D5185m	5	0	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	25	<1	<1	0
Calcium	ppm	ASTM D5185m	200	<1	4	3
Phosphorus	ppm	ASTM D5185m	300	311	349	363
Zinc	ppm	ASTM D5185m	370	0	2	2
Sulfur	ppm	ASTM D5185m	2500	541	424	434

CONTAMINANTS

method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>15	<1	1	1
Sodium	ppm	ASTM D5185m		<1	0	0
Potassium	ppm	ASTM D5185m	>20	0	1	1

FLUID CLEANLINESS


method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>10000	▲ 124094	▲ 195567	▲ 217667
Particles >6µm	ASTM D7647	>2500	▲ 41399	▲ 35647	▲ 63121
Particles >14µm	ASTM D7647	>640	117	210	402
Particles >21µm	ASTM D7647	>160	5	47	47
Particles >38µm	ASTM D7647	>40	0	3	1
Particles >71µm	ASTM D7647	>10	0	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/16	▲ 24/23/14	▲ 25/22/15	▲ 25/23/16

FLUID DEGRADATION


method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D8045	0.57	0.049	0.07	0.08

OIL ANALYSIS REPORT


▲ Particle Trend

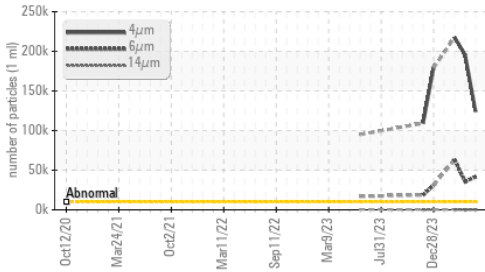


▲ Particle Trend

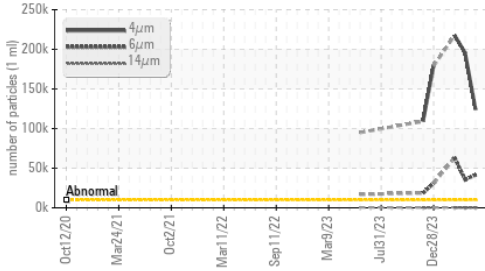

Acid Number

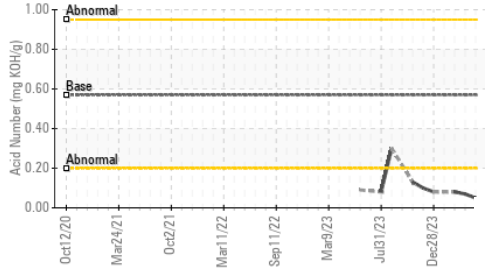

Viscosity @ 40°C

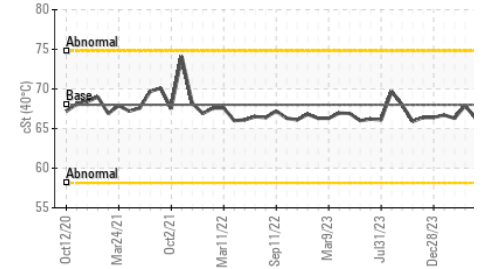

PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 68	66.3	67.9	66.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




GRAPHS


Ferrous Alloys

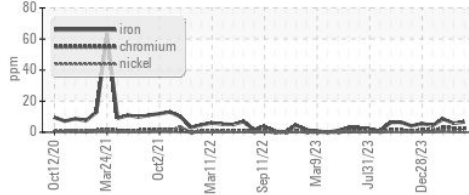


Non-ferrous Metals

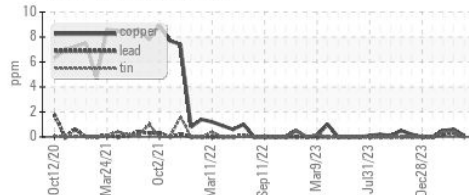


Viscosity @ 40°C

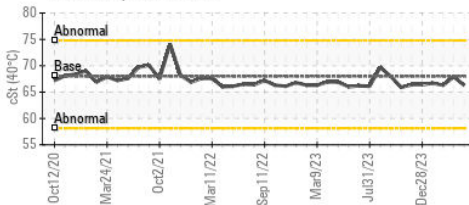

▲ Particle Count

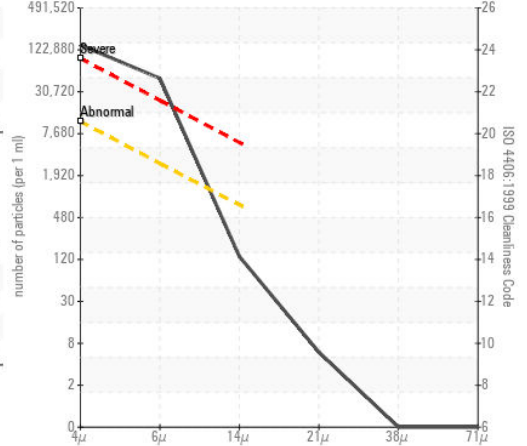

Acid Number

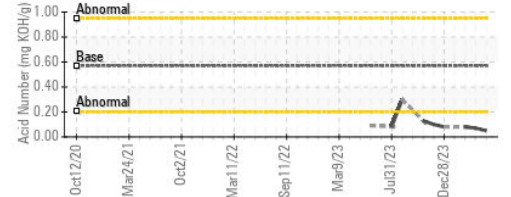

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0055959
Lab Number : 06155851
Unique Number : 10991274
Test Package : IND 2

Received : 22 Apr 2024
Tested : 23 Apr 2024
Diagnosed : 24 Apr 2024 - Don Baldrige

KraftHeinz - Kirksville - Plant 8333 PCA
 2504 INDUSTRIAL DR
 KIRKSVILLE, MO
 US 63501

Contact: WALLACE WARD
 wallace.ward@kraftheinzcompany.com

T: (660)627-1031

F: (660)627-5887

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)