


OIL ANALYSIS REPORT

Sample Rating Trend



ISO

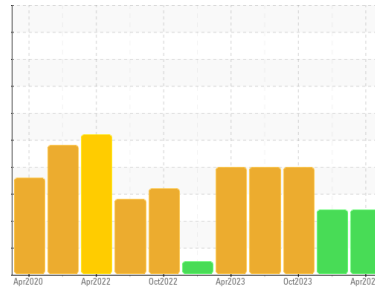

Area

INJECT B ROOM [98842773]

Machine Id

KR-GR-003241 - INCLINE AUGER B (SOUTH) (S/N INJECT B - 11513041)

Component

Gearbox

Fluid

PETRO CANADA 220 (6 QTS)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. (Customer Sample Comment: 98842773)

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PCA0114161	PCA0111164	PCA0104786
Sample Date	Client Info	17 Apr 2024	26 Dec 2023	02 Oct 2023
Machine Age	hrs	0	0	0
Oil Age	hrs	0	0	0
Oil Changed	Client Info	Not Chngd	Not Chngd	N/A
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.2	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >200	1	2	▲ 236
Chromium	ppm ASTM D5185m >15	0	0	1
Nickel	ppm ASTM D5185m >15	0	0	0
Titanium	ppm ASTM D5185m	<1	0	0
Silver	ppm ASTM D5185m	0	0	0
Aluminum	ppm ASTM D5185m >25	<1	0	0
Lead	ppm ASTM D5185m >100	0	0	0
Copper	ppm ASTM D5185m >200	0	0	<1
Tin	ppm ASTM D5185m >25	0	0	0
Vanadium	ppm ASTM D5185m	<1	0	0
Cadmium	ppm ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	34	36	0
Barium	ppm ASTM D5185m	5	0	0
Molybdenum	ppm ASTM D5185m	0	0	0
Manganese	ppm ASTM D5185m	0	<1	1
Magnesium	ppm ASTM D5185m	3	0	<1
Calcium	ppm ASTM D5185m	1316	973	5
Phosphorus	ppm ASTM D5185m	338	320	350
Zinc	ppm ASTM D5185m	5	0	7
Sulfur	ppm ASTM D5185m	14785	12201	3982

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >50	<1	<1	4
Sodium	ppm ASTM D5185m	7	10	2
Potassium	ppm ASTM D5185m >20	0	2	<1

FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	▲ 223779	▲ 447693	---
Particles >6µm	ASTM D7647 >2500	▲ 182217	▲ 356216	---
Particles >14µm	ASTM D7647 >640	▲ 38643	▲ 67894	---
Particles >21µm	ASTM D7647 >160	▲ 5403	▲ 13802	---
Particles >38µm	ASTM D7647 >40	▲ 16	▲ 180	---
Particles >71µm	ASTM D7647 >10	0	1	---
Oil Cleanliness	ISO 4406 (c) >20/18/16	▲ 25/25/22	▲ 26/26/23	---

FLUID DEGRADATION


method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045	0.50	0.57	0.48

OIL ANALYSIS REPORT


▲ Particle Trend

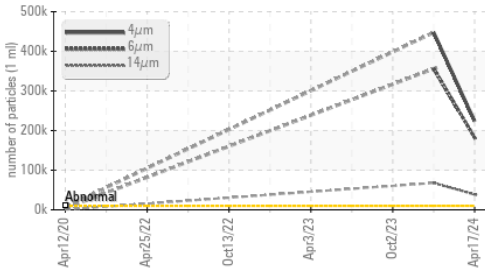


▲ Particle Trend

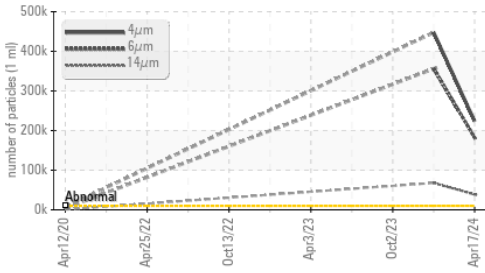

Acid Number

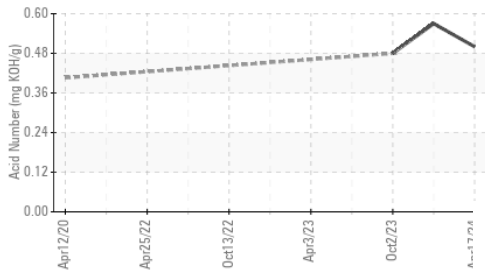

Viscosity @ 40°C

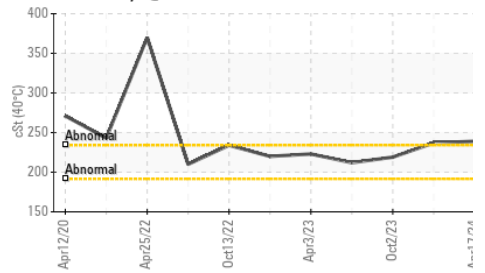

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	▲ HEAVY
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	● MILKY
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	0.2%
Free Water	scalar	*Visual		NEG	NEG





FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	239	237	219

SAMPLE IMAGES

Color

Bottom

GRAPHS

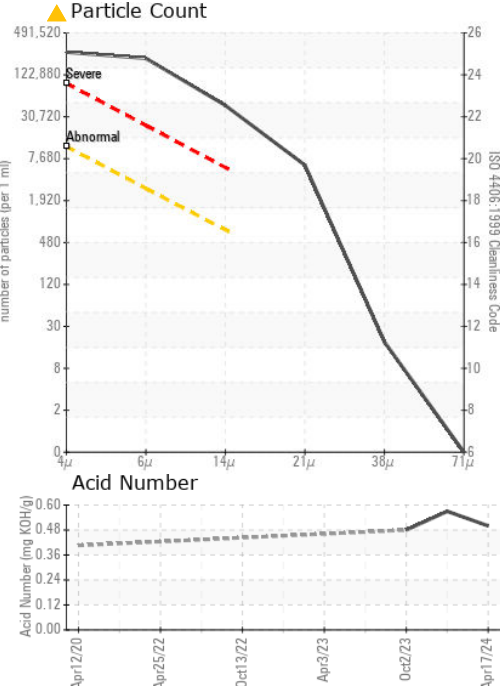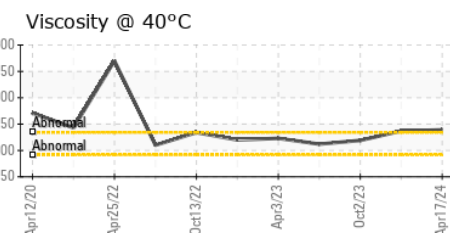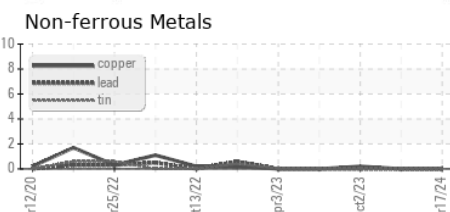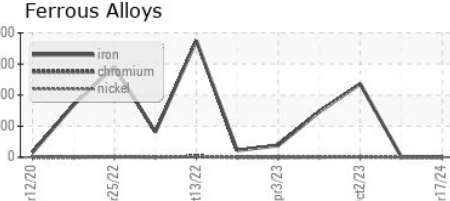

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0114161 **Received** : 22 Apr 2024
Lab Number : 06155876 **Tested** : 23 Apr 2024
Unique Number : 10991299 **Diagnosed** : 24 Apr 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: PrtCount)

KraftHeinz - Kirksville - Plant 8333 PCA
 2504 INDUSTRIAL DR
 KIRKSVILLE, MO
 US 63501
 Contact: WALLACE WARD
 wallace.ward@kraftheinzcompany.com
 T: (660)627-1031
 F: (660)627-5887

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)