


# OIL ANALYSIS REPORT

Area  
**INJECT B ROOM [98891843]**  
 Machine Id  
**KR-GR-003240 - INCLINE AUGER B (SOUTH) (S/N INJECT B - 11513041)**  
 Component  
**Gearbox**  
 Fluid  
**PETRO CANADA 220 (6 QTS)**

Sample Rating Trend

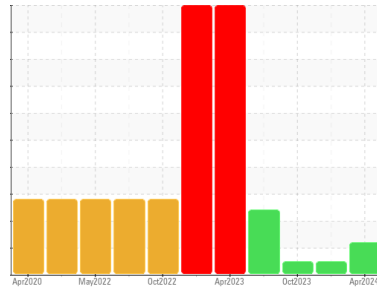

## DIAGNOSIS

**Recommendation**  
 We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. ( Customer Sample Comment: 98891843 )

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is a high amount of silt (particulates < 14 microns in size) present in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>PCA0055962</b>	PCA0088773	PCA0091773
Sample Date	Client Info	<b>16 Apr 2024</b>	22 Jan 2024	23 Oct 2023
Machine Age	hrs	<b>0</b>	0	0
Oil Age	hrs	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>ABNORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.2	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >200	<b>2</b>	0	<1
Chromium	ppm ASTM D5185m >15	<b>0</b>	0	<1
Nickel	ppm ASTM D5185m >15	<b>0</b>	0	0
Titanium	ppm ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm ASTM D5185m >25	<b>0</b>	<1	2
Lead	ppm ASTM D5185m >100	<b>0</b>	0	<1
Copper	ppm ASTM D5185m >200	<b>&lt;1</b>	0	<1
Tin	ppm ASTM D5185m >25	<b>0</b>	0	0
Vanadium	ppm ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	<b>&lt;1</b>	35	38
Barium	ppm ASTM D5185m	<b>0</b>	0	2
Molybdenum	ppm ASTM D5185m	<b>&lt;1</b>	0	<1
Manganese	ppm ASTM D5185m	<b>&lt;1</b>	<1	0
Magnesium	ppm ASTM D5185m	<b>1</b>	0	1
Calcium	ppm ASTM D5185m	<b>47</b>	1092	445
Phosphorus	ppm ASTM D5185m	<b>276</b>	340	330
Zinc	ppm ASTM D5185m	<b>37</b>	3	0
Sulfur	ppm ASTM D5185m	<b>12540</b>	12248	14965

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >50	<b>1</b>	1	<1
Sodium	ppm ASTM D5185m	<b>&lt;1</b>	8	4
Potassium	ppm ASTM D5185m >20	<b>&lt;1</b>	0	2





## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	<b>▲ 95909</b>	---	---
Particles >6µm	ASTM D7647 >2500	<b>▲ 20215</b>	---	---
Particles >14µm	ASTM D7647 >640	<b>610</b>	---	---
Particles >21µm	ASTM D7647 >160	<b>120</b>	---	---
Particles >38µm	ASTM D7647 >40	<b>5</b>	---	---
Particles >71µm	ASTM D7647 >10	<b>1</b>	---	---
Oil Cleanliness	ISO 4406 (c) >20/18/16	<b>▲ 24/22/16</b>	---	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045	<b>0.40</b>	---	---


# OIL ANALYSIS REPORT

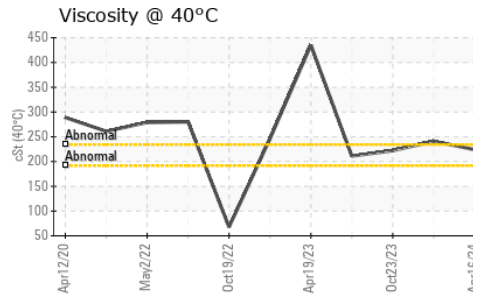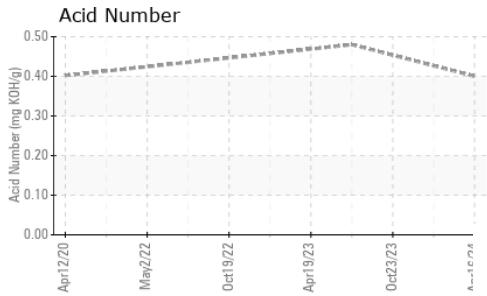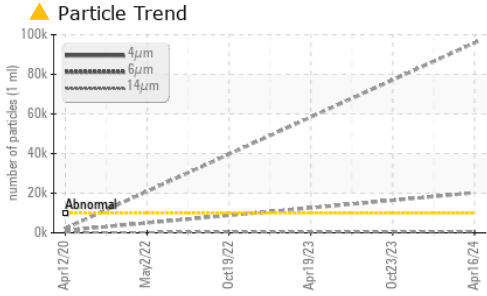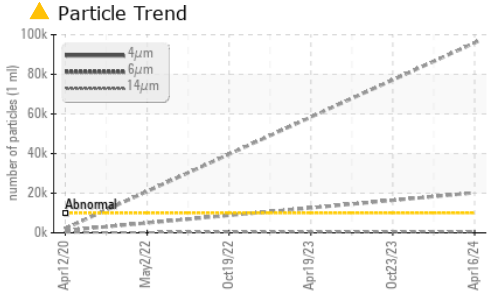





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	MODER	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	224	241	222

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

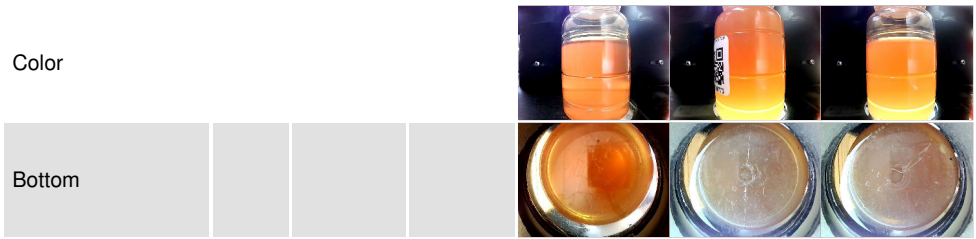

## GRAPHS

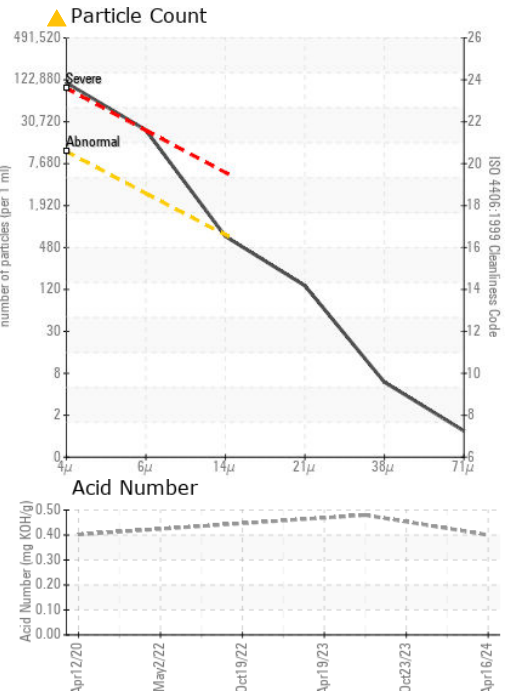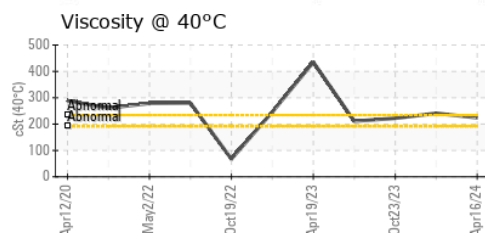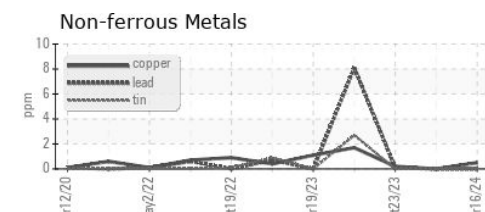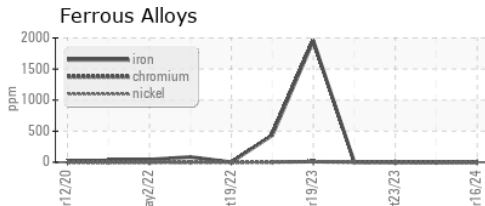

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0055962      **Received** : 22 Apr 2024  
**Lab Number** : 06155887      **Tested** : 23 Apr 2024  
**Unique Number** : 10991310      **Diagnosed** : 24 Apr 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**KraftHeinz - Kirksville - Plant 8333 PCA**  
 2504 INDUSTRIAL DR  
 KIRKSVILLE, MO  
 US 63501  
 Contact: WALLACE WARD  
 wallace.ward@kraftheinzcompany.com  
 T: (660)627-1031  
 F: (660)627-5887

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)