


# **OIL ANALYSIS REPORT**

Sample Rating Trend



# **Process Cheese [98968115] BLENDER 8**

Component **Gearbox** 

GEAR OIL ISO 320 (--- GAL)

### DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


### **Fluid Condition**


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORI	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		PCA0117534	PCA0114266	PCA0101663
Sample Date		Client Info		10 Apr 2024	25 Jan 2024	01 Nov 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Filtered	Filtered	Filtered
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINAT	ION	method	limit/base	current	history1	history2
Water		WC Method	>0.2	NEG	NEG	NEG
WEAR METAL	S	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	<1	0	0
Chromium	ppm	ASTM D5185m	>15	<1	<1	<1
Nickel	ppm	ASTM D5185m	>15	<1	0	0
Titanium	ppm	ASTM D5185m		<1	<1	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	2	2	2
Lead	ppm	ASTM D5185m	>100	0	<1	0
Copper	ppm	ASTM D5185m	>200	<1	<1	<1
Tin	ppm	ASTM D5185m	>25	<1	<1	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	50	0	0	0
Barium	ppm	ASTM D5185m	15	0	0	0
Molybdenum	ppm	ASTM D5185m	15	<1	<1	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	50	<1	0	<1
Calcium	ppm	ASTM D5185m	50	0	1	1
Phosphorus	ppm	ASTM D5185m	350	478	425	462
Zinc	ppm	ASTM D5185m	100	0	0	0
Sulfur	ppm	ASTM D5185m	12500	1282	1251	1071
CONTAMINAN	TS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	2	1	3
Sodium	ppm	ASTM D5185m		0	0	0
Potassium	ppm	ASTM D5185m	>20	<1	2	1
FLUID CLEANI	INESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>1300	347	198	417
Particles >6µm		ASTM D7647	>320	69	55	108
Particles >14µm		ASTM D7647	>80	13	6	9
Particles >21µm		ASTM D7647	>20	3	2	3
Particles >38µm		ASTM D7647	>4	0	0	1
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>17/15/13	16/13/11	15/13/10	16/14/10
FLUID DEGRA	DATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	0.38	0.34	0.39




## **OIL ANALYSIS REPORT**










VISUAL		method				history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
<b>Emulsified Water</b>	scalar	*Visual	>0.2	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROP	ERIIES	metnoa	ilmit/base	current	nistory i	nistory2
Visc @ 40°C	cSt	ASTM D445	320	318	313	311

Color

**Bottom** 

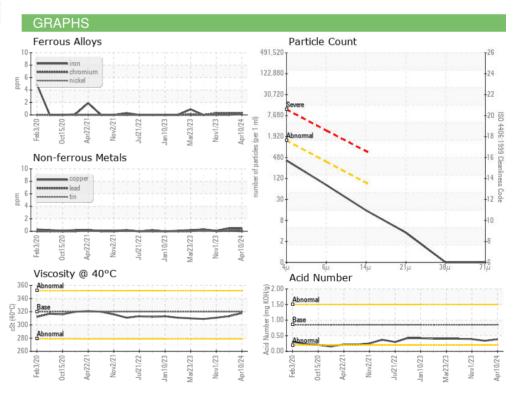





Certificate 12367

Sample No.

Laboratory

Unique Number : 10993081

: PCA0117534 Lab Number : 06157658

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received

: 23 Apr 2024 **Tested** Diagnosed

: 24 Apr 2024 : 25 Apr 2024 - Angela Borella

2035 E BENNETT SPRINGFIELD, MO US 65804

Contact: Service Manager

KraftHeinz - Springfield - Plant 8311 PCA

Test Package : IND 2 ( Additional Tests: PrtCount ) To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: