

OIL ANALYSIS REPORT

Area **UTILITIES** [98855411] AC-2 (S/N 22819)

Rotary Compressor

INGERSOLL-RAND TECHTROL GOLD (75 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

Confirm oil type. The AN level is acceptable for this fluid.



Sample Rating Trend



SAMPLE INFORI	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		PCA0117515		
Sample Date		Client Info		13 Apr 2024		
Machine Age	hrs	Client Info		4423		
Oil Age	hrs	Client Info		4423		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
CONTAMINAT	ION	method	limit/base	current	history1	history2
Water		WC Method	>0.6	NEG		
WEAR METAL	S	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>70	<1		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m		<1		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>3	2		
Lead	ppm	ASTM D5185m	>4	0		
Copper	ppm	ASTM D5185m	>20	<1		
Tin	ppm	ASTM D5185m	>3	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		121		
Zinc	ppm	ASTM D5185m		4		
Sulfur	ppm	ASTM D5185m		0		
CONTAMINAN	TS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>45	2		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm		>20	1		
FLUID CLEANI	INESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>1300	535		
Particles >6µm		ASTM D7647	>320	118		
Particles >14µm		ASTM D7647	>80	16		
Particles >21µm		ASTM D7647	>20	6		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>17/15/13	16/14/11		
FLUID DEGRA	DATION	method	limit/base	current	history1	history2
Acid Number (AN)	ma K∩⊔/a	ASTM D8045	0.10	0 55		

Acid Number (AN)


mg KOH/g ASTM D8045 0.10


Report Id: KRASPRMO [WUSCAR] 06157659 (Generated: 04/25/2024 20:00:52) Rev: 1


0.55 Contact/Location: Service Manager - KRASPRMO



OIL ANALYSIS REPORT





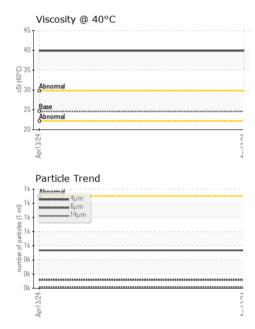

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
				-		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.6	NEG		
Free Water	scalar	*Visual		NEG		
FLUID PROPE	RTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	24.6	39.9		
SAMPLE IMAG	iES	method	limit/base	current	history1	history2
Color				13-74 N	no image	no image
Bottom					no image	no image
GRAPHS						
Ferrous Alloys				Particle Count	t	
a iron a chromium 5 - iron chromium 4 -			491,52 122,88 30,72 7,68	0 - Severe		26 -24 -22
Apr13/24			(/24	0 Abnormal		-20 -18 -16 -14
Non-ferrous Metals	S		48 salpitud			-16
copper			jo jaj 12			-14
nanananan lead						
			3	0-		-12
2				8		10
L			_		/	
Apr13/24			Apr13/24	2-		-8
Apr			Apri	0.		6
Viscosity @ 40°C				4μ 6μ	14µ 21µ	38µ 71µ
iT:			<u>,</u> ,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,			
)-			(b)HOX bull 1.5 ummy pipe V 0.5	Severe		
Abnormal			Ë 1.5	0 - Abnormal		
Abnormal			ag 1.0	0		
Base Abnormal			N 0.5	0 Base		
				0 1	*****	~
Apr13/24			Apr13/24	Apr13/24		ACC Lunk
Ap			Ap	Ap		-
VearCheck USA - 501 CA0117515 6157659 0993082 ND 2 (Additional Tes	Recei Teste Diagr	ved : 23 d : 24 losed : 25	r, NC 27513 3 Apr 2024 4 Apr 2024 Apr 2024 - Ang		SPR	Plant 8311 PC 35 E BENNET INGFIELD, MO US 6580 ervice Manage

- To discuss this sample report, contact Customer Service at 1-800-237-1369.
- * Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

Υ.

Laboratory

Sample No. Lab Number Unique Number Test Package

Contact/Location: Service Manager - KRASPRMO

T:

F: