


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

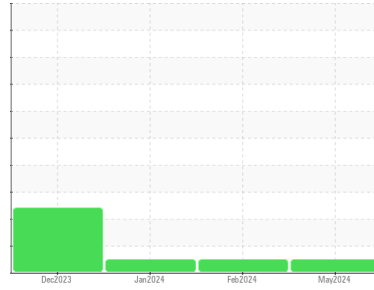

Machine Id

14
Component
Compressor
Fluid

PETRO CANADA SENTRON ASHLESS 40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		PCA0112042	PCA0117181	PCA0111966
Sample Date	Client Info		02 May 2024	01 Feb 2024	02 Jan 2024
Machine Age	hrs	Client Info	144045	141893	141174
Oil Age	hrs	Client Info	353	1733	1014
Oil Changed	Client Info		Changed	Not Changd	Not Changd
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	8	<1	3
Chromium	ppm	ASTM D5185m >10	<1	0	0
Nickel	ppm	ASTM D5185m	<1	<1	0
Titanium	ppm	ASTM D5185m	<1	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >25	<1	<1	2
Lead	ppm	ASTM D5185m >25	1	<1	0
Copper	ppm	ASTM D5185m >50	2	2	3
Tin	ppm	ASTM D5185m >15	5	2	2
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 106	92	0	<1
Barium	ppm	ASTM D5185m <1	0	0	0
Molybdenum	ppm	ASTM D5185m <1	3	0	0
Manganese	ppm	ASTM D5185m <1	<1	0	0
Magnesium	ppm	ASTM D5185m <1	4	2	<1
Calcium	ppm	ASTM D5185m	61	11	14
Phosphorus	ppm	ASTM D5185m 657	617	651	657
Zinc	ppm	ASTM D5185m	64	371	354
Sulfur	ppm	ASTM D5185m 255	332	1813	1864





CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	4	<1	<1
Sodium	ppm	ASTM D5185m	0	2	0
Potassium	ppm	ASTM D5185m >20	2	4	2
Fuel	%	ASTM D3524	---	---	0.0

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.7	0.63	0.94	0.90
Base Number (BN)	mg KOH/g	ASTM D2896 1.6	---	---	0.94

OIL ANALYSIS REPORT

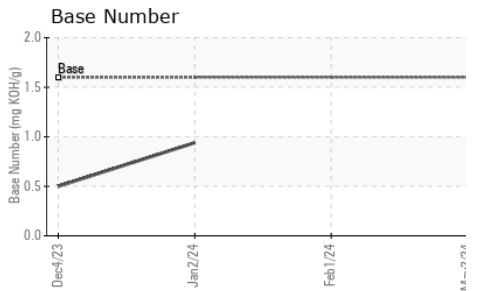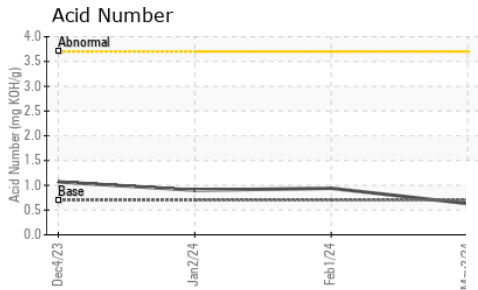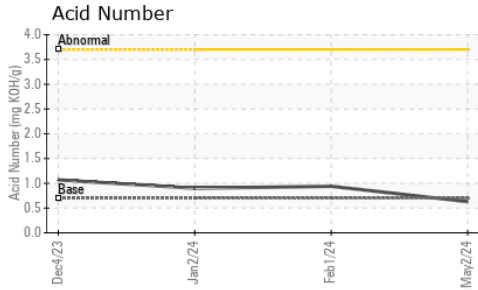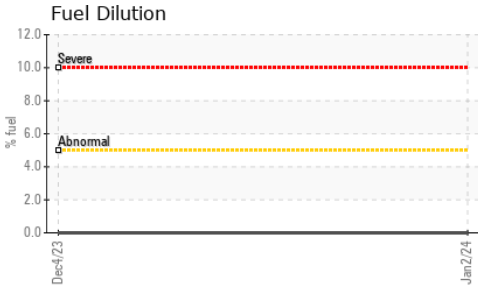








VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	125.0	118	76.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



GRAPHS

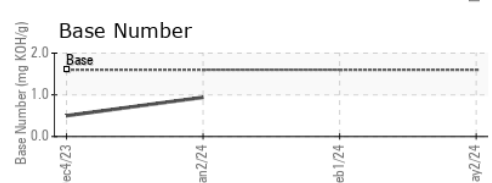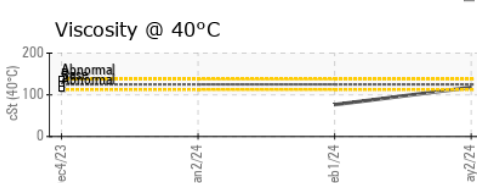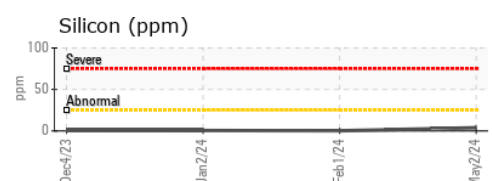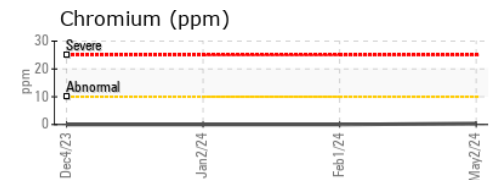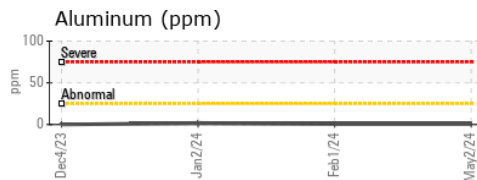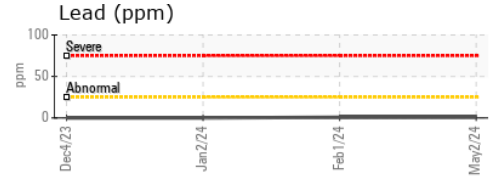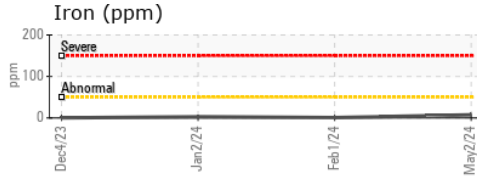

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0112042 **Received** : 09 May 2024
Lab Number : 06174020 **Tested** : 12 May 2024
Unique Number : 11020073 **Diagnosed** : 12 May 2024 - Don Baldrige
Test Package : MOB 2 (Additional Tests: FuelDilution, TBN)

ENERVEST OPERATING - HAYSI A
 1242 WEST WIND ROAD
 HAYSI, VA
 US 24256
 Contact: CHARLES GREGORY
 cgregory@usacompression.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: