


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

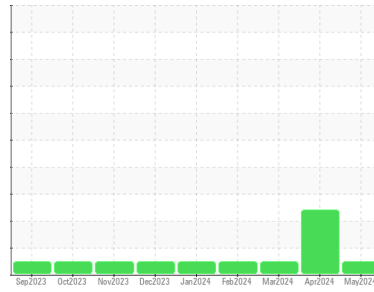

Machine Id

48

Component

Natural Gas Engine

Fluid

PETRO CANADA SENTRON LD 3000 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Wear

All component wear rates are normal.

Contamination

Tests indicate that there is no fuel present in the oil. There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		PCA0112037	PCA0117152	PCA0117182
Sample Date	Client Info		01 May 2024	01 Apr 2024	04 Mar 2024
Machine Age	hrs	Client Info	99126	98414	97749
Oil Age	hrs	Client Info	327	5407	4742
Oil Changed	Client Info		Changed	Not Changd	Not Changd
Sample Status			NORMAL	ABNORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	2	9	3
Chromium	ppm	ASTM D5185m >4	<1	1	0
Nickel	ppm	ASTM D5185m >2	<1	<1	0
Titanium	ppm	ASTM D5185m	<1	<1	0
Silver	ppm	ASTM D5185m >3	0	0	0
Aluminum	ppm	ASTM D5185m >9	<1	1	2
Lead	ppm	ASTM D5185m >30	1	3	<1
Copper	ppm	ASTM D5185m >35	3	2	<1
Tin	ppm	ASTM D5185m >4	<1	1	<1
Vanadium	ppm	ASTM D5185m	<1	<1	0
Cadmium	ppm	ASTM D5185m	<1	<1	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5	0	0	0
Barium	ppm	ASTM D5185m 1	0	0	0
Molybdenum	ppm	ASTM D5185m 2	2	6	<1
Manganese	ppm	ASTM D5185m 1	<1	1	<1
Magnesium	ppm	ASTM D5185m 5	8	9	10
Calcium	ppm	ASTM D5185m 1220	1257	1383	1410
Phosphorus	ppm	ASTM D5185m 298	291	315	303
Zinc	ppm	ASTM D5185m 350	343	359	394
Sulfur	ppm	ASTM D5185m 1995	2744	2521	2405

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >+100	2	4	2
Sodium	ppm	ASTM D5185m	0	7	2
Potassium	ppm	ASTM D5185m >20	6	37	1
Fuel	%	ASTM D3524 >4.0	0.0	0.2	0.2

INFRA-RED


	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0	0	0
Nitration	Abs/cm	*ASTM D7624 >20	4.0	9.4	5.0
Sulfation	Abs/.1mm	*ASTM D7415 >30	13.7	19.5	16.9

FLUID DEGRADATION


	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	7.8	15.7	10.1
Acid Number (AN)	mg KOH/g	ASTM D8045 0.86	0.19	▲ 2.07	1.70
Base Number (BN)	mg KOH/g	ASTM D2896 3.9	3.89	▲ 1.91	1.98

OIL ANALYSIS REPORT


Fuel Dilution

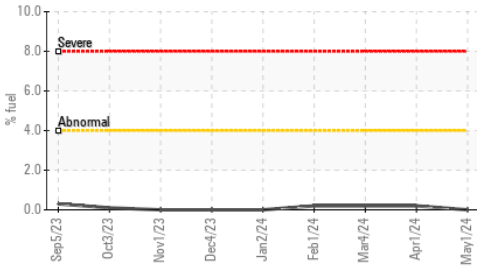


FT-IR (Direct Trend)

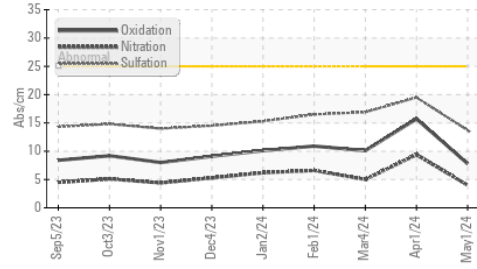


Acid Number

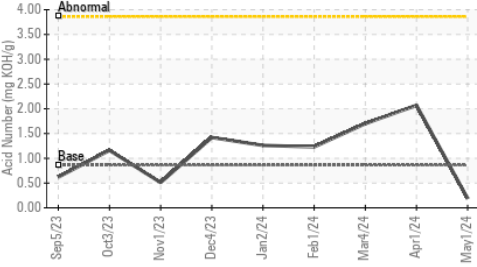

Base Number

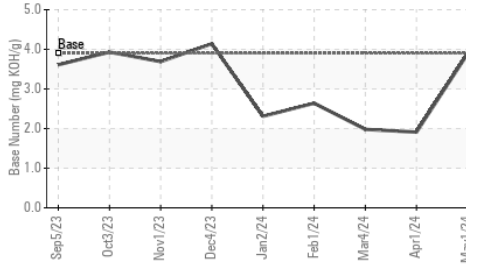

Viscosity @ 100°C

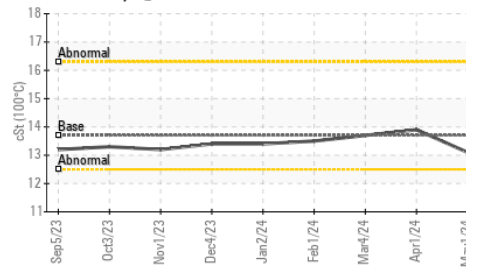

VISUAL


method	limit/base	current	history1	history2
White Metal	*Visual	NONE	NONE	NONE
Yellow Metal	*Visual	NONE	NONE	NONE
Precipitate	*Visual	NONE	NONE	NONE
Silt	*Visual	NONE	NONE	NONE
Debris	*Visual	NONE	NONE	NONE
Sand/Dirt	*Visual	NONE	NONE	NONE
Appearance	*Visual	NORML	NORML	NORML
Odor	*Visual	NORML	NORML	NORML
Emulsified Water	*Visual	>0.1	NEG	NEG
Free Water	*Visual	NEG	NEG	NEG

FLUID PROPERTIES


method	limit/base	current	history1	history2
Visc @ 100°C	cSt ASTM D445	13.7	13.9	13.7

GRAPHS


Iron (ppm)

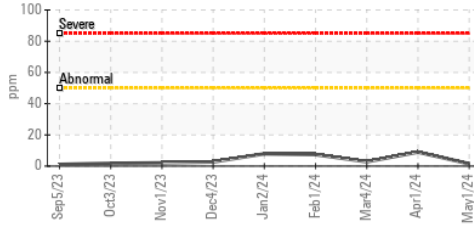


Lead (ppm)

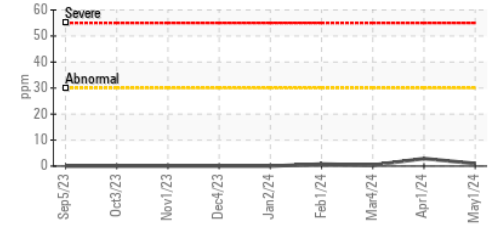


Aluminum (ppm)

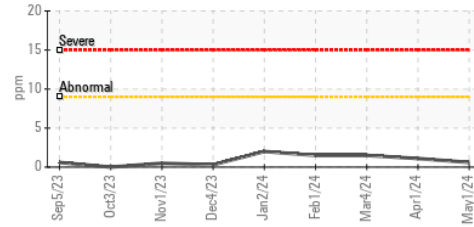


Chromium (ppm)

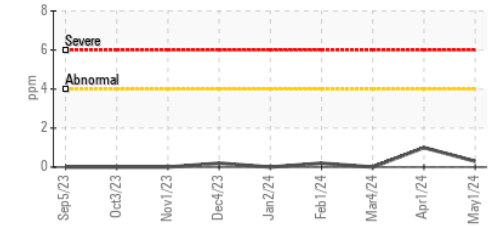


Copper (ppm)

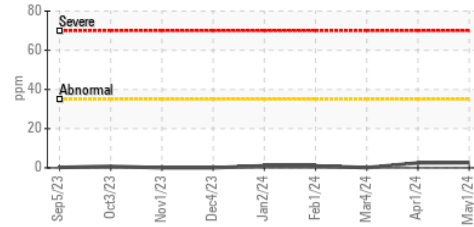


Silicon (ppm)

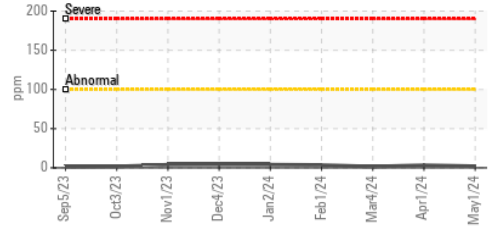

Viscosity @ 100°C

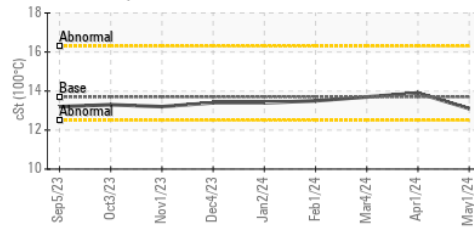

Base Number

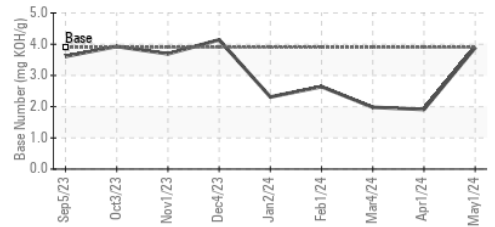

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : PCA0112037

Lab Number : 06174054

Unique Number : 11020107

Test Package : MOB 2 (Additional Tests : FuelDilution, PercentFuel)

Received : 09 May 2024

Tested : 15 May 2024

Diagnosed : 15 May 2024 - Wes Davis

ENERVEST OPERATING - POPLAR GAP A

1618 CRESCENT ROAD

GRUNDY, VA

US 24614

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: