


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

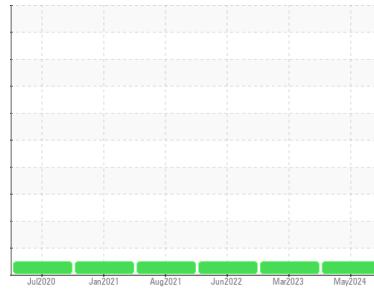

Area
SCOF [98996107]
 Machine Id
6410/6420 NORTH
 Component
Gearbox
 Fluid
GEAR OIL ISO 460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			PCA0120257	PCA0088297	PCA0067375
Sample Date	Client Info			01 May 2024	29 Mar 2023	17 Jun 2022
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			Filtered	Filtered	Filtered
Sample Status				NORMAL	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.2	NEG	NEG	NEG





WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	5	6	8
Chromium	ppm	ASTM D5185m	>15	<1	0	0
Nickel	ppm	ASTM D5185m	>15	0	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	3	1	7
Lead	ppm	ASTM D5185m	>100	0	0	<1
Copper	ppm	ASTM D5185m	>200	<1	0	0
Tin	ppm	ASTM D5185m	>25	<1	0	0
Antimony	ppm	ASTM D5185m	>5	---	---	---
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	50	0	0	0
Barium	ppm	ASTM D5185m	15	0	0	2
Molybdenum	ppm	ASTM D5185m	15	0	<1	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	50	<1	<1	0
Calcium	ppm	ASTM D5185m	50	3	3	4
Phosphorus	ppm	ASTM D5185m	350	377	304	336
Zinc	ppm	ASTM D5185m	100	7	10	13
Sulfur	ppm	ASTM D5185m	12500	411	393	372

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<1	<1	1
Sodium	ppm	ASTM D5185m		0	1	0
Potassium	ppm	ASTM D5185m	>20	2	<1	1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>1300	452	527	495
Particles >6µm		ASTM D7647	>320	84	157	65
Particles >14µm		ASTM D7647	>80	19	24	10
Particles >21µm		ASTM D7647	>20	6	4	4
Particles >38µm		ASTM D7647	>4	1	0	1
Particles >71µm		ASTM D7647	>3	0	0	1
Oil Cleanliness		ISO 4406 (c)	>17/15/13	16/14/11	16/14/12	16/13/10

OIL ANALYSIS REPORT

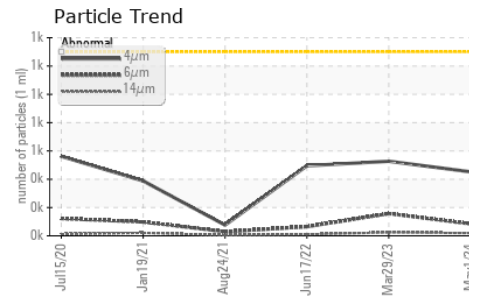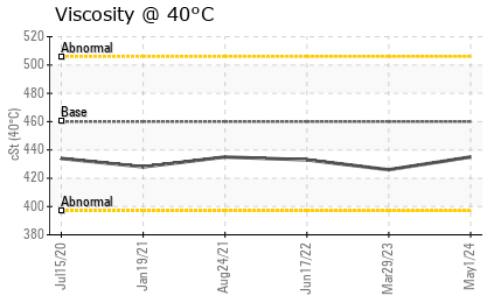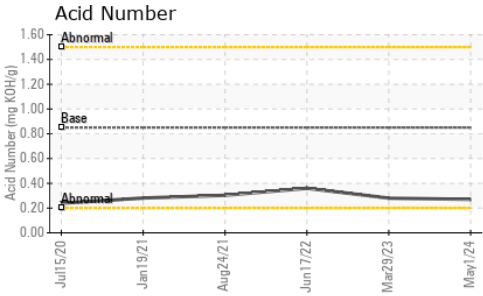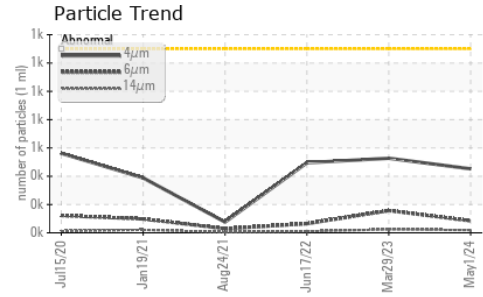


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	0.27	0.28	0.36






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	460	435	426	433

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

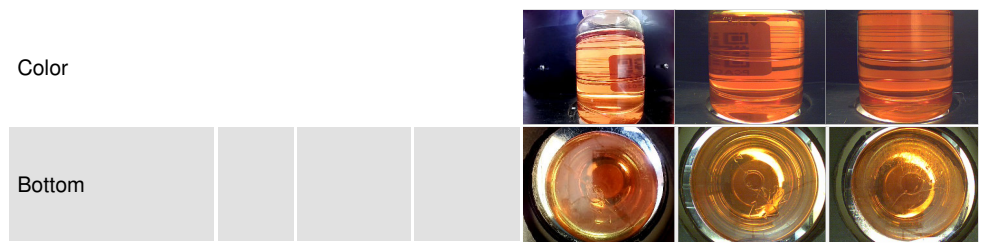

GRAPHS

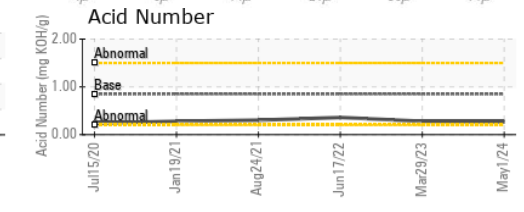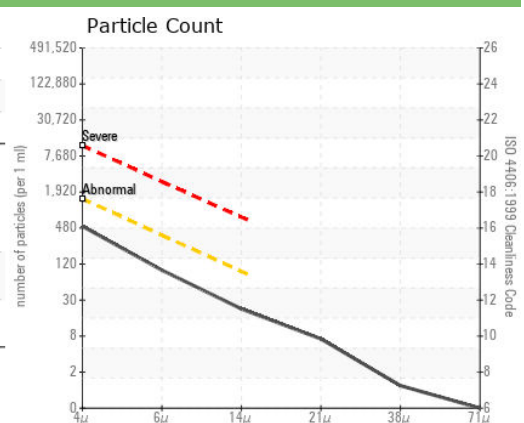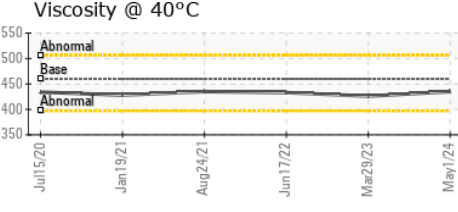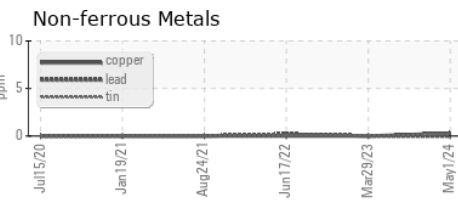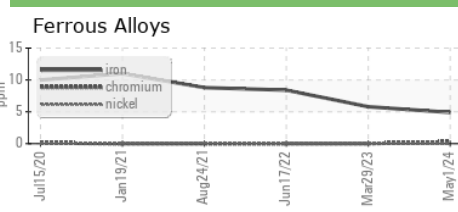

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0120257
Lab Number : 06175428
Unique Number : 11021481
Test Package : IND 2 (Additional Tests: PrtCount)

Received : 10 May 2024
Tested : 13 May 2024
Diagnosed : 14 May 2024 - Don Baldrige

KraftHeinz - Springfield - Plant 8311 PCA
 2035 E BENNETT
 SPRINGFIELD, MO
 US 65804
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)