


# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**

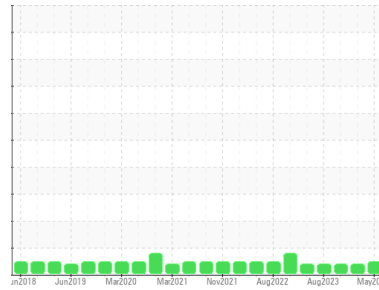

Machine Id  
**L-8 62 DISTRIBUTION**

Component  
**Gearbox**

Fluid  
**PETRO CANADA ENDURATEX EP 460 (6 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>PCA0091847</b>	PCA0116738	PCA0091849
Sample Date	Client Info	<b>22 May 2024</b>	13 Feb 2024	26 Nov 2023
Machine Age	hrs	Client Info	<b>0</b>	0
Oil Age	hrs	Client Info	<b>0</b>	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	ABNORMAL	ABNORMAL

## CONTAMINATION

method	limit/base	current	history1	history2	
Water	WC Method	>0.2	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>200	<b>57</b>	54	44
Chromium	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>3</b>	3	1
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	<1
Lead	ppm	ASTM D5185m	>100	<b>&lt;1</b>	0	<1
Copper	ppm	ASTM D5185m	>200	<b>4</b>	<1	1
Tin	ppm	ASTM D5185m	>25	<b>1</b>	1	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	<1

## ADDITIVES

method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m	55	<b>21</b>	25	21
Barium	ppm	ASTM D5185m	0	<b>0</b>	0	<1
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m	0	<b>1</b>	<1	1
Magnesium	ppm	ASTM D5185m	2	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	6	<b>4</b>	6	3
Phosphorus	ppm	ASTM D5185m	240	<b>392</b>	403	389
Zinc	ppm	ASTM D5185m	3	<b>7</b>	13	6
Sulfur	ppm	ASTM D5185m	10310	<b>6759</b>	5955	6502



## CONTAMINANTS

method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>50	<b>3</b>	3	6
Sodium	ppm	ASTM D5185m		<b>1</b>	<1	0
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	0	1

## FLUID DEGRADATION

method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D8045	0.5	<b>0.89</b>	0.82	0.81


# OIL ANALYSIS REPORT

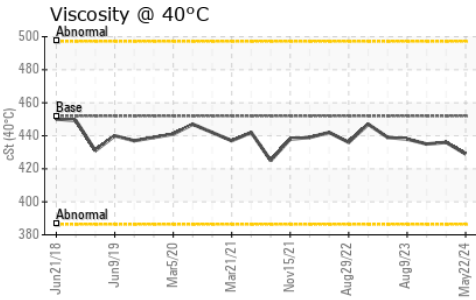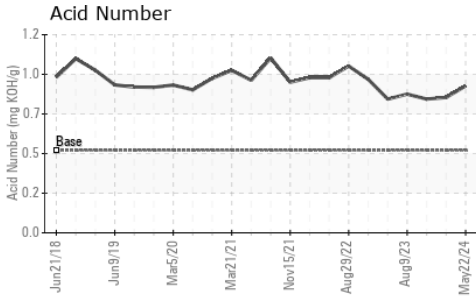





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	▲ MODER	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	452	<b>429</b>	436	435

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

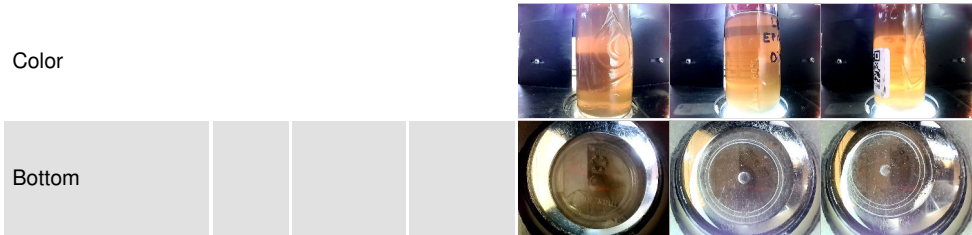

## GRAPHS

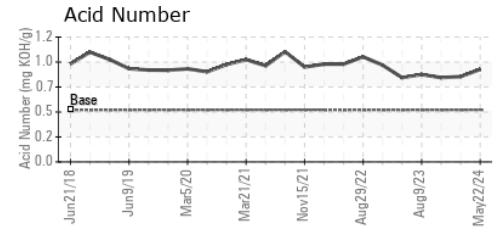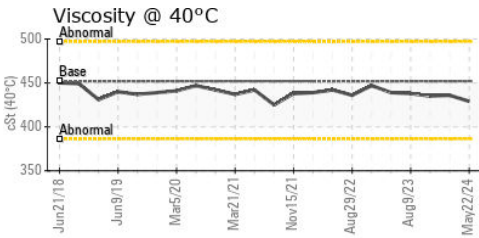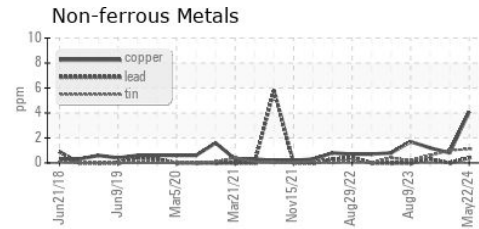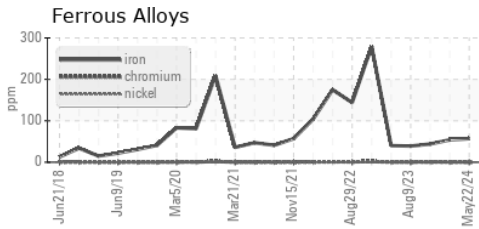

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0091847  
**Lab Number** : **06189438**  
**Unique Number** : 11046190  
**Test Package** : PLANT

**Received** : 23 May 2024  
**Tested** : 28 May 2024  
**Diagnosed** : 28 May 2024 - Wes Davis

**CERTAINTED VINYL PLANT**  
 2651 PENNY RD  
 CLAREMONT, NC  
 US 28613  
 Contact: BRUCE JAMES  
 bruce.a.james@saint-gobain.com  
 T: (828)459-3320  
 F: (828)459-3329

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)