


OIL ANALYSIS REPORT

Area
MIX ROOM C [98982994]
 Machine Id
KR-GR-003111 - WEST DUMPER (S/N MIX C - 11513059)
 Component
Hydraulic System
 Fluid
AW HYDRAULIC OIL ISO 68 (--- GAL)

Sample Rating Trend

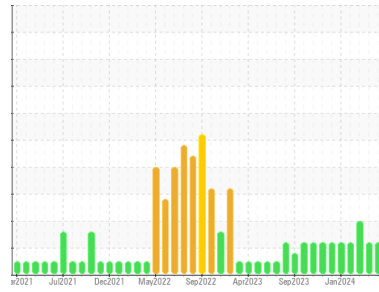

DIAGNOSIS

Recommendation
 We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			PCA0122284	PCA0114148	PCA0120387
Sample Date	Client Info			24 May 2024	17 Apr 2024	20 Mar 2024
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	Not Chngd	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.05	NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	5	5	3
Chromium	ppm	ASTM D5185m	>20	2	1	1
Nickel	ppm	ASTM D5185m	>20	<1	0	<1
Titanium	ppm	ASTM D5185m		<1	0	<1
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>20	2	<1	3
Lead	ppm	ASTM D5185m	>20	<1	0	<1
Copper	ppm	ASTM D5185m	>20	<1	0	<1
Tin	ppm	ASTM D5185m	>20	<1	0	<1
Vanadium	ppm	ASTM D5185m		0	<1	<1
Cadmium	ppm	ASTM D5185m		0	0	<1





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	0	0	0
Barium	ppm	ASTM D5185m	5	<1	0	<1
Molybdenum	ppm	ASTM D5185m	5	<1	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	25	<1	0	<1
Calcium	ppm	ASTM D5185m	200	2	2	3
Phosphorus	ppm	ASTM D5185m	300	428	375	428
Zinc	ppm	ASTM D5185m	370	2	0	2
Sulfur	ppm	ASTM D5185m	2500	472	548	455

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	2	<1	2
Sodium	ppm	ASTM D5185m		<1	<1	0
Potassium	ppm	ASTM D5185m	>20	2	<1	2

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 209982	▲ 120486	▲ 149101	
Particles >6µm	ASTM D7647	>2500	▲ 31629	▲ 33788	▲ 30842	
Particles >14µm	ASTM D7647	>640	216	205	▲ 1331	
Particles >21µm	ASTM D7647	>160	24	10	▲ 355	
Particles >38µm	ASTM D7647	>40	0	0	17	
Particles >71µm	ASTM D7647	>10	0	0	1	
Oil Cleanliness	ISO 4406 (c)	>20/18/16	▲ 25/22/15	▲ 24/22/15	▲ 24/22/18	

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.57	0.13	0.11	0.14


OIL ANALYSIS REPORT

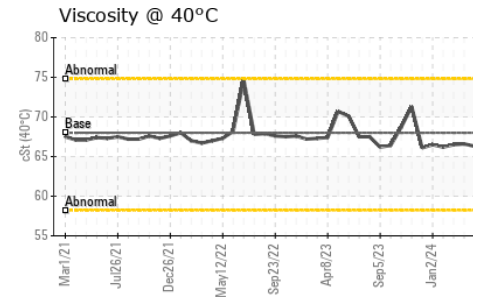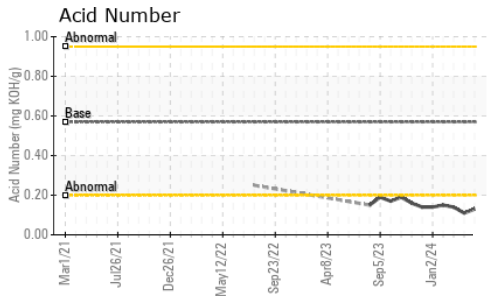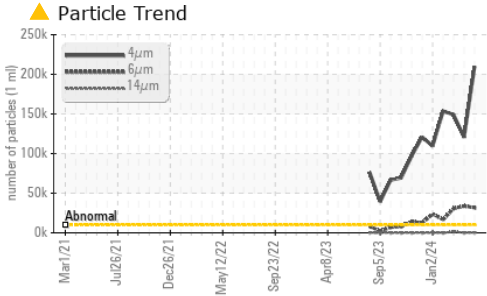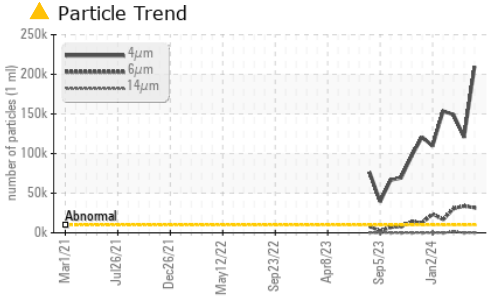






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 68	66.3	66.6	66.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

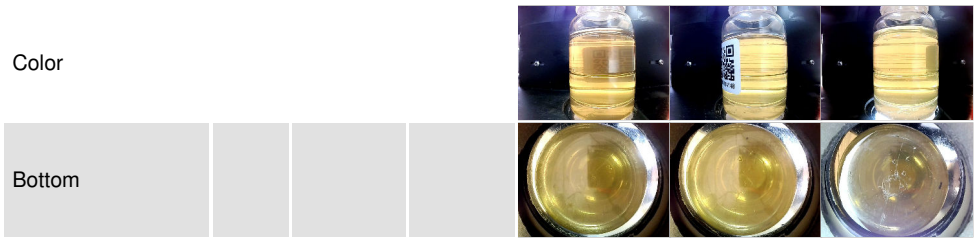

GRAPHS

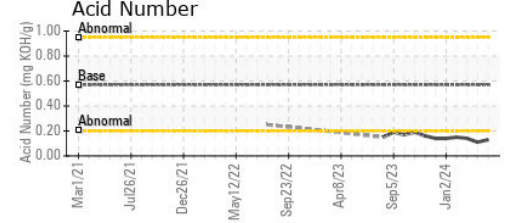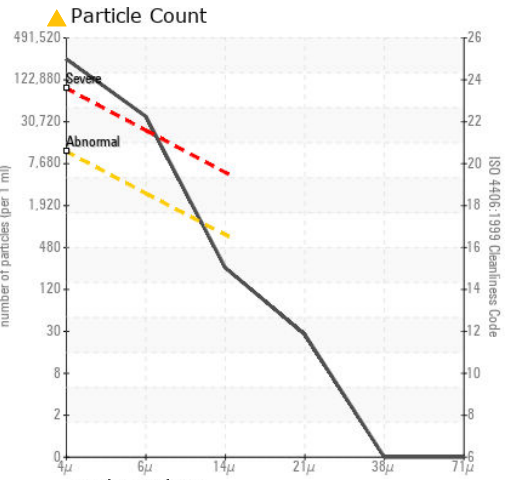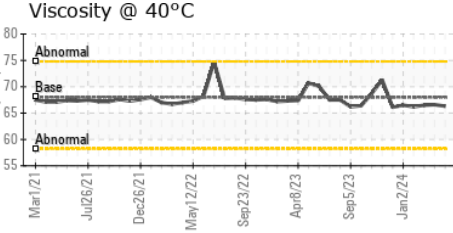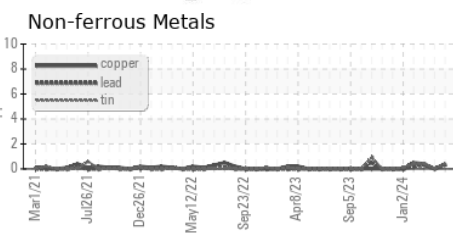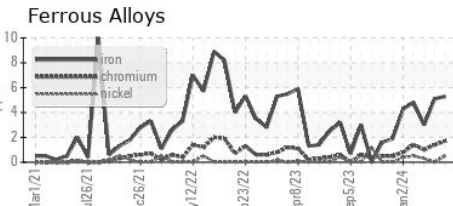

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0122284
Lab Number : 06195384
Unique Number : 11057507
Test Package : IND 2

Received : 30 May 2024
Tested : 31 May 2024
Diagnosed : 31 May 2024 - Angela Borella

KraftHeinz - Kirksville - Plant 8333 PCA
 2504 INDUSTRIAL DR
 KIRKSVILLE, MO
 US 63501
 Contact: WALLACE WARD
 wallace.ward@kraftheinzcompany.com
 T: (660)627-1031
 F: (660)627-5887

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)