


# OIL ANALYSIS REPORT

Sample Rating Trend



ISO

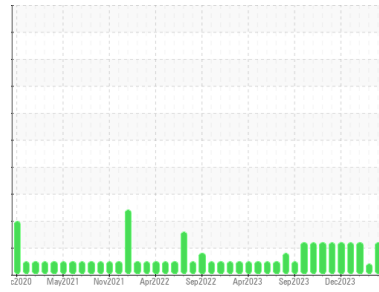

Area

**GRIND ROOM [98996311]**

Machine Id

**KR-GR-003070 - DUMPER 1A - NORTH (S/N GRIND A - 11513011)**

Component

**Hydraulic System**

Fluid

**AW HYDRAULIC OIL ISO 68 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PCA0122292</b>	PCA0055976	PCA0116080
Sample Date	Client Info		<b>24 May 2024</b>	16 Apr 2024	14 Mar 2024
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	Not Chngd	N/A
Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.05	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	2
Chromium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	<1
Nickel	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m	<b>0</b>	<1	<1
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >20	<b>1</b>	0	3
Lead	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	2
Tin	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	<1

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 5	<b>0</b>	0	<1
Molybdenum	ppm	ASTM D5185m 5	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m 25	<b>&lt;1</b>	<1	<1
Calcium	ppm	ASTM D5185m 200	<b>2</b>	2	5
Phosphorus	ppm	ASTM D5185m 300	<b>398</b>	377	296
Zinc	ppm	ASTM D5185m 370	<b>4</b>	4	6
Sulfur	ppm	ASTM D5185m 2500	<b>459</b>	589	487

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>3</b>	2	2
Sodium	ppm	ASTM D5185m	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	1

## FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>▲ 24081</b>	---	▲ 107817
Particles >6µm	ASTM D7647	>2500	<b>● 2660</b>	---	▲ 10176
Particles >14µm	ASTM D7647	>640	<b>138</b>	---	106
Particles >21µm	ASTM D7647	>160	<b>27</b>	---	24
Particles >38µm	ASTM D7647	>40	<b>1</b>	---	2
Particles >71µm	ASTM D7647	>10	<b>0</b>	---	0
Oil Cleanliness	ISO 4406 (c)	>20/18/16	<b>▲ 22/19/14</b>	---	▲ 24/21/14

## FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.57	<b>0.25</b>	0.28	0.38

# OIL ANALYSIS REPORT


### ▲ Particle Trend

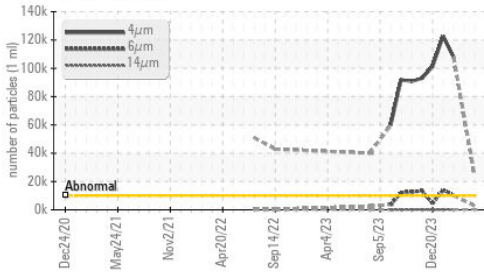


### ▲ Particle Trend

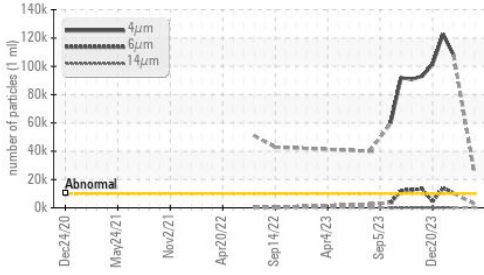

### Acid Number

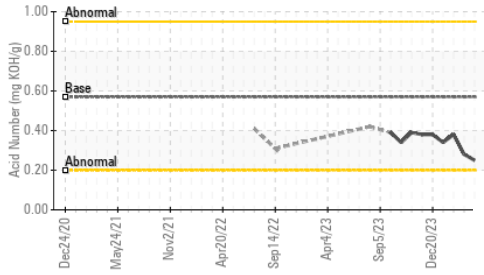


### Viscosity @ 40°C

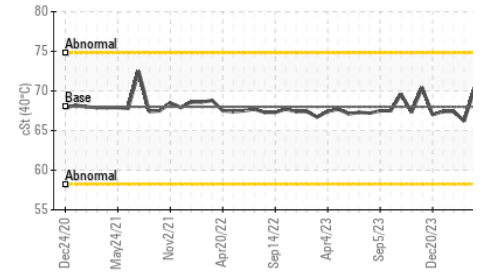

PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	<b>LIGHT</b>	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	68	<b>70.3</b>	66.2	67.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

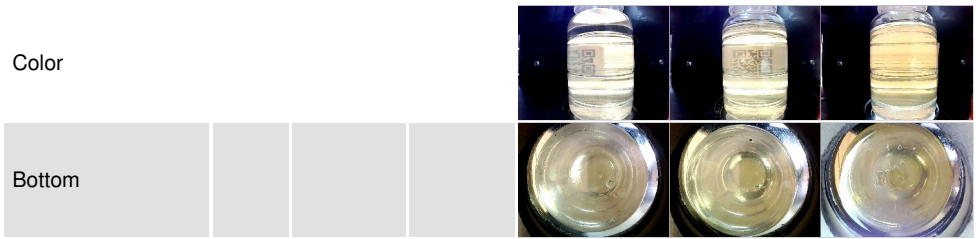


## GRAPHS


### Ferrous Alloys

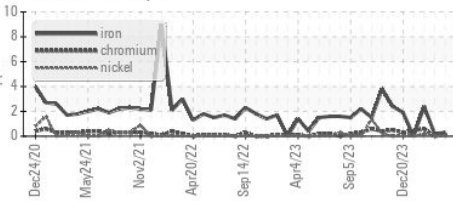


### Non-ferrous Metals

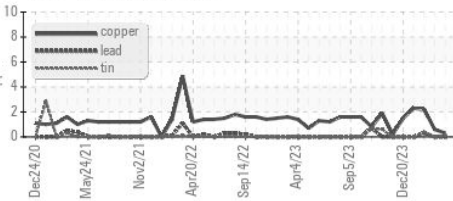


### Viscosity @ 40°C

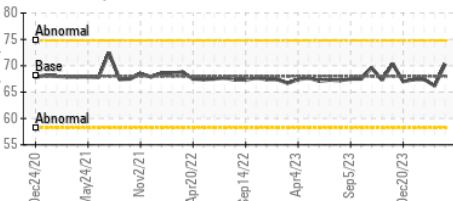

### ▲ Particle Count

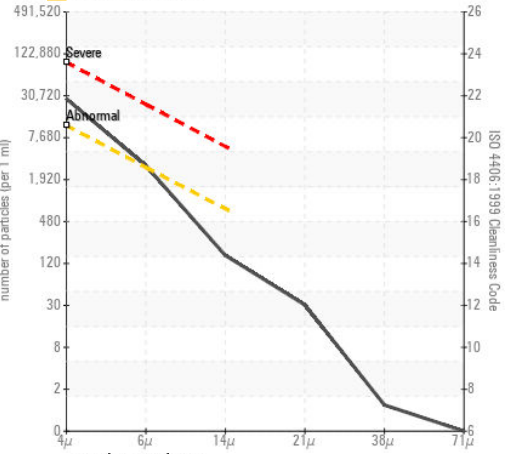

### Acid Number

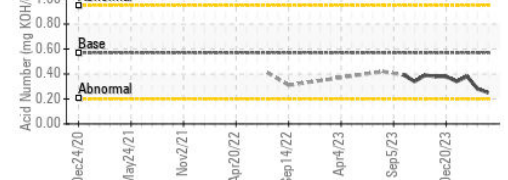

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0122292  
**Lab Number** : 06195402  
**Unique Number** : 11057525  
**Test Package** : IND 2

**Received** : 30 May 2024  
**Tested** : 05 Jun 2024  
**Diagnosed** : 05 Jun 2024 - Jonathan Hester

**KraftHeinz - Kirksville - Plant 8333 PCA**  
 2504 INDUSTRIAL DR  
 KIRKSVILLE, MO  
 US 63501  
 Contact: WALLACE WARD  
 wallace.ward@kraftheinzcompany.com  
 T: (660)627-1031  
 F: (660)627-5887

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)