


# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**

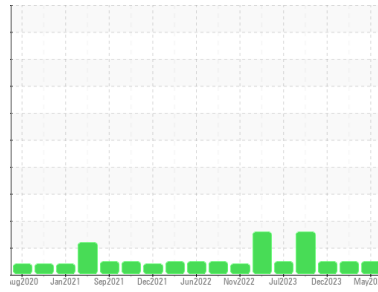

Area  
**LEGACY [98983452]**  
 Machine Id  
**KR-GR-006003 - HYDRAULIC A/B (S/N OLD POWER HOUSE)**  
 Component  
**Hydraulic System**  
 Fluid  
**PETRO CANADA PURITY FG HYDRAULIC AW 68 (30 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION |             | method      | limit/base | current            | history1    | history2    |
|--------------------|-------------|-------------|------------|--------------------|-------------|-------------|
| Sample Number      | Client Info |             |            | <b>PCA0124757</b>  | PCA0116658  | PCA0114827  |
| Sample Date        | Client Info |             |            | <b>24 May 2024</b> | 14 Mar 2024 | 20 Dec 2023 |
| Machine Age        | hrs         | Client Info |            | <b>0</b>           | 0           | 0           |
| Oil Age            | hrs         | Client Info |            | <b>0</b>           | 0           | 0           |
| Oil Changed        | Client Info |             |            | <b>N/A</b>         | N/A         | Not Changd  |
| Sample Status      |             |             |            | <b>NORMAL</b>      | NORMAL      | NORMAL      |

| CONTAMINATION |           | method | limit/base | current    | history1 | history2 |
|---------------|-----------|--------|------------|------------|----------|----------|
| Water         | WC Method |        | >0.05      | <b>NEG</b> | NEG      | NEG      |

| WEAR METALS |     | method      | limit/base | current      | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| Iron        | ppm | ASTM D5185m | >20        | <b>&lt;1</b> | 0        | 0        |
| Chromium    | ppm | ASTM D5185m | >20        | <b>&lt;1</b> | <1       | 0        |
| Nickel      | ppm | ASTM D5185m | >20        | <b>0</b>     | 0        | 0        |
| Titanium    | ppm | ASTM D5185m |            | <b>&lt;1</b> | <1       | <1       |
| Silver      | ppm | ASTM D5185m |            | <b>0</b>     | 0        | 0        |
| Aluminum    | ppm | ASTM D5185m | >20        | <b>2</b>     | 3        | 0        |
| Lead        | ppm | ASTM D5185m | >20        | <b>&lt;1</b> | <1       | 0        |
| Copper      | ppm | ASTM D5185m | >20        | <b>1</b>     | 1        | 1        |
| Tin         | ppm | ASTM D5185m | >20        | <b>&lt;1</b> | <1       | 0        |
| Vanadium    | ppm | ASTM D5185m |            | <b>0</b>     | <1       | 0        |
| Cadmium     | ppm | ASTM D5185m |            | <b>&lt;1</b> | <1       | 0        |





| ADDITIVES  |     | method      | limit/base | current      | history1 | history2 |
|------------|-----|-------------|------------|--------------|----------|----------|
| Boron      | ppm | ASTM D5185m |            | <b>0</b>     | 0        | 0        |
| Barium     | ppm | ASTM D5185m |            | <b>2</b>     | <1       | 0        |
| Molybdenum | ppm | ASTM D5185m |            | <b>&lt;1</b> | 0        | 0        |
| Manganese  | ppm | ASTM D5185m |            | <b>0</b>     | 0        | 0        |
| Magnesium  | ppm | ASTM D5185m |            | <b>2</b>     | 0        | 0        |
| Calcium    | ppm | ASTM D5185m |            | <b>2</b>     | 3        | 0        |
| Phosphorus | ppm | ASTM D5185m |            | <b>385</b>   | 401      | 377      |
| Zinc       | ppm | ASTM D5185m |            | <b>14</b>    | 8        | <1       |
| Sulfur     | ppm | ASTM D5185m |            | <b>358</b>   | 337      | 383      |

| CONTAMINANTS |     | method      | limit/base | current  | history1 | history2 |
|--------------|-----|-------------|------------|----------|----------|----------|
| Silicon      | ppm | ASTM D5185m | >15        | <b>9</b> | 13       | 13       |
| Sodium       | ppm | ASTM D5185m |            | <b>0</b> | 0        | 1        |
| Potassium    | ppm | ASTM D5185m | >20        | <b>1</b> | <1       | 2        |

| FLUID CLEANLINESS |  | method       | limit/base | current         | history1 | history2 |
|-------------------|--|--------------|------------|-----------------|----------|----------|
| Particles >4µm    |  | ASTM D7647   | >10000     | <b>3716</b>     | 1191     | ---      |
| Particles >6µm    |  | ASTM D7647   | >2500      | <b>941</b>      | 456      | ---      |
| Particles >14µm   |  | ASTM D7647   | >640       | <b>72</b>       | 62       | ---      |
| Particles >21µm   |  | ASTM D7647   | >160       | <b>17</b>       | 20       | ---      |
| Particles >38µm   |  | ASTM D7647   | >40        | <b>2</b>        | 2        | ---      |
| Particles >71µm   |  | ASTM D7647   | >10        | <b>0</b>        | 0        | ---      |
| Oil Cleanliness   |  | ISO 4406 (c) | >20/18/16  | <b>19/17/13</b> | 17/16/13 | ---      |

| FLUID DEGRADATION |          | method     | limit/base | current     | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN)  | mg KOH/g | ASTM D8045 | 0.26       | <b>0.36</b> | 0.41     | ---      |


# OIL ANALYSIS REPORT

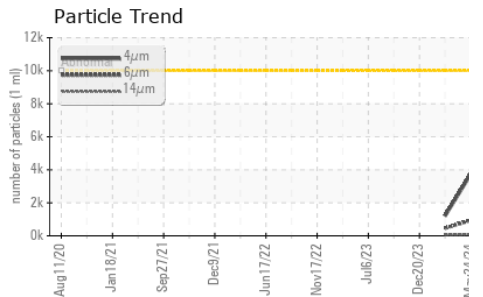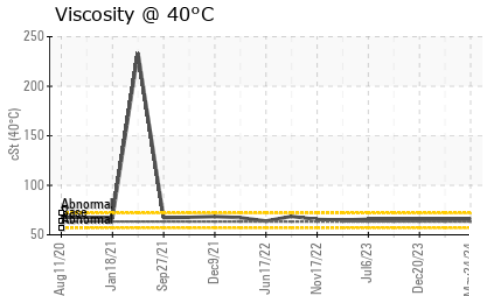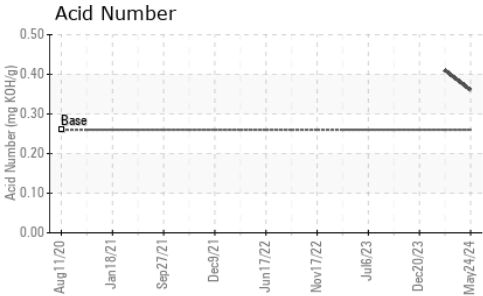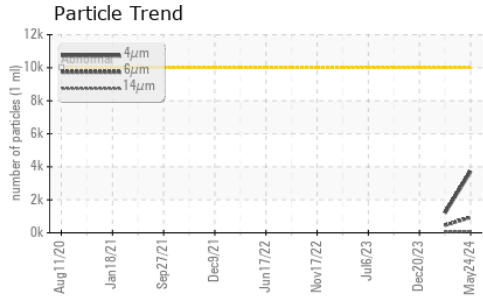






| VISUAL           | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Yellow Metal     | scalar | *Visual    | NONE    | NONE     | NONE     |
| Precipitate      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Silt             | scalar | *Visual    | NONE    | NONE     | NONE     |
| Debris           | scalar | *Visual    | NONE    | NONE     | NONE     |
| Sand/Dirt        | scalar | *Visual    | NONE    | NONE     | NONE     |
| Appearance       | scalar | *Visual    | NORML   | NORML    | NORML    |
| Odor             | scalar | *Visual    | NORML   | NORML    | NORML    |
| Emulsified Water | scalar | *Visual    | >0.05   | NEG      | NEG      |
| Free Water       | scalar | *Visual    |         | NEG      | NEG      |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C      | cSt    | ASTM D445  | 63.34   | 65.7     | 65.5     |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

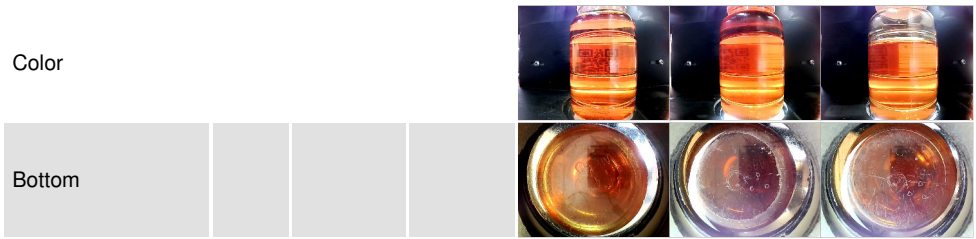

## GRAPHS

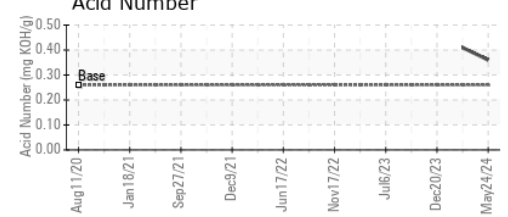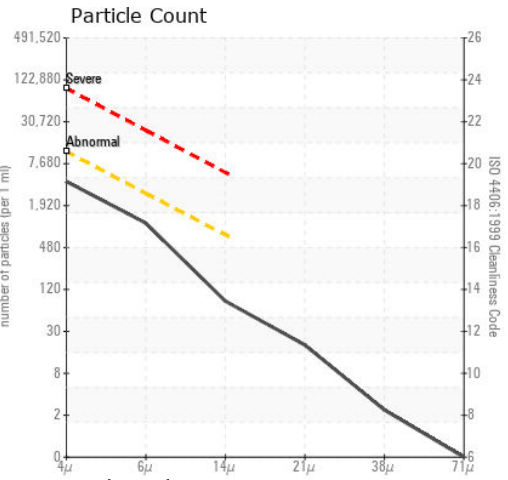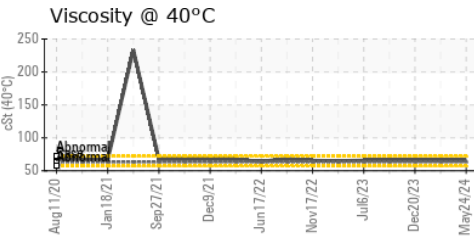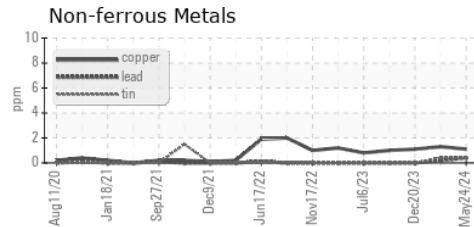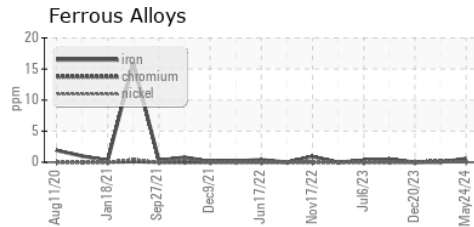

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0124757  
**Lab Number** : 06195403  
**Unique Number** : 11057526  
**Test Package** : IND 2

**Received** : 30 May 2024  
**Tested** : 31 May 2024  
**Diagnosed** : 31 May 2024 - Angela Borella

**KraftHeinz - Kirksville - Plant 8333 PCA**  
 2504 INDUSTRIAL DR  
 KIRKSVILLE, MO  
 US 63501  
 Contact: WALLACE WARD  
 wallace.ward@kraftheinzcompany.com  
 T: (660)627-1031  
 F: (660)627-5887

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)