


# OIL ANALYSIS REPORT

Sample Rating Trend



## VISCOSITY

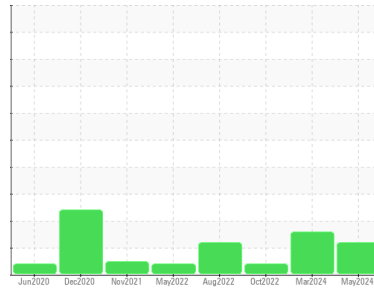

Area  
**STUFF ROOM D [98993943]**  
 Machine Id  
**KR-GF-000031 (S/N STUFF D - 11513137)**  
 Component  
**Pump**  
 Fluid  
**ISO 100 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

#### Wear

All component wear rates are normal.

#### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

#### Fluid Condition

Viscosity of sample indicates oil is within ISO 68 range, advise investigate. Confirm oil type. The AN level is acceptable for this fluid.

### SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>PCA0114155</b>	PCA0116065	PCA0082114
Sample Date	Client Info	<b>24 May 2024</b>	14 Mar 2024	27 Oct 2022
Machine Age	hrs	<b>0</b>	0	0
Oil Age	hrs	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>ATTENTION</b>	ABNORMAL	ATTENTION

### CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >.1	<b>NEG</b>	NEG	NEG

### WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >90	<b>&lt;1</b>	<1	3
Chromium	ppm	ASTM D5185m >5	<b>&lt;1</b>	<1	0
Nickel	ppm	ASTM D5185m >5	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>&lt;1</b>	<1	0
Silver	ppm	ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >7	<b>2</b>	3	<1
Lead	ppm	ASTM D5185m >12	<b>&lt;1</b>	<1	<1
Copper	ppm	ASTM D5185m >30	<b>&lt;1</b>	1	1
Tin	ppm	ASTM D5185m >9	<b>&lt;1</b>	<1	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0

### ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>7</b>	0	0
Barium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>1</b>	<1	<1
Calcium	ppm	ASTM D5185m	<b>89</b>	3	0
Phosphorus	ppm	ASTM D5185m	<b>528</b>	478	410
Zinc	ppm	ASTM D5185m	<b>44</b>	4	12
Sulfur	ppm	ASTM D5185m	<b>665</b>	467	591

### CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >60	<b>3</b>	3	3
Sodium	ppm	ASTM D5185m	<b>1</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>2</b>	1	1

### FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	<b>19178</b>	▲ 44088	---
Particles >6µm	ASTM D7647 >2500	<b>954</b>	▲ 3072	---
Particles >14µm	ASTM D7647 >640	<b>22</b>	37	---
Particles >21µm	ASTM D7647 >160	<b>4</b>	7	---
Particles >38µm	ASTM D7647 >40	<b>1</b>	1	---
Particles >71µm	ASTM D7647 >10	<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c) >20/18/16	<b>21/17/12</b>	▲ 23/19/12	---

### FLUID DEGRADATION


method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.25</b>	0.25	---

# OIL ANALYSIS REPORT


## Particle Trend

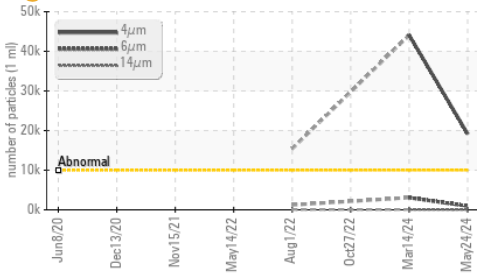


## Viscosity @ 40°C

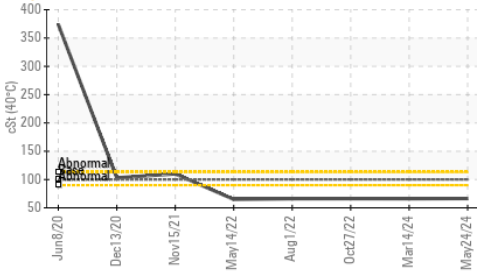

## Particle Trend

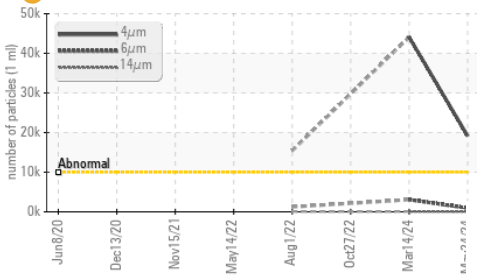

## Acid Number

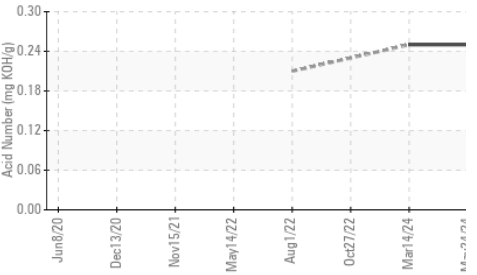


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	100	66.4	66.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color

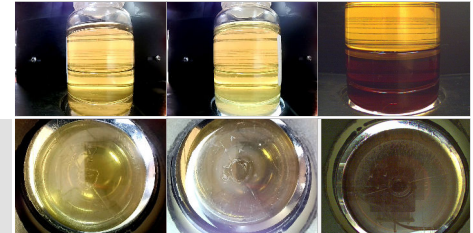


Bottom

## GRAPHS


### Ferrous Alloys

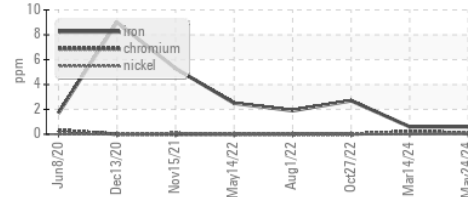


### Non-ferrous Metals

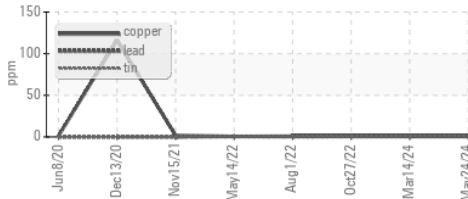


### Viscosity @ 40°C

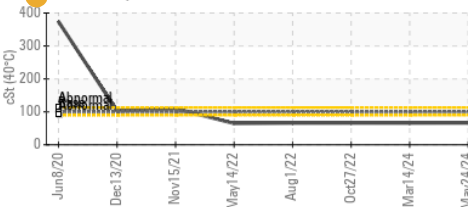

### Particle Count

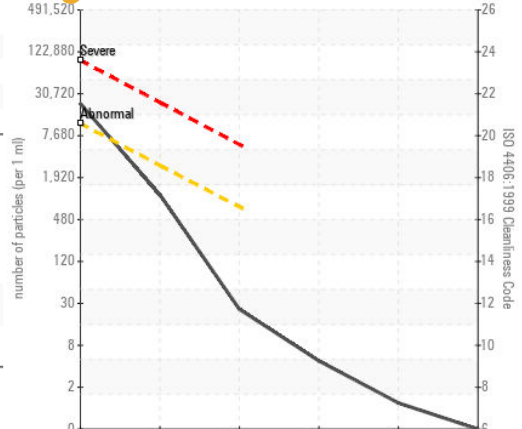

### Acid Number

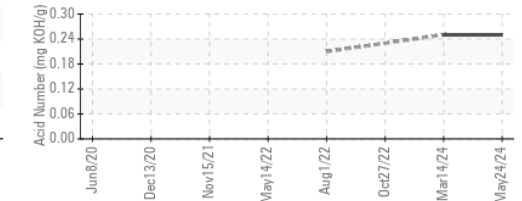

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513

**Sample No.** : PCA0114155

**Lab Number** : 06195410

**Unique Number** : 11057533

**Test Package** : IND 2 ( Additional Tests: PrtCount )

**Received** : 30 May 2024

**Tested** : 31 May 2024

**Diagnosed** : 31 May 2024 - Angela Borella

**KraftHeinz - Kirksville - Plant 8333 PCA**

2504 INDUSTRIAL DR

KIRKSVILLE, MO

US 63501

Contact: WALLACE WARD

wallace.ward@kraftheinzcompany.com

T: (660)627-1031

F: (660)627-5887

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)