


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

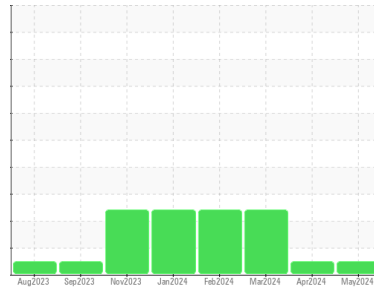

Machine Id
2086
 Component
Natural Gas Engine
 Fluid
LO-ASH ENGINE OIL SAE 40 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Wear

All component wear rates are normal.

Contamination

Fuel content negligible. There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			PCA0111234	PCA0111233	PCA0111214
Sample Date	Client Info			16 May 2024	16 Apr 2024	07 Mar 2024
Machine Age	hrs	Client Info		72499	71848	70832
Oil Age	hrs	Client Info		1004	353	62589
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	ABNORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	3	11
Chromium	ppm	ASTM D5185m	>4	0	<1	<1
Nickel	ppm	ASTM D5185m	>2	0	<1	0
Titanium	ppm	ASTM D5185m		0	<1	0
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>9	<1	1	2
Lead	ppm	ASTM D5185m	>30	0	<1	3
Copper	ppm	ASTM D5185m	>35	3	3	13
Tin	ppm	ASTM D5185m	>4	<1	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	<1	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	37	0	0	2
Barium	ppm	ASTM D5185m	12	0	0	0
Molybdenum	ppm	ASTM D5185m	200	2	3	10
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	5	15	13	25
Calcium	ppm	ASTM D5185m	1600	1390	1273	1489
Phosphorus	ppm	ASTM D5185m	300	310	303	307
Zinc	ppm	ASTM D5185m	400	378	356	433
Sulfur	ppm	ASTM D5185m	2600	2779	2613	2559

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+100	1	2	3
Sodium	ppm	ASTM D5185m		1	0	5
Potassium	ppm	ASTM D5185m	>20	0	1	1
Fuel	%	ASTM D3524	>4.0	0.2	0.0	0.3

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0	0	0
Nitration	Abs/cm	*ASTM D7624	>20	4.7	4.3	8.6
Sulfation	Abs/.1mm	*ASTM D7415	>30	15.5	14.7	23.0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	10.2	9.1	22.7
Acid Number (AN)	mg KOH/g	ASTM D8045		1.41	0.49	▲ 3.18
Base Number (BN)	mg KOH/g	ASTM D2896	3.0	3.09	3.55	▲ 1.82









OIL ANALYSIS REPORT

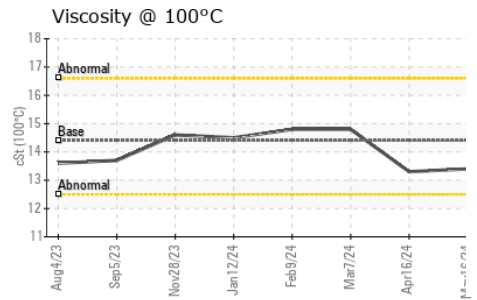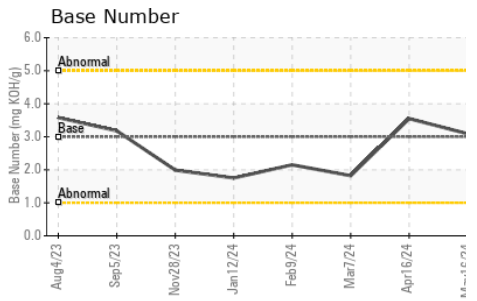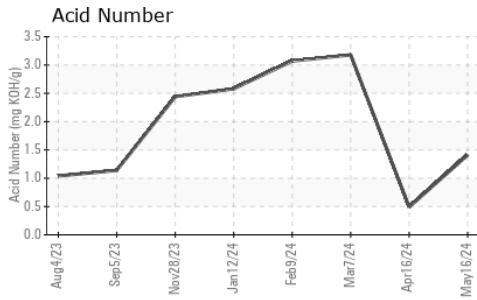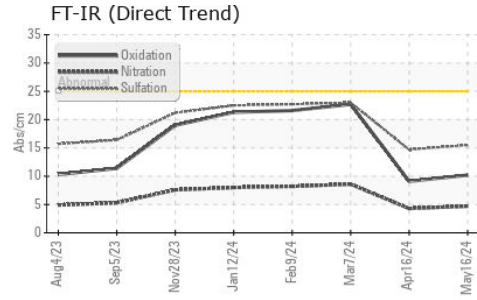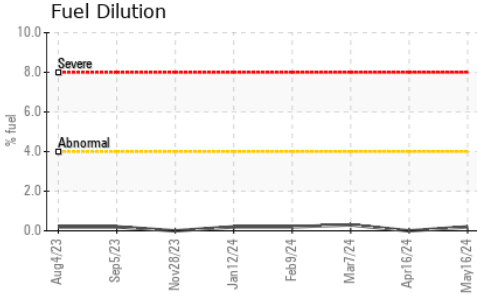

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	13.4	13.3

GRAPHS

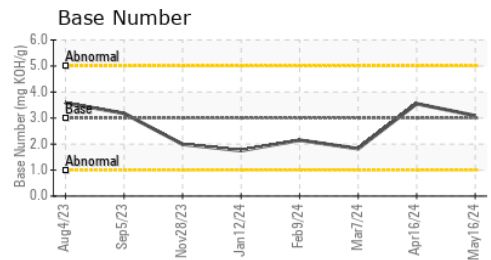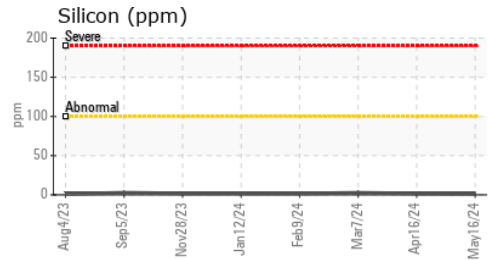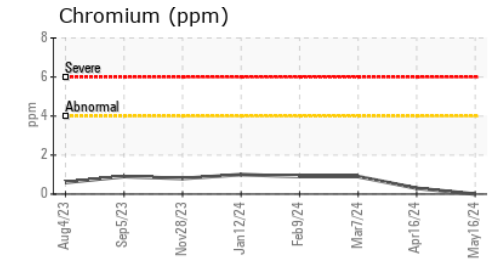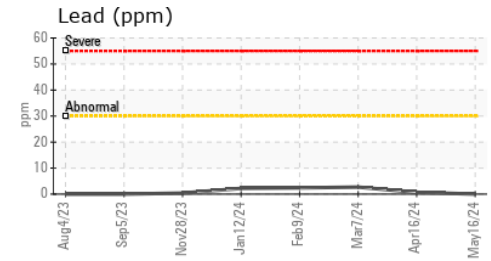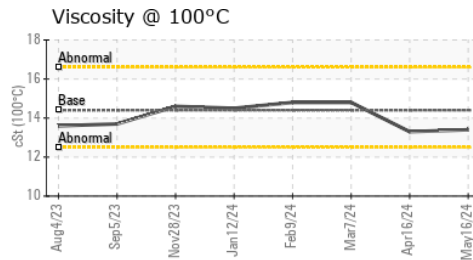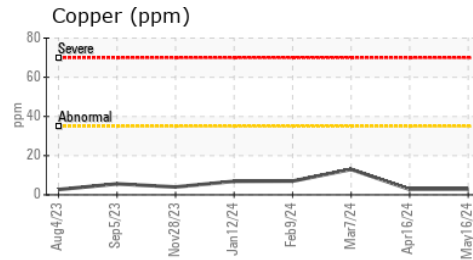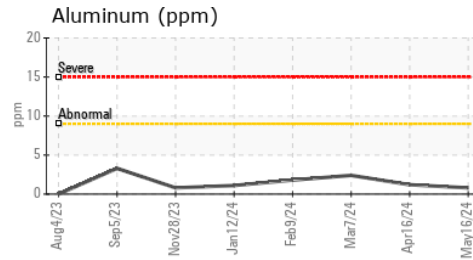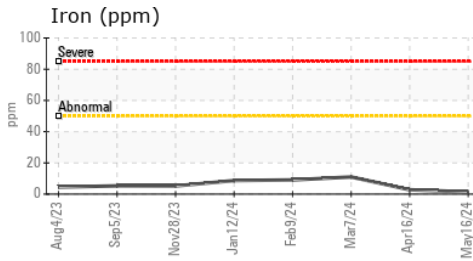

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0111234 **Received** : 30 May 2024
Lab Number : 06195623 **Tested** : 03 Jun 2024
Unique Number : 11057746 **Diagnosed** : 03 Jun 2024 - Wes Davis
Test Package : MOB 2 (Additional Tests: FuelDilution, PercentFuel)

USA COMPRESSION
 375 S MAIN STREET
 MANSFIELD, PA
 US 16933

Contact: JASON KUZNESKI
 jkuzneski@usacompression.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: