

OIL ANALYSIS REPORT

Sample Rating Trend



Area (24564UA)

819013 Diesel Engine Fluid

DIESEL ENGINE OIL SAE 40 (--- GAL)

DIAGNOSIS Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition


The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORI	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		GFL0122052	GFL0111879	GFL0111889
Sample Date		Client Info		03 Jun 2024	16 Apr 2024	13 Mar 2024
Machine Age	hrs	Client Info		11150	11010	10829
Oil Age	hrs	Client Info		10969	181	10829
Oil Changed		Client Info		Not Changd	Not Changd	Changed
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINAT	ION	method	limit/base	current	history1	history2
Fuel		WC Method	>3.0	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
WEAR METAL	S	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>120	29	21	28
Chromium	ppm	ASTM D5185m	>20	<1	1	<1
Nickel	ppm	ASTM D5185m	>5	0	2	0
Titanium	ppm	ASTM D5185m	>2	<1	<1	<1
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>20	8	5	8
Lead	ppm	ASTM D5185m	>40	8	3	3
Copper	ppm	ASTM D5185m	>330	2	2	3
Tin	ppm	ASTM D5185m	>15	2	2	<1
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium		AOTH DELOF				0
Caumum	ppm	ASTM D5185m		0	1	0
ADDITIVES	ppm	method	limit/base	0 current	1 history1	0 history2
	ppm ppm		limit/base 250	-		-
ADDITIVES		method		current	history1	history2
ADDITIVES Boron	ppm	method ASTM D5185m	250	current 20	history1 19	history2 8
ADDITIVES Boron Barium	ppm ppm	method ASTM D5185m ASTM D5185m	250 10	current 20 <1	history1 19 0	history2 8 0
ADDITIVES Boron Barium Molybdenum	ppm ppm ppm	method ASTM D5185m ASTM D5185m ASTM D5185m	250 10	current 20 <1 67	history1 19 0 60	history2 8 0 68
ADDITIVES Boron Barium Molybdenum Manganese	ppm ppm ppm ppm	method ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	250 10 100	current 20 <1 67 1	history1 19 0 60 1	history2 8 0 68 0
ADDITIVES Boron Barium Molybdenum Manganese Magnesium	ppm ppm ppm ppm ppm	method ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	250 10 100 450	current 20 <1 67 1 991	history1 19 0 60 1 888	history2 8 0 68 0 1045
ADDITIVES Boron Barium Molybdenum Manganese Magnesium Calcium	ppm ppm ppm ppm ppm ppm	method ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	250 10 100 450 3000	current 20 <1 67 1 991 1241	history1 19 0 60 1 888 1135	history2 8 0 68 0 1045 1277
ADDITIVES Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus	ppm ppm ppm ppm ppm ppm	method ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	250 10 100 450 3000 1150	current 20 <1 67 1 991 1241 1179	history1 19 0 60 1 888 1135 1088	history2 8 0 68 0 1045 1277 1222
ADDITIVES Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc	ppm ppm ppm ppm ppm ppm ppm ppm	method ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	250 10 100 450 3000 1150 1350	current 20 <1 67 1 991 1241 1179 1355	history1 19 0 60 1 888 1135 1088 1212	history2 8 0 68 0 1045 1277 1222 1377
ADDITIVES Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur	ppm ppm ppm ppm ppm ppm ppm ppm	method ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	250 10 100 450 3000 1150 1350 4250	Current 20 <1 67 1 991 1241 1179 1355 3474	history1 19 0 60 1 888 1135 1088 1212 3442	history2 8 0 68 0 1045 1277 1222 1377 3389
ADDITIVES Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN	ppm ppm ppm ppm ppm ppm ppm ppm ppm	method ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	250 10 100 450 3000 1150 1350 4250	current 20 <1 67 1 991 1241 1179 1355 3474 current	history1 19 0 60 1 888 1135 1088 1212 3442 history1	history2 8 0 68 0 1045 1277 1222 1377 3389 history2
ADDITIVES Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon	ppm ppm ppm ppm ppm ppm ppm ppm ppm ppm	method ASTM D5185m	250 10 100 450 3000 1150 1350 4250 limit/base	current 20 <1 67 1 991 1241 1179 1355 3474 current 18	history1 19 0 60 1 888 1135 1088 1212 3442 history1 13	history2 8 0 68 0 1045 1277 1222 1377 3389 history2 18
ADDITIVES Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium	ppm ppm ppm ppm ppm ppm ppm ppm ppm ppm	method ASTM D5185m	250 10 100 450 3000 1150 1350 4250 limit/base >25 >216	current 20 <1 67 1 991 1241 1179 1355 3474 current 18 4	history1 19 0 60 1 888 1135 1088 1212 3442 history1 13 2	history2 8 0 68 0 1045 1277 1222 1377 3389 history2 18 1
ADDITIVES Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium	ppm ppm ppm ppm ppm ppm ppm ppm ppm ppm	method ASTM D5185m	250 10 100 450 3000 1150 1350 4250 limit/base >25 >216 >20	current 20 <1 67 1 991 1241 1179 1355 3474 current 18 4 8	history1 19 0 60 1 888 1135 1088 1212 3442 history1 13 2 4	history2 8 0 68 0 1045 1277 1222 1377 3389 history2 18 1 7
ADDITIVES Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED	ppm ppm ppm ppm ppm ppm ppm ppm ppm TS	method ASTM D5185m	250 10 100 450 3000 1150 1350 4250 Iimit/base >25 >216 >20 Iimit/base	current 20 <1 67 1 991 1241 1179 1355 3474 current 18 4 8 current	history1 19 0 60 1 888 1135 1088 1212 3442 history1 13 2 4 history1	history2 8 0 68 0 1045 1277 1222 1377 3389 history2 18 1 7 history2
ADDITIVES Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED Soot %	ppm ppm ppm ppm ppm ppm ppm ppm ppm ppm	method ASTM D5185m	250 10 100 450 3000 1150 1350 4250 limit/base >25 >216 >20 limit/base >20	current 20 <1 67 1 991 1241 1179 1355 3474 current 18 4 8 current 0.4	history1 19 0 60 1 888 1135 1088 1212 3442 history1 13 2 4 history1 0.4	history2 8 0 68 0 1045 1277 1222 1377 3389 history2 18 1 7 history2 0.6
ADDITIVES Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED Soot % Nitration	ppm ppm ppm ppm ppm ppm ppm ppm ppm ppm	method ASTM D5185m	250 10 100 450 3000 1150 1350 4250 imit/base >25 >216 >20 imit/base >4 >20	current 20 <1 67 1 991 1241 1179 1355 3474 current 18 4 8 current 0.4 9.5	history1 19 0 60 1 888 1135 1088 1212 3442 history1 13 2 4 history1 0.4 7.3	history2 8 0 68 0 1045 1277 1222 1377 3389 history2 18 1 7 history2 0.6 9.8
ADDITIVES Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED Soot % Nitration Sulfation	ppm ppm ppm ppm ppm ppm ppm ppm ppm ppm	method ASTM D5185m ASTM D5185m	250 10 100 450 3000 1150 1350 4250 1imit/base >25 >216 >20 imit/base >4 >20	current 20 <1 67 1 991 1241 1179 1355 3474 current 18 4 8 current 0.4 9.5 22.9	history1 19 0 60 1 888 1135 1088 1212 3442 history1 13 2 4 history1 0.4 7.3 19.8	history2 8 0 68 0 1045 1277 1222 1377 3389 history2 18 1 7 history2 0.6 9.8 21.4




OIL ANALYSIS REPORT



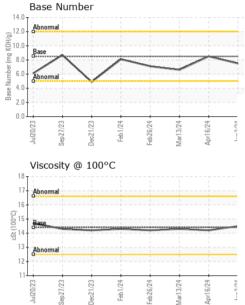

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPE	RTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	14.5	14.2	14.3
GRAPHS						

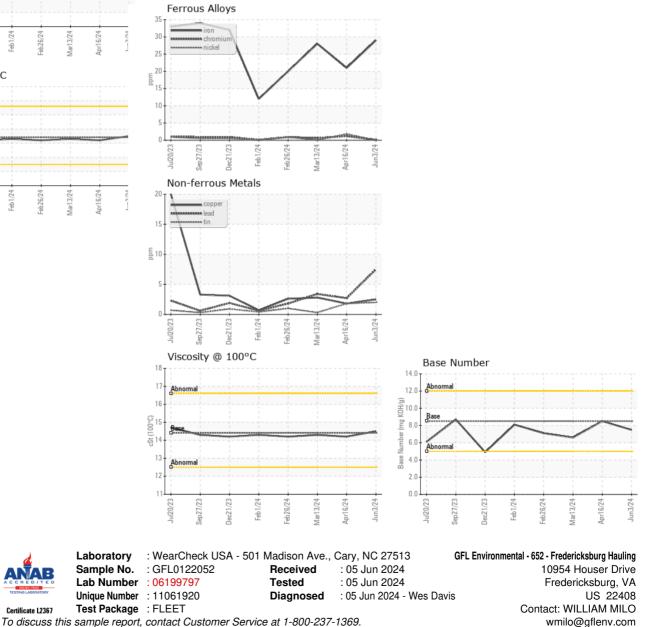



Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) Report Id: GFL652 [WUSCAR] 06199797 (Generated: 06/05/2024 18:08:15) Rev: 1

Submitted By: TECHNICIAN ACCOUNT

T:

F: