


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

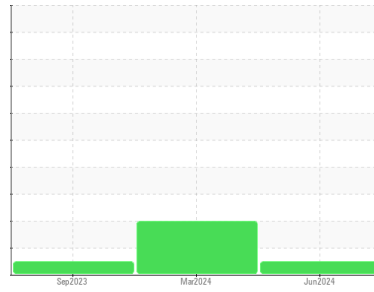

Area
ISO - Pouring Table
 Machine Id
Pouring Table Application Hydraulic System B3225
 Component
Hydraulic System
 Fluid
PETRO CANADA HYDREX AW 46 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		PCA0124553	PCA0107750	PCA0106229
Sample Date	Client Info		13 Jun 2024	28 Mar 2024	13 Sep 2023
Machine Age	yrs	Client Info	3	3	3
Oil Age	yrs	Client Info	0	0	3
Oil Changed	Client Info		Not Changed	Not Changd	Not Changed
Sample Status			NORMAL	ABNORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	<1	1	0
Chromium	ppm	ASTM D5185m >20	<1	<1	0
Nickel	ppm	ASTM D5185m >20	<1	<1	0
Titanium	ppm	ASTM D5185m	<1	<1	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >20	2	2	<1
Lead	ppm	ASTM D5185m >20	<1	1	0
Copper	ppm	ASTM D5185m >20	<1	1	<1
Tin	ppm	ASTM D5185m >20	<1	1	0
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	<1	<1	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 0	0	0	0
Molybdenum	ppm	ASTM D5185m 0	<1	2	0
Manganese	ppm	ASTM D5185m 0	<1	<1	<1
Magnesium	ppm	ASTM D5185m 0	<1	<1	<1
Calcium	ppm	ASTM D5185m 50	40	52	50
Phosphorus	ppm	ASTM D5185m 330	313	366	339
Zinc	ppm	ASTM D5185m 430	424	425	432
Sulfur	ppm	ASTM D5185m 760	879	971	1024

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	1	<1	<1
Sodium	ppm	ASTM D5185m	0	0	0
Potassium	ppm	ASTM D5185m >20	<1	2	0
Water	%	ASTM D6304 >0.05	NEG	NEG	NEG


FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	3445	▲ 16445	4344
Particles >6µm	ASTM D7647	>1300	242	▲ 3818	285
Particles >14µm	ASTM D7647	>160	7	▲ 300	11
Particles >21µm	ASTM D7647	>40	1	▲ 54	4
Particles >38µm	ASTM D7647	>10	0	2	1
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	19/15/10	▲ 21/19/15	19/15/11


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.70	0.38	0.43	0.39


OIL ANALYSIS REPORT

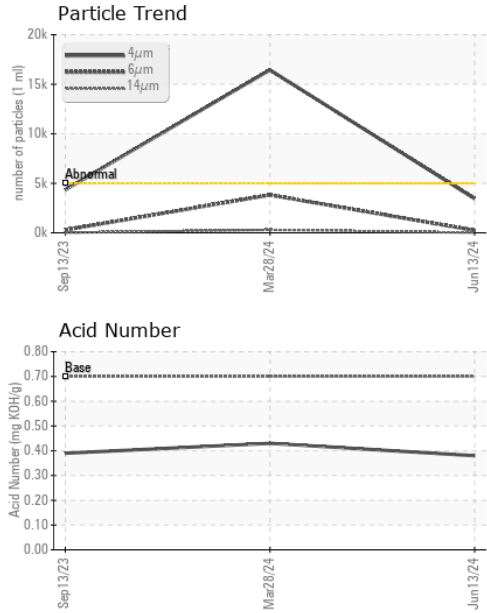


PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

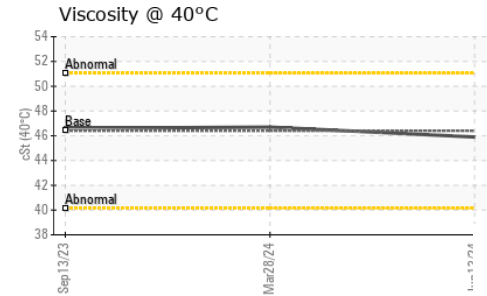






PARAMETER	method	limit/base	current	history1	history2	
FLUID PROPERTIES						
Visc @ 40°C	cSt	ASTM D445	46.4	45.9	46.7	46.6

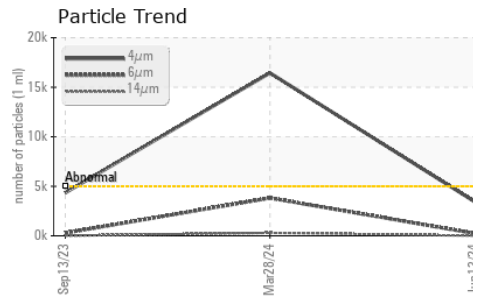

PARAMETER	method	limit/base	current	history1	history2
SAMPLE IMAGES					

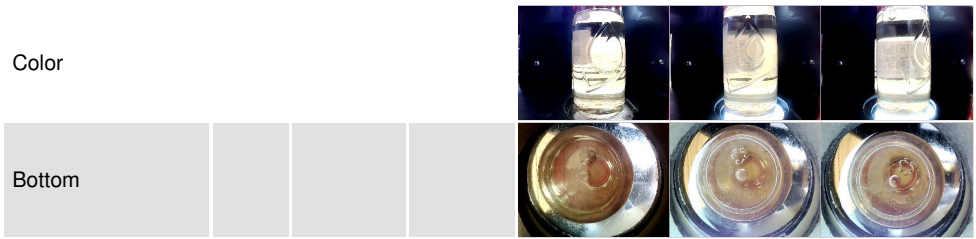

GRAPHS

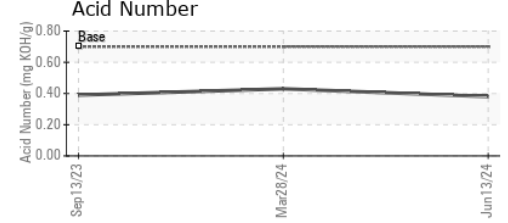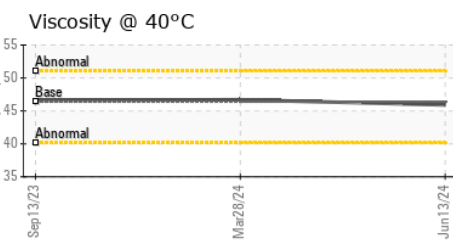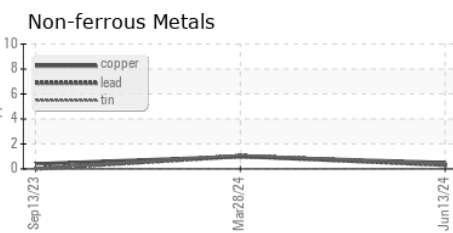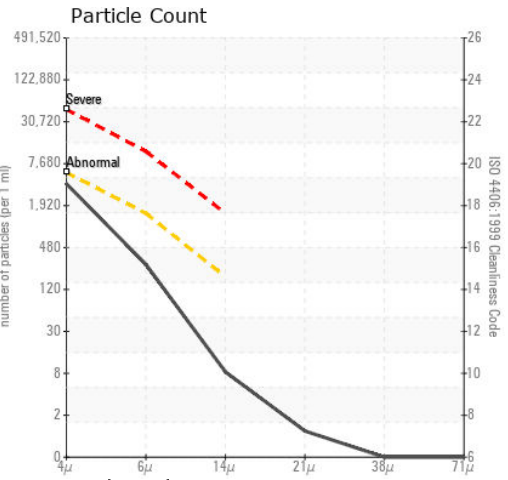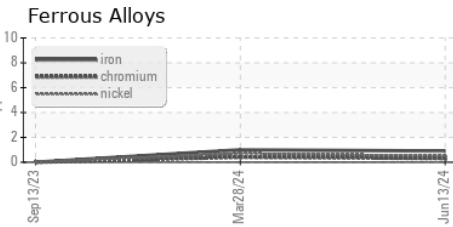

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0124553
Lab Number : 06211562
Unique Number : 11084426
Test Package : PLANT

Received : 17 Jun 2024
Tested : 18 Jun 2024
Diagnosed : 18 Jun 2024 - Don Baldrige

IKO HAGERSTOWN
 160 IKO WAY
 HAGERSTOWN, MD
 US 21740
 Contact: LUIS FERNANDEZ
 luis.fernandez@iko.com
 T: (240)267-4100
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)