


# OIL ANALYSIS REPORT

## Sample Rating Trend



**NORMAL**

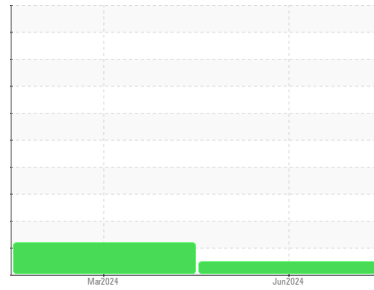

Area  
**UTILITIES [99012692]**  
Machine Id  
**GSC-12**  
Component  
**Screw Compressor**  
Fluid  
**CAMCO 717 SC (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>PCA0117526</b>	PCA0102400	---
Sample Date	Client Info			<b>11 Jun 2024</b>	18 Mar 2024	---
Machine Age	hrs	Client Info		<b>2853</b>	0	---
Oil Age	hrs	Client Info		<b>0</b>	0	---
Oil Changed	Client Info			<b>N/A</b>	N/A	---
Sample Status				<b>NORMAL</b>	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>60	<b>&lt;1</b>	2	---
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	<1	---
Nickel	ppm	ASTM D5185m		<b>0</b>	<1	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Silver	ppm	ASTM D5185m		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>5	<b>0</b>	1	---
Lead	ppm	ASTM D5185m	>10	<b>0</b>	1	---
Copper	ppm	ASTM D5185m	>30	<b>&lt;1</b>	<1	---
Tin	ppm	ASTM D5185m	>15	<b>0</b>	1	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	<1	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	---
Barium	ppm	ASTM D5185m		<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	<1	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Calcium	ppm	ASTM D5185m		<b>0</b>	3	---
Phosphorus	ppm	ASTM D5185m		<b>1</b>	3	---
Zinc	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Sulfur	ppm	ASTM D5185m		<b>0</b>	0	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<b>2</b>	2	---
Sodium	ppm	ASTM D5185m		<b>1</b>	0	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	<1	---
Water	%	ASTM D6304	>0.1	<b>0.003</b>	0.008	---
ppm Water	ppm	ASTM D6304	>1000	<b>37</b>	83	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>1300	<b>967</b>	▲ 7437	---
Particles >6µm		ASTM D7647	>320	<b>192</b>	▲ 645	---
Particles >14µm		ASTM D7647	>80	<b>6</b>	6	---
Particles >21µm		ASTM D7647	>20	<b>0</b>	2	---
Particles >38µm		ASTM D7647	>4	<b>0</b>	0	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>17/15/13	<b>17/15/10</b>	▲ 20/17/10	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.014</b>	0.014	---


# OIL ANALYSIS REPORT

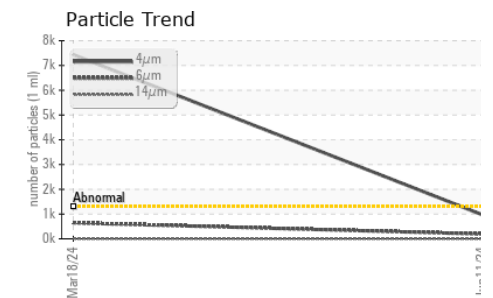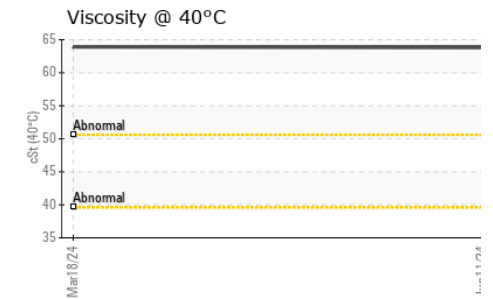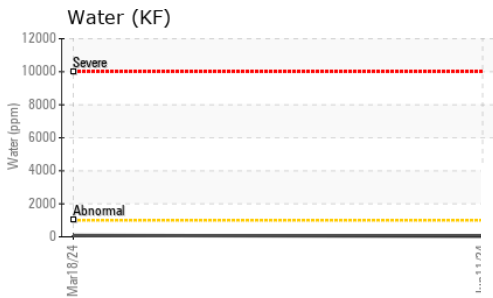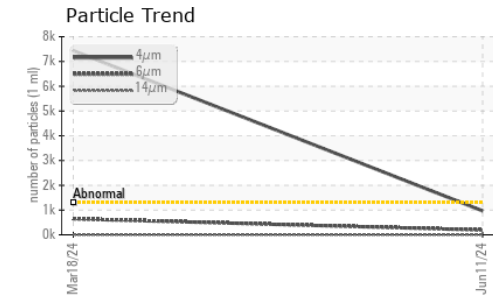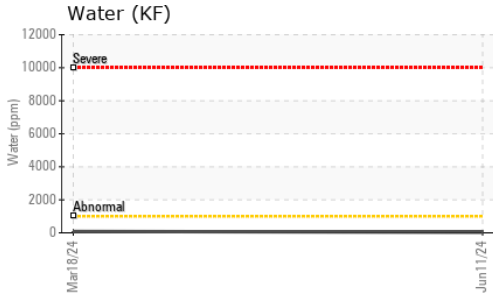





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	<b>63.8</b>	63.9	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

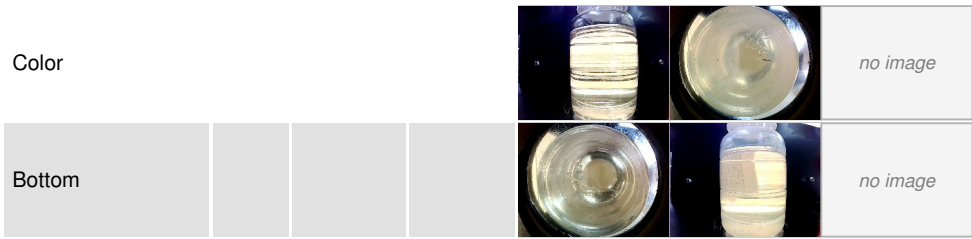

## GRAPHS

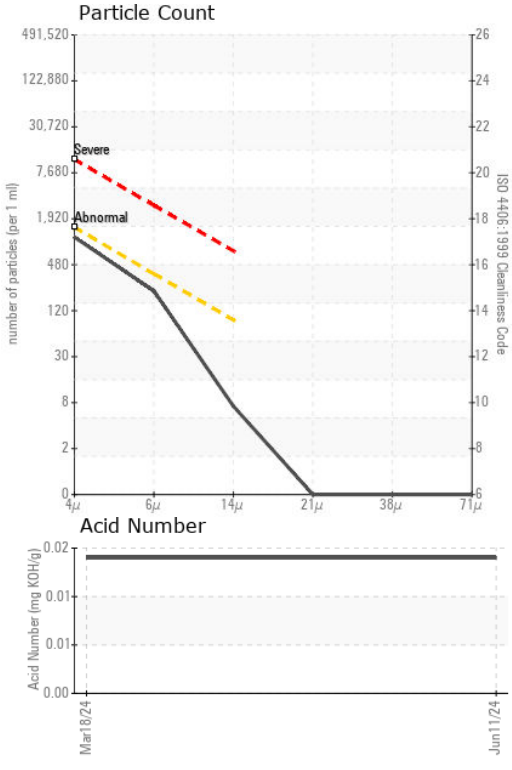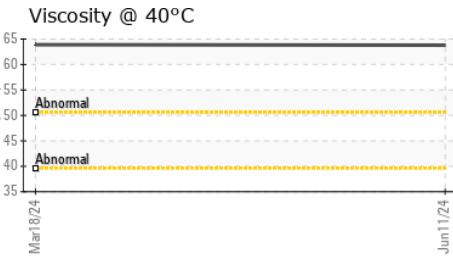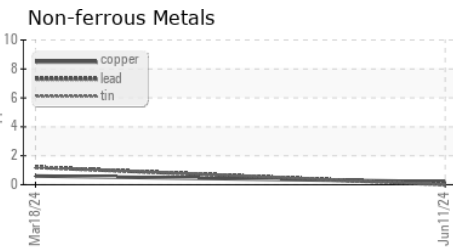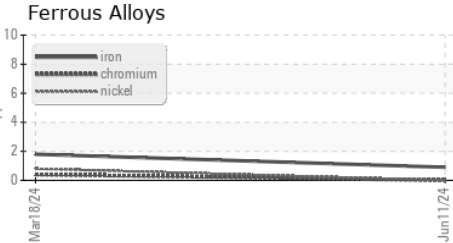

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0117526 **Received** : 17 Jun 2024  
**Lab Number** : **06211728** **Tested** : 18 Jun 2024  
**Unique Number** : 11084592 **Diagnosed** : 18 Jun 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**KraftHeinz - Springfield - Plant 8311 PCA**  
 2035 E BENNETT  
 SPRINGFIELD, MO  
 US 65804  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: