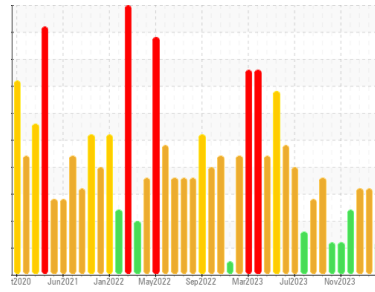


OIL ANALYSIS REPORT

Sample Rating Trend

ISO


Area

MIX ROOM A [98996319]

 Machine Id
KR-GR-003109 - E DUMPER 15A (S/N MIX A - 11513055)

Component

Hydraulic System

Fluid

AW HYDRAULIC OIL ISO 68 (--- GAL)
DIAGNOSIS
Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. (Customer Sample Comment: 98996319)

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PCA0128832	PCA0119602	PCA0055967
Sample Date	Client Info	13 Jun 2024	17 Apr 2024	16 Apr 2024
Machine Age	hrs	0	0	0
Oil Age	hrs	0	0	0
Oil Changed	Client Info	Not Changed	Not Changed	Not Changed
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >20	3	0	2
Chromium	ppm	ASTM D5185m >20	<1	0	<1
Nickel	ppm	ASTM D5185m >20	<1	0	0
Titanium	ppm	ASTM D5185m	<1	<1	<1
Silver	ppm	ASTM D5185m	<1	0	0
Aluminum	ppm	ASTM D5185m >20	2	0	0
Lead	ppm	ASTM D5185m >20	<1	0	0
Copper	ppm	ASTM D5185m >20	<1	<1	<1
Tin	ppm	ASTM D5185m >20	<1	0	0
Vanadium	ppm	ASTM D5185m	0	<1	<1
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 5	0	0	0
Barium	ppm	ASTM D5185m 5	0	0	0
Molybdenum	ppm	ASTM D5185m 5	<1	0	3
Manganese	ppm	ASTM D5185m	<1	0	0
Magnesium	ppm	ASTM D5185m 25	<1	<1	0
Calcium	ppm	ASTM D5185m 200	0	<1	1
Phosphorus	ppm	ASTM D5185m 300	383	418	402
Zinc	ppm	ASTM D5185m 370	7	0	0
Sulfur	ppm	ASTM D5185m 2500	601	630	758

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	3	2	4
Sodium	ppm	ASTM D5185m	4	5	3
Potassium	ppm	ASTM D5185m >20	1	0	0

FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	▲ 41496	---	6159
Particles >6µm	ASTM D7647 >2500	▲ 6649	---	● 3355
Particles >14µm	ASTM D7647 >640	27	---	571
Particles >21µm	ASTM D7647 >160	4	---	192
Particles >38µm	ASTM D7647 >40	0	---	30
Particles >71µm	ASTM D7647 >10	0	---	3
Oil Cleanliness	ISO 4406 (c) >20/18/16	▲ 23/20/12	---	● 20/19/16

FLUID DEGRADATION


method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.57	0.24	0.20	0.26

OIL ANALYSIS REPORT


▲ Particle Trend

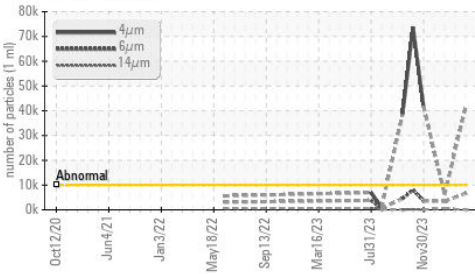


▲ Particle Trend

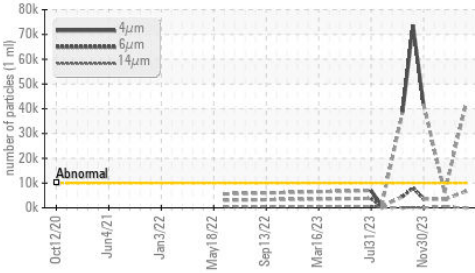

Acid Number

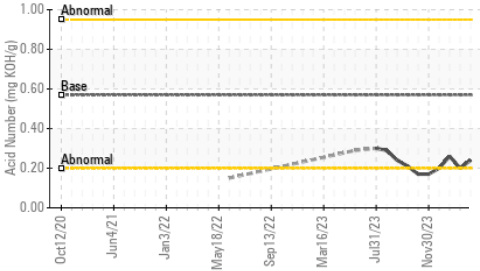

Viscosity @ 40°C

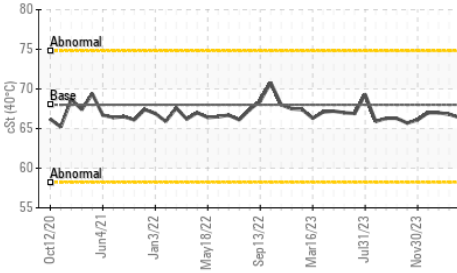

PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	▲ MODER	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	● HAZY	● MILKY
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	68	66.4	66.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color

Bottom




GRAPHS


Ferrous Alloys

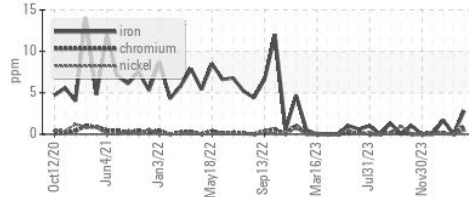


Non-ferrous Metals

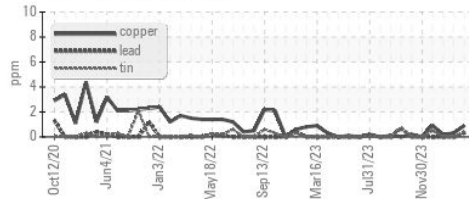


Viscosity @ 40°C

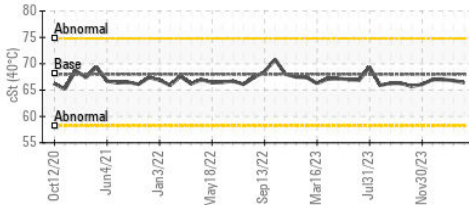

▲ Particle Count

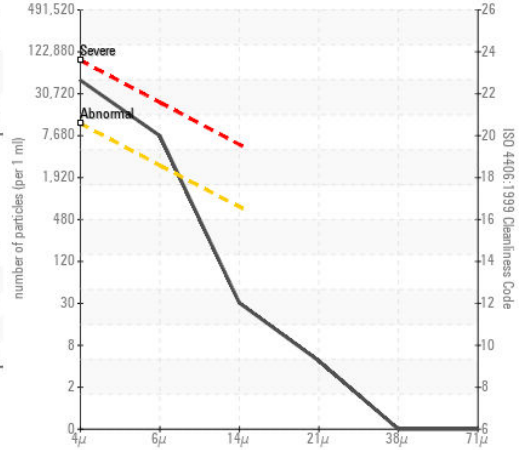

Acid Number

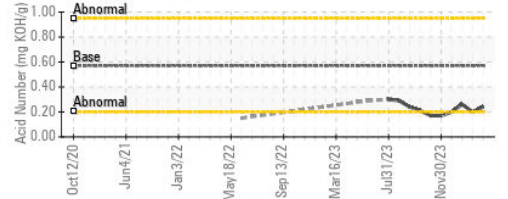

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0128832
Lab Number : 06213448
Unique Number : 11086312
Test Package : IND 2

Received : 18 Jun 2024
Tested : 19 Jun 2024
Diagnosed : 20 Jun 2024 - Don Baldrige

KraftHeinz - Kirksville - Plant 8333 PCA
 2504 INDUSTRIAL DR
 KIRKSVILLE, MO
 US 63501

Contact: WALLACE WARD
 wallace.ward@kraftheinzcompany.com

T: (660)627-1031

F: (660)627-5887

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)