




# OIL ANALYSIS REPORT

Sample Rating Trend

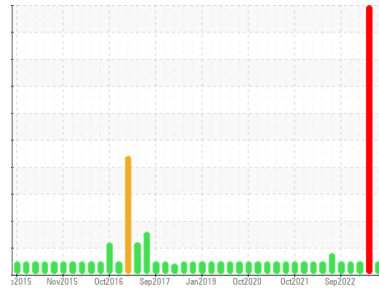

**NORMAL**



Machine Id  
**10377C**

Component  
**Natural Gas Engine**

Fluid  
**PETRO CANADA DURON GEO LD 15W40 (30 QTS)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>GFL0123393</b>	GFL0082411	GFL0082475
Sample Date	Client Info		<b>18 Jun 2024</b>	18 Oct 2023	26 Sep 2023
Machine Age	hrs	Client Info	<b>80011</b>	80011	1512
Oil Age	hrs	Client Info	<b>80011</b>	80011	803
Oil Changed	Client Info		<b>Changed</b>	Changed	Changed
Sample Status			<b>NORMAL</b>	SEVERE	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>31</b>	▲ 1552	14
Chromium	ppm	ASTM D5185m >4	<b>2</b>	3	<1
Nickel	ppm	ASTM D5185m >2	<b>&lt;1</b>	1	<1
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	1	0
Silver	ppm	ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >9	<b>3</b>	▲ 43	2
Lead	ppm	ASTM D5185m >30	<b>14</b>	▲ 87	<1
Copper	ppm	ASTM D5185m >35	<b>4</b>	▲ 40	<1
Tin	ppm	ASTM D5185m >4	<b>0</b>	▲ 4	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	<1	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 50	<b>3</b>	38	24
Barium	ppm	ASTM D5185m 5	<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185m 50	<b>54</b>	● <1	51
Manganese	ppm	ASTM D5185m 0	<b>&lt;1</b>	10	<1
Magnesium	ppm	ASTM D5185m 560	<b>567</b>	● 17	529
Calcium	ppm	ASTM D5185m 1510	<b>1832</b>	● 60	1493
Phosphorus	ppm	ASTM D5185m 780	<b>764</b>	● 269	769
Zinc	ppm	ASTM D5185m 870	<b>1034</b>	● 163	953
Sulfur	ppm	ASTM D5185m 2040	<b>2937</b>	● 201	2573

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >+100	<b>4</b>	19	4
Sodium	ppm	ASTM D5185m	<b>9</b>	17	5
Potassium	ppm	ASTM D5185m >20	<b>4</b>	▲ 152	2

## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	<b>0</b>	0.1	0
Nitration	Abs/cm	*ASTM D7624 >20	<b>11.6</b>	7.0	8.0
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>25.1</b>	54.7	18.1


## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>20.7</b>	68.8	15.5
Base Number (BN)	mg KOH/g	ASTM D2896 10.2	<b>2.8</b>	2.9	7.1




# OIL ANALYSIS REPORT


FT-IR (Direct Trend)

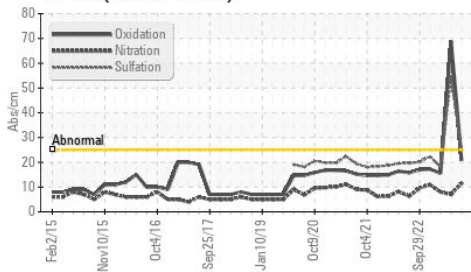

Base Number

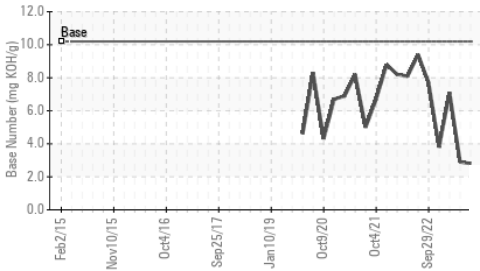

Viscosity @ 100°C

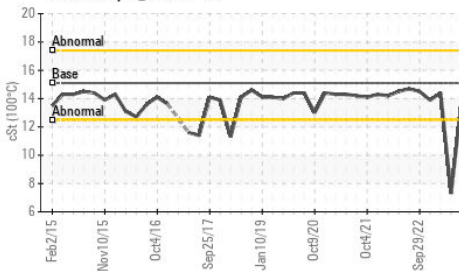

## VISUAL


	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

## FLUID PROPERTIES


	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.1	13.8	7.3

## GRAPHS


Ferrous Alloys

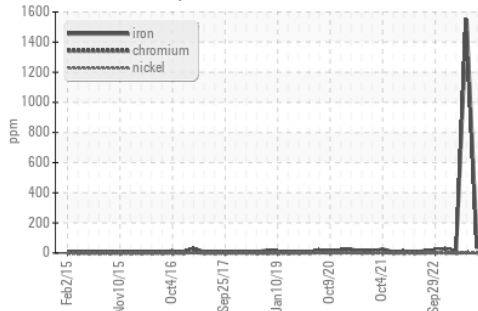


Non-ferrous Metals

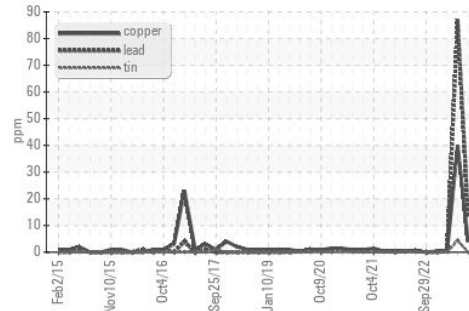

Viscosity @ 100°C

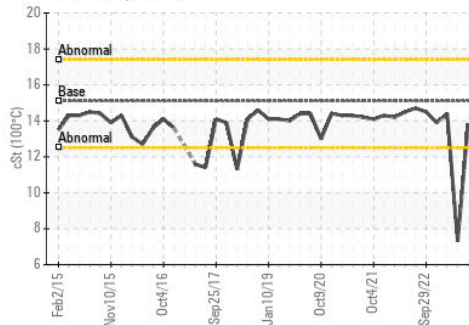

Base Number

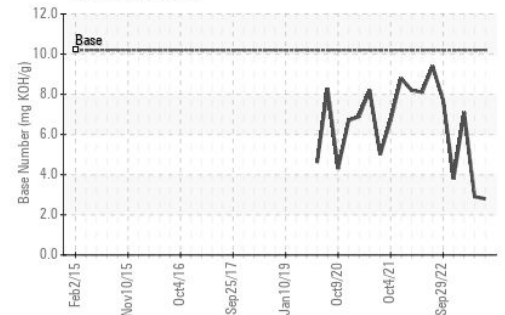

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : GFL0123393  
 Lab Number : 06215544  
 Unique Number : 11088408  
 Test Package : FLEET

Received : 20 Jun 2024  
 Tested : 21 Jun 2024  
 Diagnosed : 21 Jun 2024 - Wes Davis

GFL Environmental - 007 - Brunswick  
 2809 Galloway Road  
 Bolivia, NC  
 US 28422  
 Contact: DONALD CRAVEN  
 dcraven@gflenv.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (910)253-4179