




OIL ANALYSIS REPORT

Sample Rating Trend

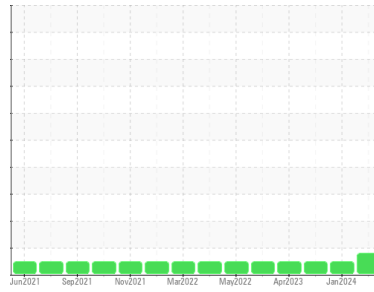

Area
(YA156352)

Machine Id
930012

Component
Natural Gas Engine

Fluid
PETRO CANADA DURON GEO LD 15W40 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

The copper level is abnormal. In the absence of other significant wear metals, suspect copper due to sources other than wear (i.e. cooling core). All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	GFL0123415	GFL0082439	GFL0082405
Sample Date	Client Info	18 Jun 2024	05 Jan 2024	05 Jul 2023
Machine Age	hrs	7157	7157	7157
Oil Age	hrs	7157	7157	1215
Oil Changed	Client Info	Not Chngd	Changed	Changed
Sample Status		ABNORMAL	NORMAL	NORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.1	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	11	11	8
Chromium	ppm	ASTM D5185m >4	1	2	1
Nickel	ppm	ASTM D5185m >2	0	1	0
Titanium	ppm	ASTM D5185m	<1	<1	<1
Silver	ppm	ASTM D5185m >3	0	0	0
Aluminum	ppm	ASTM D5185m >9	2	2	<1
Lead	ppm	ASTM D5185m >30	4	11	17
Copper	ppm	ASTM D5185m >35	39	2	2
Tin	ppm	ASTM D5185m >4	0	1	<1
Vanadium	ppm	ASTM D5185m	<1	0	<1
Cadmium	ppm	ASTM D5185m	0	<1	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 50	8	8	8
Barium	ppm	ASTM D5185m 5	0	0	<1
Molybdenum	ppm	ASTM D5185m 50	52	54	55
Manganese	ppm	ASTM D5185m 0	<1	1	<1
Magnesium	ppm	ASTM D5185m 560	593	602	607
Calcium	ppm	ASTM D5185m 1510	1811	1698	1806
Phosphorus	ppm	ASTM D5185m 780	815	765	808
Zinc	ppm	ASTM D5185m 870	1030	1020	1014
Sulfur	ppm	ASTM D5185m 2040	2896	2675	2880

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >+100	7	13	7
Sodium	ppm	ASTM D5185m	10	6	10
Potassium	ppm	ASTM D5185m >20	4	2	2

INFRA-RED





method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844	0	0.1	0.1
Nitration	Abs/cm	*ASTM D7624 >20	11.2	13.3	12.0
Sulfation	Abs/.1mm	*ASTM D7415 >30	23.5	26.4	28.2

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414 >25	19.9	22.9	25.7
Base Number (BN)	mg KOH/g	ASTM D2896 10.2	4.1	4.3	2.6







OIL ANALYSIS REPORT

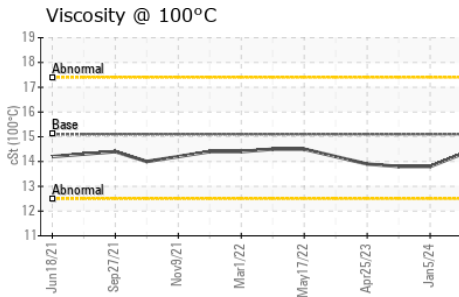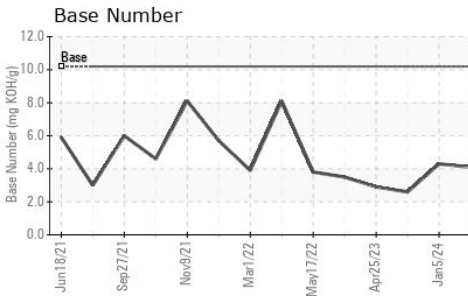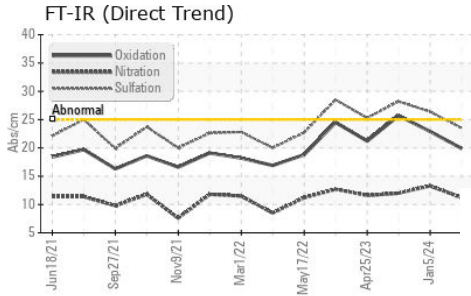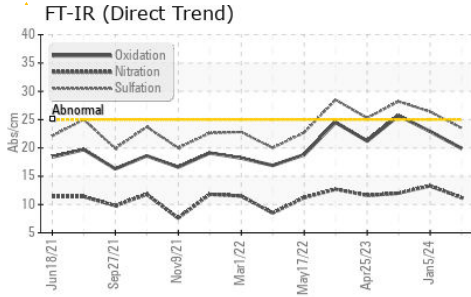

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.1	14.3	13.8

GRAPHS

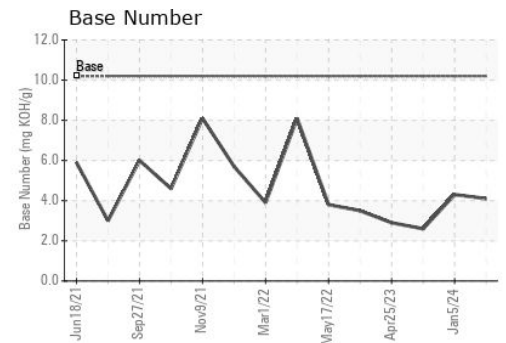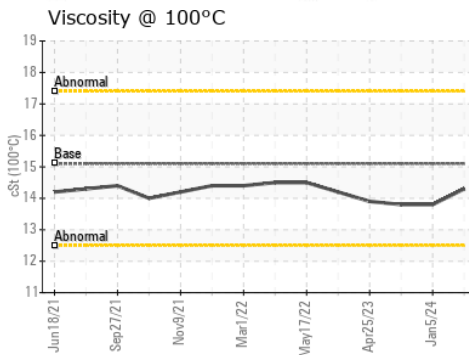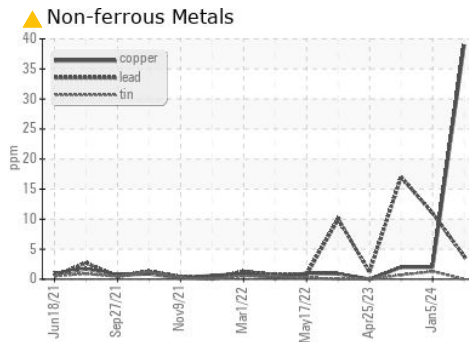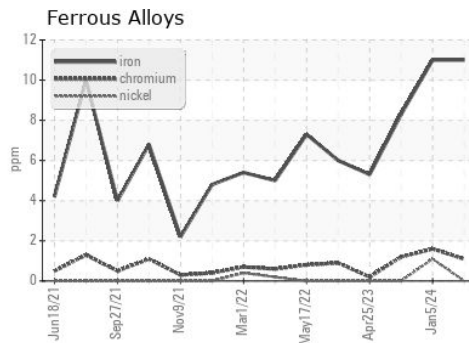

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : GFL0123415
 Lab Number : 06215576
 Unique Number : 11088440
 Test Package : FLEET

Received : 20 Jun 2024
 Tested : 21 Jun 2024
 Diagnosed : 21 Jun 2024 - Sean Felton

GFL Environmental - 007 - Brunswick
 2809 Galloway Road
 Bolivia, NC
 US 28422
 Contact: DONALD CRAVEN
 dcraven@gflenv.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (910)253-4179