

# OIL ANALYSIS REPORT

## Sample Rating Trend



**NORMAL**



Area  
**ISO - Cooling Towers**  
 Machine Id  
**COOLING TOWER 4B DRIVE**

Component  
**Gearbox**  
 Fluid  
**PETRO CANADA ENDURATEX SYNTHETIC EP 220 (39 LTR)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PCA0120198</b>	---	---
Sample Date	Client Info		<b>26 Jun 2024</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>Not Chngd</b>	---	---
Sample Status			<b>NORMAL</b>	---	---

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.2	<b>NEG</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >200	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m >15	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m >15	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >25	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185m >100	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >200	<b>0</b>	---	---
Tin	ppm	ASTM D5185m >25	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 33	<b>&lt;1</b>	---	---
Barium	ppm	ASTM D5185m 5	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m 5	<b>1</b>	---	---
Calcium	ppm	ASTM D5185m 5	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m 437	<b>287</b>	---	---
Zinc	ppm	ASTM D5185m 5	<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m 5000	<b>6</b>	---	---


## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>1</b>	---	---
Sodium	ppm	ASTM D5185m	<b>0</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>3</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.7	<b>1.80</b>	---	---

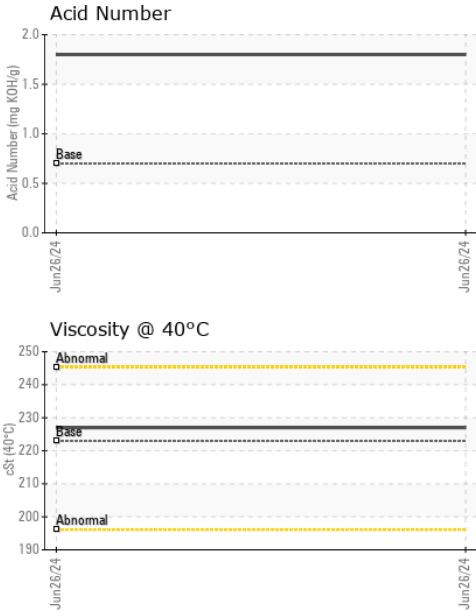

# OIL ANALYSIS REPORT







VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	---	---
Free Water	scalar	*Visual		<b>NEG</b>	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	223	<b>227</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

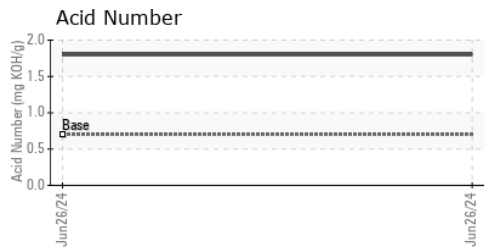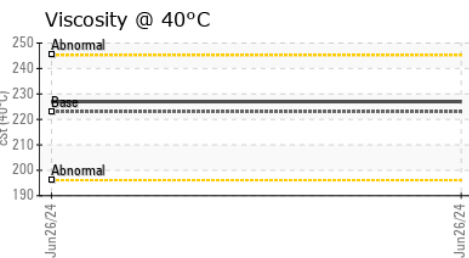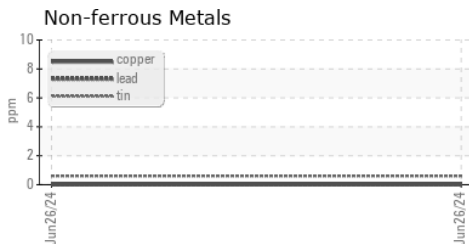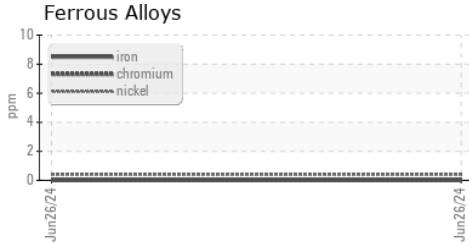

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0120198      **Received** : 02 Jul 2024  
**Lab Number** : **06226398**      **Tested** : 03 Jul 2024  
**Unique Number** : 11109891      **Diagnosed** : 05 Jul 2024 - Jonathan Hester  
**Test Package** : PLANT

**IKO HAGERSTOWN**  
 160 IKO WAY  
 HAGERSTOWN, MD  
 US 21740  
 Contact: LUIS FERNANDEZ  
 luis.fernandez@iko.com  
 T: (240)267-4100  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)