

OIL ANALYSIS REPORT

NAT CUTS [99014088] **LINE 12 CUBER**

Hydraulic System AW HYDRAULIC OIL ISO 46 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

Area


All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

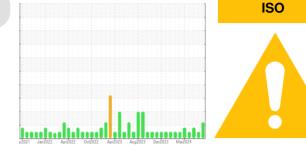

Sample Rating Trend


SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		PCA0127877	PCA0124921	PCA0124922
Sample Date		Client Info		17 Jun 2024	10 May 2024	07 May 2024
	hrs	Client Info		0	0	0
Ũ	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	NORMAL	ATTENTION
CONTAMINATIO	DN	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG	NEG	NEG
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	4	3	3
	ppm	ASTM D5185m	>20	<1	<1	<1
	ppm	ASTM D5185m	>20	0	0	0
	ppm	ASTM D5185m		0	0	0
	ppm	ASTM D5185m		0	0	0
1	ppm	ASTM D5185m	>20	0	0	0
	ppm	ASTM D5185m	>20	0	<1	<1
	ppm	ASTM D5185m	>20	8	7	8
	ppm	ASTM D5185m	>20	0	0	0
	ppm	ASTM D5185m		0	0	0
	ppm	ASTM D5185m		0	0	0
ADDITIVES	Pere	method	limit/base	current	history1	history2
_						
	ppm	ASTM D5185m	5	0	0	0
	ppm	ASTM D5185m	5	0	0	0
	ppm	ASTM D5185m	5	0	0	0
•	ppm	ASTM D5185m		0	0	0
	ppm	ASTM D5185m	25	0	1	<1
	ppm	ASTM D5185m	200	0	0	0
	ppm	ASTM D5185m	300	437	435	440
	ppm	ASTM D5185m	370	30	34	33
Sulfur	ppm	ASTM D5185m	2500	1168	1153	1154
CONTAMINANT	S	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	3	3	3
Sodium	ppm	ASTM D5185m		<1	0	0
Potassium	ppm	ASTM D5185m	>20	0	0	0
FLUID CLEANLI	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	A 35792	1460	5817
Particles >6µm		ASTM D7647	>1300	A 7383	677	1080
Particles >14µm		ASTM D7647	>320	229	126	47
Particles >21µm		ASTM D7647	>80	29	24	6
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>19/17/15	A 22/20/15	18/17/14	20/17/13
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.57	0.23	0.22	0.22
	-					


Report Id: KRASPRMO [WUSCAR] 06227363 (Generated: 07/08/2024 09:25:34) Rev: 1

Contact/Location: Service Manager - KRASPRMO



OIL ANALYSIS REPORT

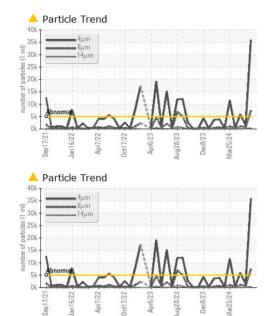



0ct17/22 Apr6/23 Dec8/23

/lar25/24


vug28/23

Abnorm 4(

35

Sep17/21 Jan 16/22 Anr7/77

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPE	RTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	48.7	48.7	48.9
SAMPLE IMAG	ES	method	limit/base	current	history1	history2
Color					•	
Bottom						

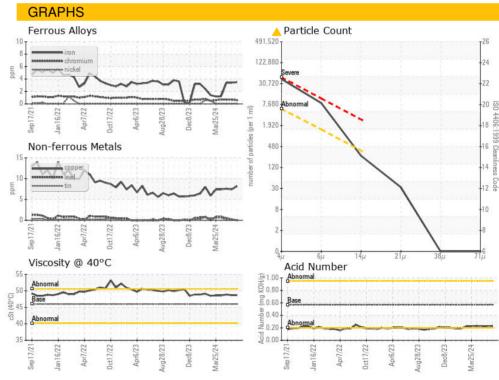

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513 KraftHeinz - Springfield - Plant 8311 PCA Sample No. : PCA0127877 Received : 03 Jul 2024 2035 E BENNETT Lab Number : 06227363 Tested : 05 Jul 2024 SPRINGFIELD, MO : 05 Jul 2024 - Angela Borella Unique Number : 11110856 Diagnosed US 65804 Test Package : IND 2 Contact: Service Manager Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F:

Report Id: KRASPRMO [WUSCAR] 06227363 (Generated: 07/08/2024 09:25:34) Rev: 1

Contact/Location: Service Manager - KRASPRMO