


# OIL ANALYSIS REPORT

## Sample Rating Trend



ISO

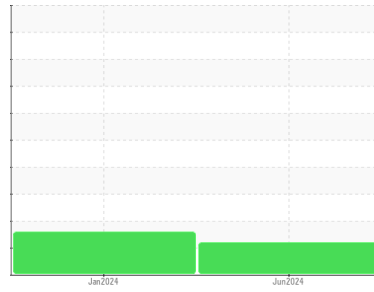

Area

## PROCESS CHEESE [99142378] SODIUM HYDROXIDE BAY (S/N UP900137)

Machine Id

Component

Pump

Fluid

ISO 68 (1 LTR)

### DIAGNOSIS

#### Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			PCA0130494	PCA0114282	---
Sample Date	Client Info			25 Jun 2024	21 Jan 2024	---
Machine Age	mths	Client Info		24	0	---
Oil Age	mths	Client Info		1	0	---
Oil Changed	Client Info			N/A	Changed	---
Sample Status				ABNORMAL	ABNORMAL	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>.1	NEG	NEG	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>90	0	0	---
Chromium	ppm	ASTM D5185m	>5	0	<1	---
Nickel	ppm	ASTM D5185m	>5	0	0	---
Titanium	ppm	ASTM D5185m	>3	0	<1	---
Silver	ppm	ASTM D5185m	>3	0	0	---
Aluminum	ppm	ASTM D5185m	>7	0	2	---
Lead	ppm	ASTM D5185m	>12	0	0	---
Copper	ppm	ASTM D5185m	>30	0	<1	---
Tin	ppm	ASTM D5185m	>9	0	<1	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m		0	0	---
Molybdenum	ppm	ASTM D5185m		0	<1	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m		<1	0	---
Calcium	ppm	ASTM D5185m		0	1	---
Phosphorus	ppm	ASTM D5185m		158	496	---
Zinc	ppm	ASTM D5185m		0	0	---
Sulfur	ppm	ASTM D5185m		151	1386	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>60	2	2	---
Sodium	ppm	ASTM D5185m		<1	0	---
Potassium	ppm	ASTM D5185m	>20	0	2	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>1300	▲ 5728	▲ 29838	---
Particles >6µm		ASTM D7647	>320	▲ 1608	▲ 5690	---
Particles >14µm		ASTM D7647	>80	24	41	---
Particles >21µm		ASTM D7647	>20	4	5	---
Particles >38µm		ASTM D7647	>4	1	0	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>17/15/13	▲ 20/18/12	▲ 22/20/13	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.44	0.28	---


# OIL ANALYSIS REPORT

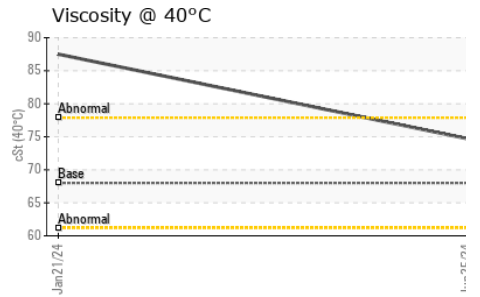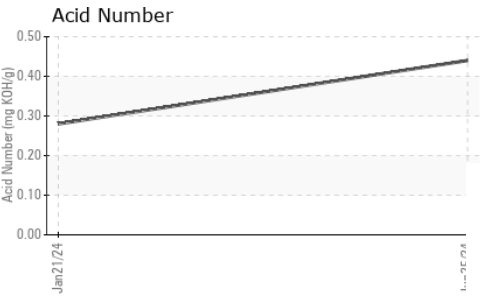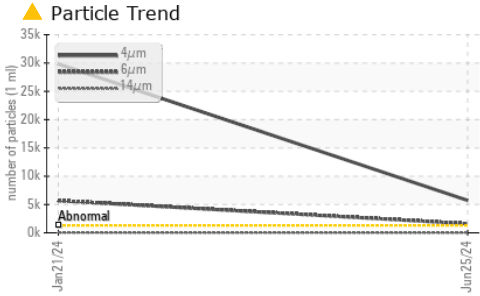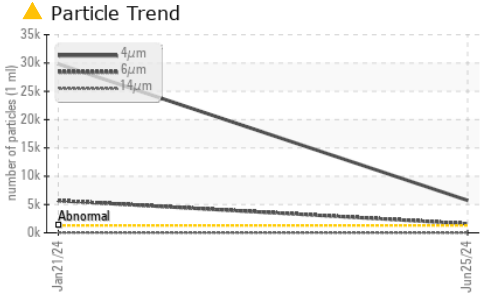





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	68.0	74.7	▲ 87.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

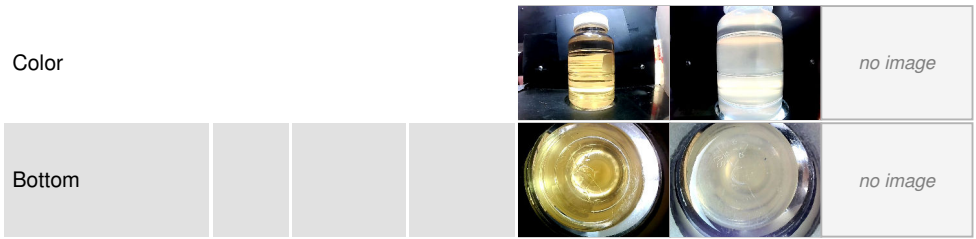

## GRAPHS

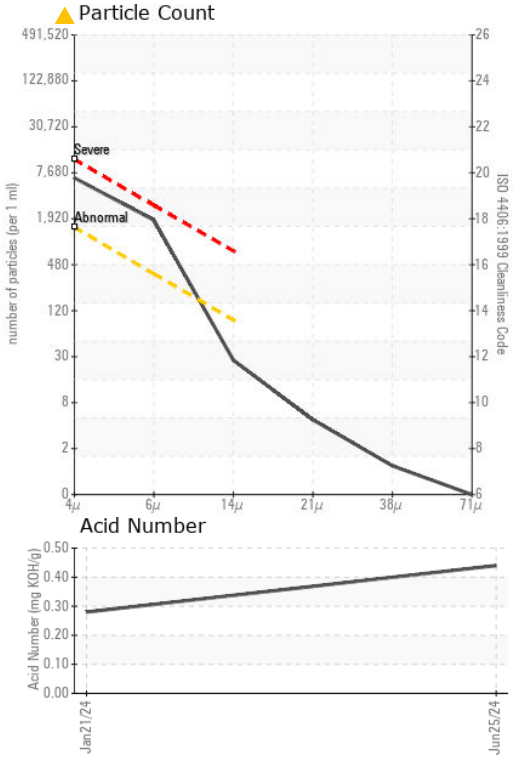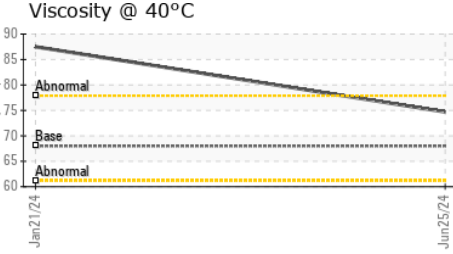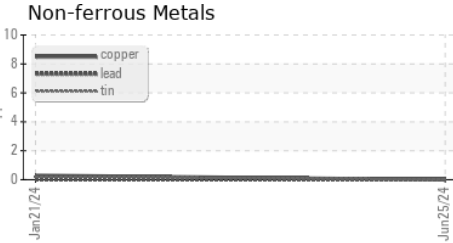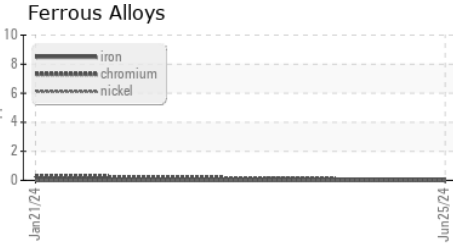

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0130494      **Received** : 03 Jul 2024  
**Lab Number** : 06227386      **Tested** : 06 Jul 2024  
**Unique Number** : 11110879      **Diagnosed** : 06 Jul 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**KraftHeinz - Springfield - Plant 8311 PCA**  
 2035 E BENNETT  
 SPRINGFIELD, MO  
 US 65804  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: