


OIL ANALYSIS REPORT

Sample Rating Trend



ISO

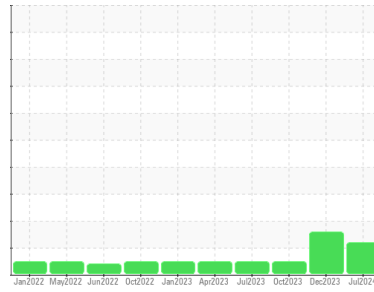

Area

INJECT B ROOM [99046597]

Machine Id

KR-GR-003238 - REWORK SCREW LOAD (S/N INJECT B - 11513039)

Component

Gearbox

Fluid

PETRO CANADA 220 (6 QTS)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. (Customer Sample Comment: 99046597)

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			PCA0118008	PCA0113112	PCA0106510
Sample Date	Client Info			02 Jul 2024	26 Dec 2023	10 Oct 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			Not Chngd	Not Chngd	N/A
Sample Status				ABNORMAL	ABNORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.2	NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	0	1	<1
Chromium	ppm	ASTM D5185m	>15	0	0	0
Nickel	ppm	ASTM D5185m	>15	0	0	0
Titanium	ppm	ASTM D5185m		0	0	<1
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	0	0	<1
Lead	ppm	ASTM D5185m	>100	0	0	0
Copper	ppm	ASTM D5185m	>200	0	0	<1
Tin	ppm	ASTM D5185m	>25	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		1	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		<1	0	0
Calcium	ppm	ASTM D5185m		9	0	0
Phosphorus	ppm	ASTM D5185m		292	259	396
Zinc	ppm	ASTM D5185m		13	0	0
Sulfur	ppm	ASTM D5185m		12355	10021	3365


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	1	1	3
Sodium	ppm	ASTM D5185m		3	5	1
Potassium	ppm	ASTM D5185m	>20	<1	2	0

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 100617	▲ 108155	---	
Particles >6µm	ASTM D7647	>2500	▲ 22755	▲ 21028	---	
Particles >14µm	ASTM D7647	>640	639	▲ 649	---	
Particles >21µm	ASTM D7647	>160	113	120	---	
Particles >38µm	ASTM D7647	>40	3	3	---	
Particles >71µm	ASTM D7647	>10	0	0	---	
Oil Cleanliness	ISO 4406 (c)	>20/18/16	▲ 24/22/16	▲ 24/22/17	---	


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.43	0.43	0.47

OIL ANALYSIS REPORT


▲ Particle Trend

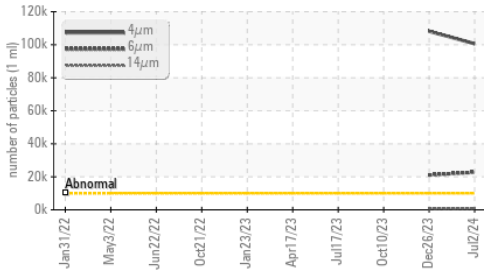


▲ Particle Trend

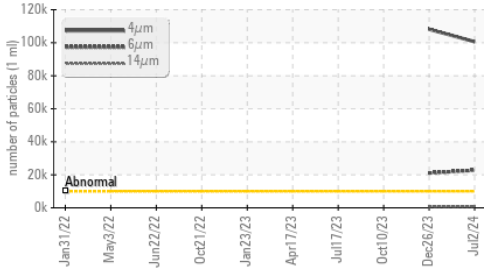

Acid Number

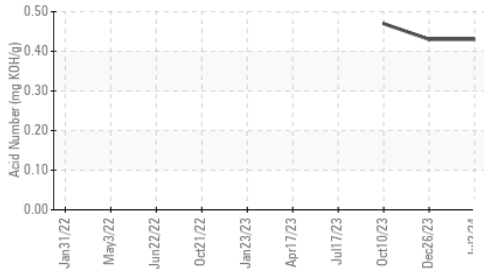

Viscosity @ 40°C

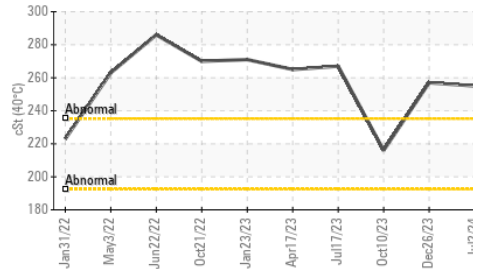


PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	255	257	216

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color

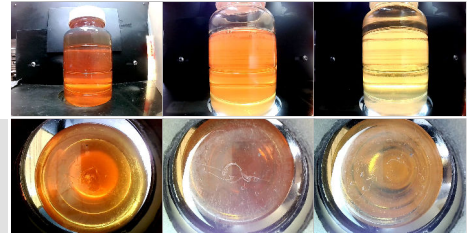


Bottom

GRAPHS


Ferrous Alloys

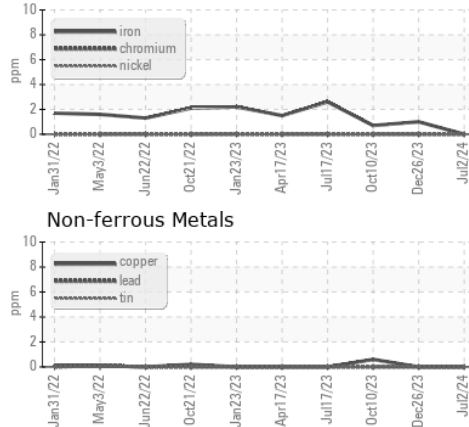


Non-ferrous Metals

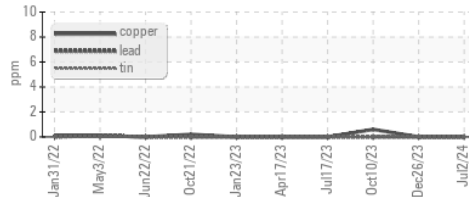


Viscosity @ 40°C

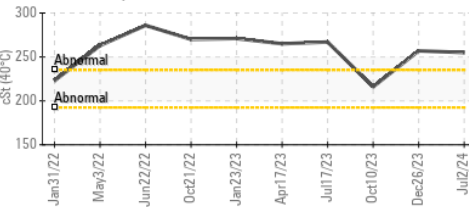

▲ Particle Count

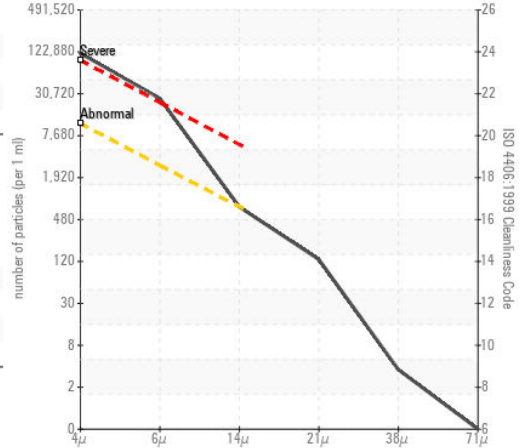

Acid Number

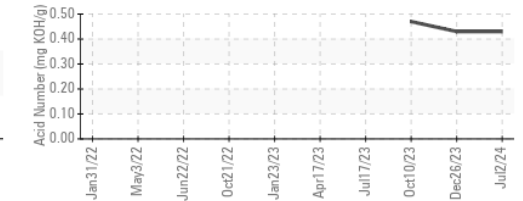

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : PCA0118008

Lab Number : 06228493

Unique Number : 11111986

Test Package : IND 2 (Additional Tests: PrtCount)

Received : 05 Jul 2024

Tested : 08 Jul 2024

Diagnosed : 08 Jul 2024 - Angela Borella

KraftHeinz - Kirksville - Plant 8333 PCA

2504 INDUSTRIAL DR

KIRKSVILLE, MO

US 63501

Contact: WALLACE WARD

wallace.ward@kraftheinzcompany.com

T: (660)627-1031

F: (660)627-5887

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)