


OIL ANALYSIS REPORT

Sample Rating Trend



GLYCOL

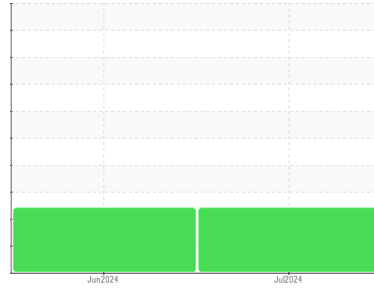

Machine Id
Rel162225
 Component
Diesel Engine
 Fluid
{not provided} (--- GAL)

DIAGNOSIS

▲ Recommendation

We advise that you check for the source of the coolant leak. Check for low coolant level. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

Sodium and/or potassium levels are high.

▲ Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		PCA0122505	PCA0122547	---
Sample Date	Client Info		01 Jul 2024	27 Jun 2024	---
Machine Age	hrs	Client Info	16801	16755	---
Oil Age	hrs	Client Info	16801	16755	---
Oil Changed		Client Info	N/A	N/A	---
Sample Status			ABNORMAL	ABNORMAL	---

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<1.0	<1.0	---
Water	WC Method	>0.2	NEG	NEG	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	8	37	---
Chromium	ppm	ASTM D5185m >20	<1	2	---
Nickel	ppm	ASTM D5185m >4	0	<1	---
Titanium	ppm	ASTM D5185m	<1	<1	---
Silver	ppm	ASTM D5185m >3	<1	<1	---
Aluminum	ppm	ASTM D5185m >20	3	14	---
Lead	ppm	ASTM D5185m >40	0	<1	---
Copper	ppm	ASTM D5185m >330	1	4	---
Tin	ppm	ASTM D5185m >15	0	0	---
Vanadium	ppm	ASTM D5185m	<1	<1	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	11	12	---
Barium	ppm	ASTM D5185m	0	<1	---
Molybdenum	ppm	ASTM D5185m	83	193	---
Manganese	ppm	ASTM D5185m	<1	<1	---
Magnesium	ppm	ASTM D5185m	946	905	---
Calcium	ppm	ASTM D5185m	1182	1114	---
Phosphorus	ppm	ASTM D5185m	1046	930	---
Zinc	ppm	ASTM D5185m	1252	1250	---
Sulfur	ppm	ASTM D5185m	3812	3992	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	5	11	---
Sodium	ppm	ASTM D5185m	▲ 224	▲ 1288	---
Potassium	ppm	ASTM D5185m >20	▲ 237	▲ 1371	---
Glycol	%	*ASTM D2982	NEG	NEG	---





INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >3	0.2	0.6	---
Nitration	Abs/cm	*ASTM D7624 >20	6.7	15.7	---
Sulfation	Abs/.1mm	*ASTM D7415 >30	18.1	24.1	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	13.6	20.3	---
Base Number (BN)	mg KOH/g	ASTM D2896	10.57	11.06	---









OIL ANALYSIS REPORT

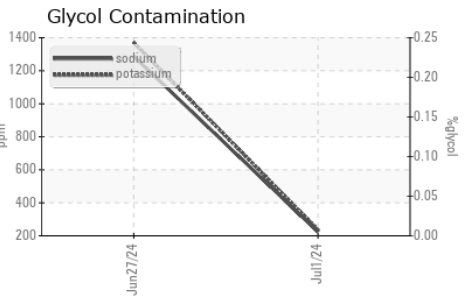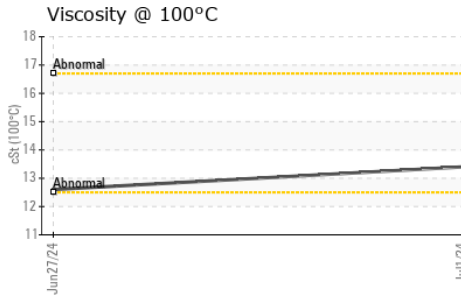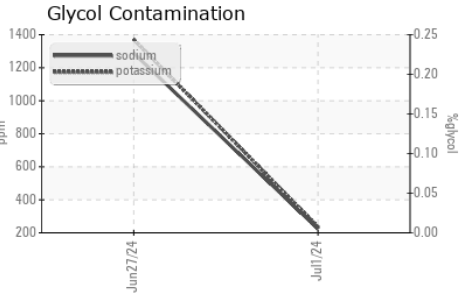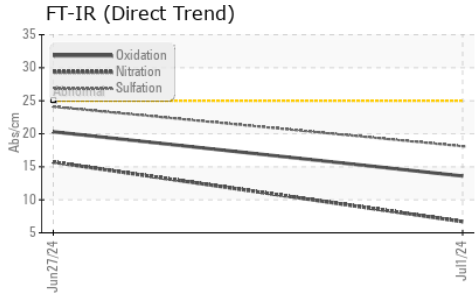

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	12.6	---

GRAPHS

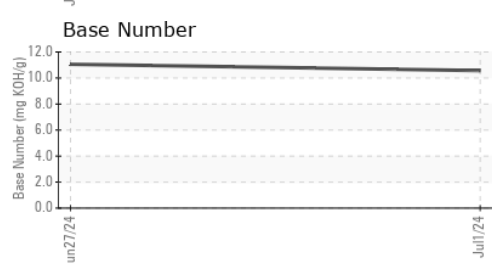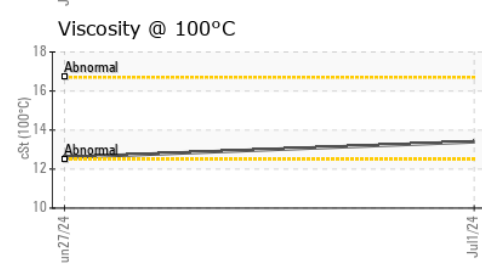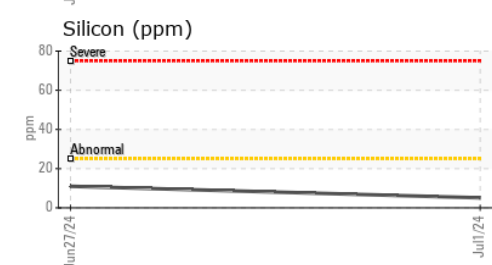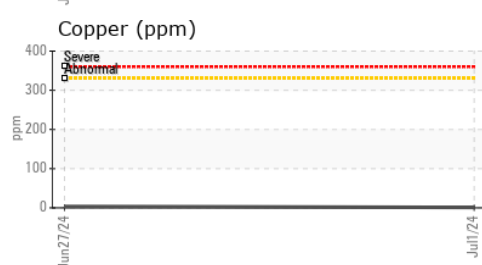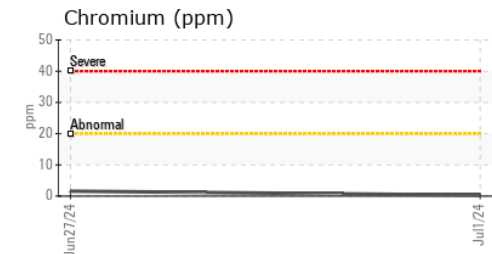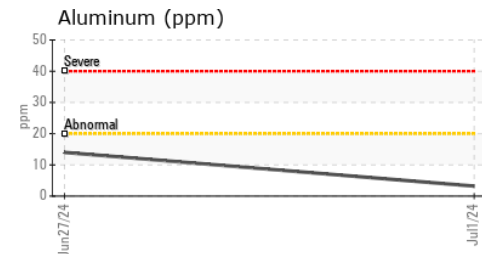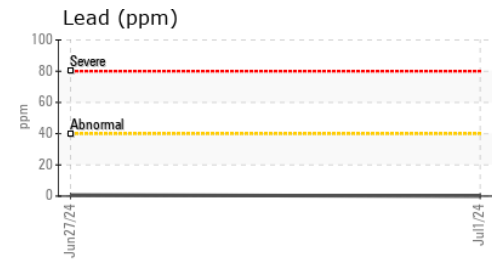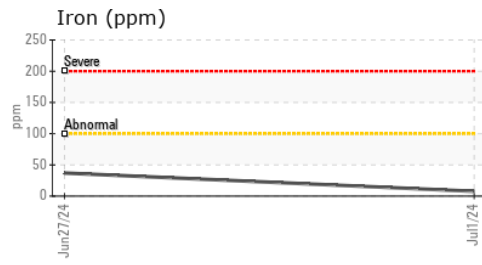

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0122505 **Received** : 05 Jul 2024
Lab Number : **06228849** **Tested** : 09 Jul 2024
Unique Number : 11112342 **Diagnosed** : 09 Jul 2024 - Jonathan Hester
Test Package : MOB 2 (Additional Tests: Glycol)

UMM - Shop 401 - Norton
 186 South Washington Street
 Norton, MA
 US 02766
 Contact: P Cohen
 pcohen@win-waste.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)