


OIL ANALYSIS REPORT

Area
RIDGEWAY
 Machine Id
[RIDGEWAY] DB170105E Unit 05
 Component
Natural Gas Engine
 Fluid
PETRO CANADA DURON MONOGRADE HD 40W (350 GAL)

Sample Rating Trend

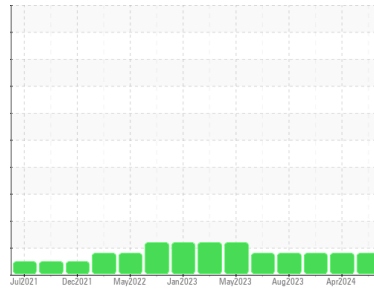

FUEL



DIAGNOSIS

Recommendation

We advise that you check the fuel injection system. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of fuel present in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		PCA0094550	PCA0094548	PCA0094552
Sample Date	Client Info		01 Jul 2024	29 Apr 2024	30 Jan 2024
Machine Age	hrs	Client Info	31787	30920	30322
Oil Age	hrs	Client Info	4027	6510	5912
Oil Changed	Client Info		Not Chngd	Not Chngd	Not Chngd
Sample Status			ABNORMAL	MARGINAL	MARGINAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	10	10	9
Chromium	ppm	ASTM D5185m >4	<1	<1	<1
Nickel	ppm	ASTM D5185m >2	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m >3	0	0	0
Aluminum	ppm	ASTM D5185m >9	3	3	3
Lead	ppm	ASTM D5185m >30	3	2	3
Copper	ppm	ASTM D5185m >35	5	6	4
Tin	ppm	ASTM D5185m >4	0	<1	1
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	9	9	10
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	11	12	13
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m	946	809	784
Calcium	ppm	ASTM D5185m	1245	1161	1067
Phosphorus	ppm	ASTM D5185m	1115	1011	1005
Zinc	ppm	ASTM D5185m	1375	1184	1196
Sulfur	ppm	ASTM D5185m	3732	3411	2967

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >+100	3	3	5
Sodium	ppm	ASTM D5185m	3	3	3
Potassium	ppm	ASTM D5185m >20	<1	0	<1
Fuel	%	ASTM D3524 >4.0	▲ 4.5	▲ 3.3	▲ 3.0

INFRA-RED


	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0.1	0.1	0.1
Nitration	Abs/cm	*ASTM D7624 >20	5.0	4.8	4.8
Sulfation	Abs/.1mm	*ASTM D7415 >30	14.8	14.2	14.4

FLUID DEGRADATION


	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	7.9	7.7	7.7
Acid Number (AN)	mg KOH/g	ASTM D8045	1.06	1.18	1.08
Base Number (BN)	mg KOH/g	ASTM D2896 8.5	7.44	8.29	8.28

OIL ANALYSIS REPORT


Fuel Dilution

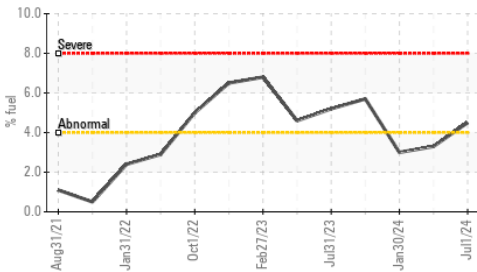


FT-IR (Direct Trend)

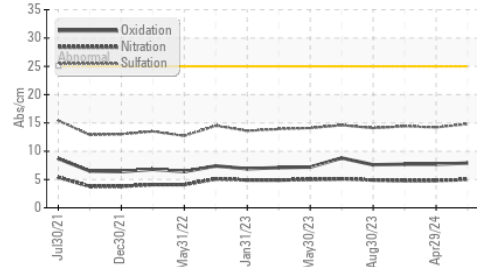


Acid Number

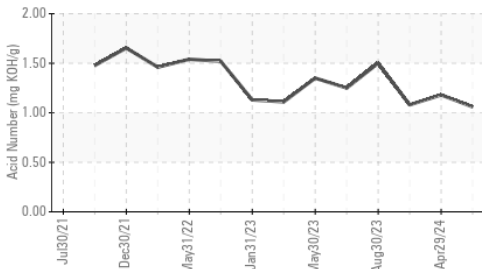

Base Number

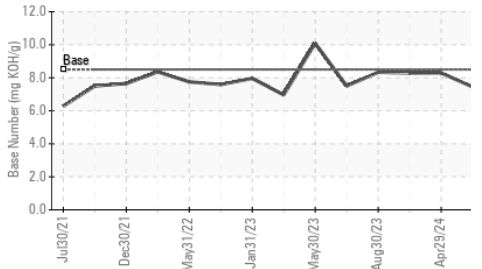

Viscosity @ 100°C

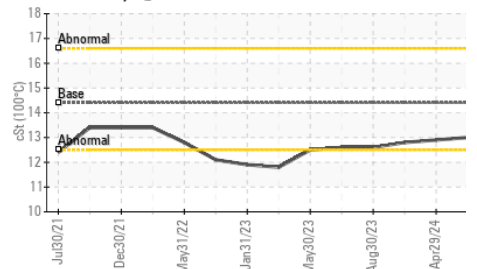

VISUAL


	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES


	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	13.0	12.9

GRAPHS


Iron (ppm)

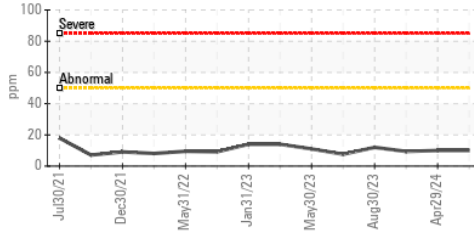


Aluminum (ppm)

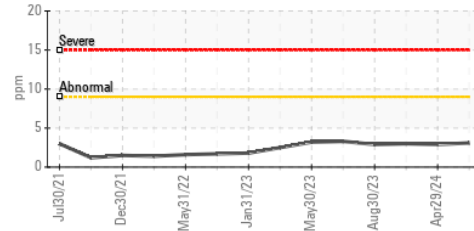


Copper (ppm)

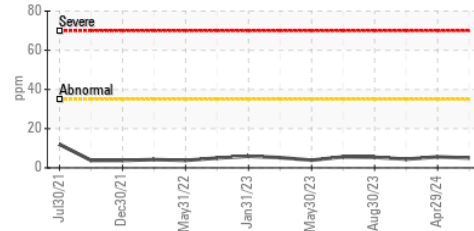


Viscosity @ 100°C

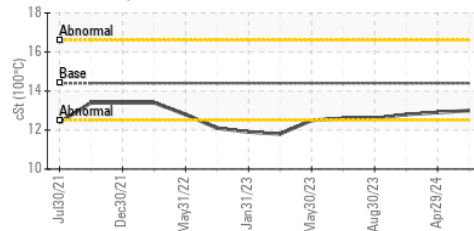


Lead (ppm)

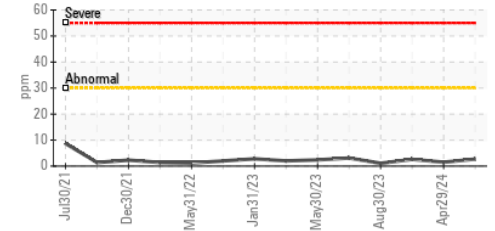


Chromium (ppm)

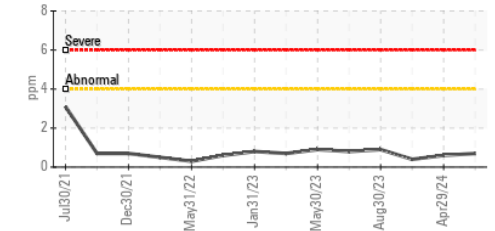

Silicon (ppm)

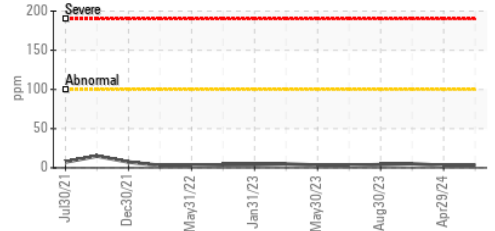

Base Number

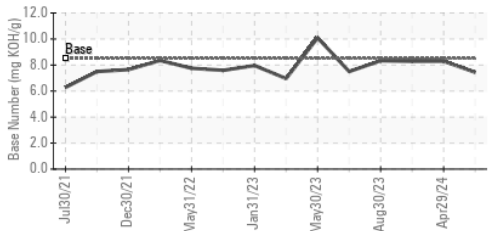

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : PCA0094550

Lab Number : 06229603

Unique Number : 11113096

Test Package : MOB 2 (Additional Tests: FuelDilution, PercentFuel)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 05 Jul 2024

Tested : 10 Jul 2024

Diagnosed : 10 Jul 2024 - Jonathan Hester

Magellan Midstream LP - Ridgeway

20471 West 230 Place

Ridgeway, MO

US 64481

Contact: Kevin Meister

kevin.meister@magellanlp.com

T: (660)872-6417

F: