




OIL ANALYSIS REPORT

Sample Rating Trend

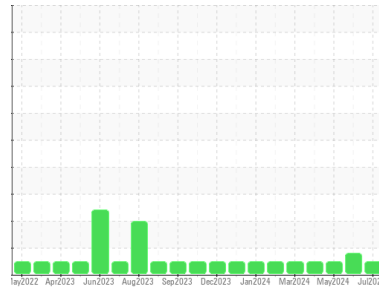

NORMAL



Machine Id
731113-310101

Component
Natural Gas Engine

Fluid
PETRO CANADA DURON GEO LD 15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		GFL0124132	GFL0120239	GFL0117230
Sample Date	Client Info		03 Jul 2024	03 Jun 2024	13 May 2024
Machine Age	hrs	Client Info	6345	6148	6035
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		Not Changed	Not Changd	Not Changed
Sample Status			NORMAL	ABNORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	14	▲ 57	9
Chromium	ppm	ASTM D5185m >4	2	2	<1
Nickel	ppm	ASTM D5185m >2	1	1	0
Titanium	ppm	ASTM D5185m	1	<1	0
Silver	ppm	ASTM D5185m >3	<1	0	0
Aluminum	ppm	ASTM D5185m >9	4	4	2
Lead	ppm	ASTM D5185m >30	4	<1	<1
Copper	ppm	ASTM D5185m >35	2	<1	<1
Tin	ppm	ASTM D5185m >4	1	<1	<1
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 50	9	38	8
Barium	ppm	ASTM D5185m 5	0	1	0
Molybdenum	ppm	ASTM D5185m 50	57	56	51
Manganese	ppm	ASTM D5185m 0	1	<1	<1
Magnesium	ppm	ASTM D5185m 560	632	556	538
Calcium	ppm	ASTM D5185m 1510	1761	1620	1614
Phosphorus	ppm	ASTM D5185m 780	845	850	679
Zinc	ppm	ASTM D5185m 870	1131	1005	963
Sulfur	ppm	ASTM D5185m 2040	2749	2771	2757

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >+100	6	16	4
Sodium	ppm	ASTM D5185m	9	1	7
Potassium	ppm	ASTM D5185m >20	3	3	0

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0	0.1	0
Nitration	Abs/cm	*ASTM D7624 >20	11.1	7.8	11.2
Sulfation	Abs/.1mm	*ASTM D7415 >30	24.0	19.7	22.2


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	18.9	15.3	17.7
Base Number (BN)	mg KOH/g	ASTM D2896 10.2	4.1	7.7	4.2




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

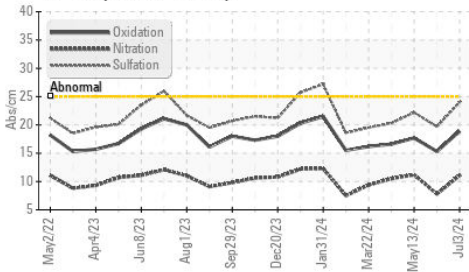

Base Number

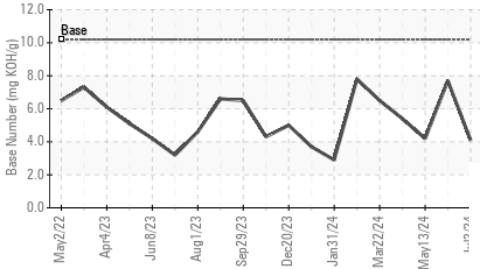

Viscosity @ 100°C

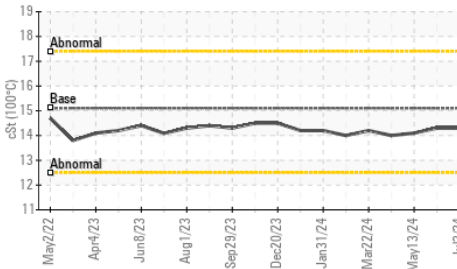

VISUAL


	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES


	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.1	14.3	14.1

GRAPHS


Ferrous Alloys

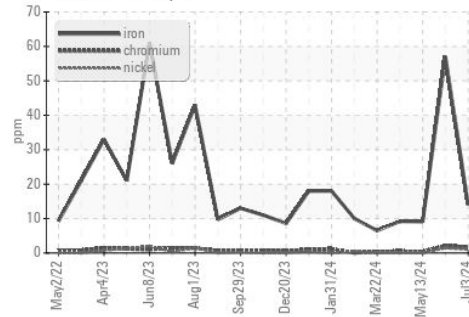


Non-ferrous Metals

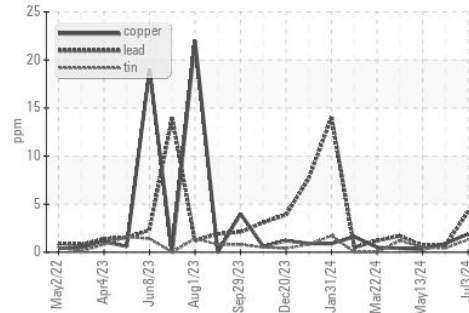

Viscosity @ 100°C

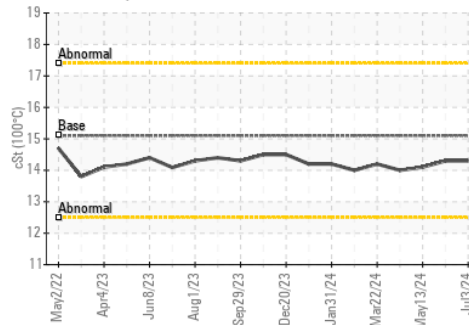

Base Number

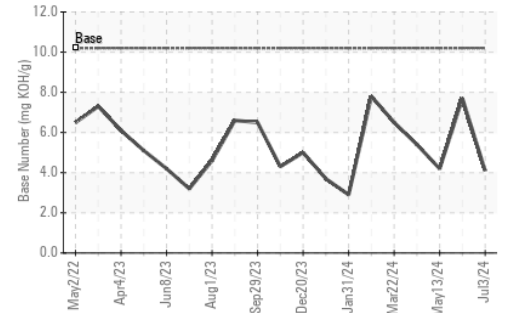

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : GFL0124132
Lab Number : 06229873
Unique Number : 11113366
Test Package : FLEET

GFL Environmental - 836 - Kansas City Hauling
 7801 East Truman Road
 Kansas City, MO
 US 64126
 Contact: Loyce Stewart
 loyce.stewart@gflenv.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: