OIL ANALYSIS REPORT

Sample Rating Trend

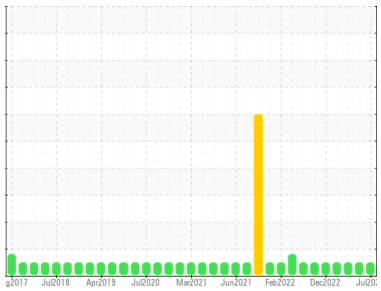

NORMAL

Area
(P618187)
Machine Id
2684C
Component
Natural Gas Engine
Fluid
PETRO CANADA DURON GEO LD 15W40 (40 QTS)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is no indication of any contamination in the oil.

Fluid Condition
The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**GFL0125694**	GFL0101770	GFL0101794
Sample Date		Client Info		**03 Jul 2024**	30 Apr 2024	31 Jan 2024
Machine Age	hrs	Client Info		**15600**	14952	14325
Oil Age	hrs	Client Info		**648**	602	600
Oil Changed		Client Info		**Changed**	Changed	Changed
Sample Status				**NORMAL**	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>0.1	**NEG**	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**28**	23	15
Chromium	ppm	ASTM D5185m	>4	**2**	3	1
Nickel	ppm	ASTM D5185m	>2	**<1**	<1	<1
Titanium	ppm	ASTM D5185m		**<1**	<1	<1
Silver	ppm	ASTM D5185m	>3	**<1**	0	0
Aluminum	ppm	ASTM D5185m	>9	**3**	2	7
Lead	ppm	ASTM D5185m	>30	**27**	14	9
Copper	ppm	ASTM D5185m	>35	**3**	2	2
Tin	ppm	ASTM D5185m	>4	**<1**	<1	<1
Vanadium	ppm	ASTM D5185m		**<1**	<1	0
Cadmium	ppm	ASTM D5185m		**0**	<1	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	50	**20**	21	15
Barium	ppm	ASTM D5185m	5	**0**	0	<1
Molybdenum	ppm	ASTM D5185m	50	**59**	60	56
Manganese	ppm	ASTM D5185m	0	**<1**	<1	<1
Magnesium	ppm	ASTM D5185m	560	**683**	667	607
Calcium	ppm	ASTM D5185m	1510	**1875**	1881	1677
Phosphorus	ppm	ASTM D5185m	780	**1026**	972	835
Zinc	ppm	ASTM D5185m	870	**1171**	1134	1010
Sulfur	ppm	ASTM D5185m	2040	**2588**	2905	2514

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+100	**10**	8	16
Sodium	ppm	ASTM D5185m		**12**	14	8
Potassium	ppm	ASTM D5185m	>20	**14**	20	25

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		**0.1**	0	0
Nitration	Abs/cm	*ASTM D7624	>20	**15.1**	14.0	12.9
Sulfation	Abs/.1mm	*ASTM D7415	>30	**31.3**	28.9	28.0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	**34.0**	28.2	25.2
Base Number (BN)	mg KOH/g	ASTM D2896	10.2	**2.6**	3.2	4.4

OIL ANALYSIS REPORT

FT-IR (Direct Trend)

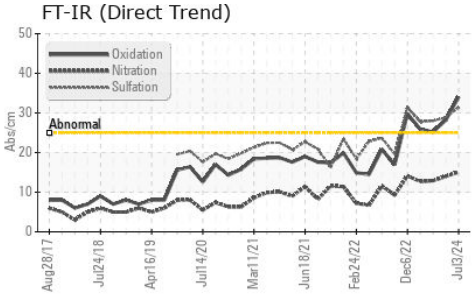

Base Number

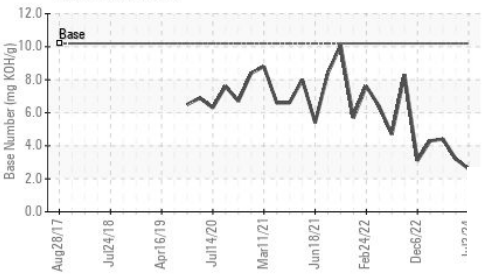

Viscosity @ 100°C

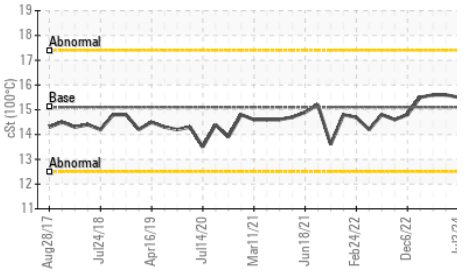

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.1	**15.5**	15.6	15.6

GRAPHS

Ferrous Alloys

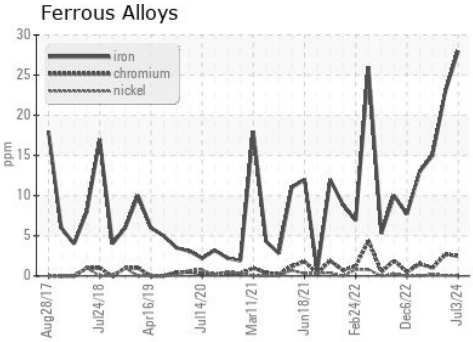

Non-ferrous Metals

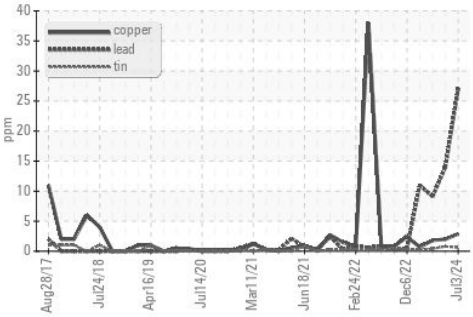

Viscosity @ 100°C

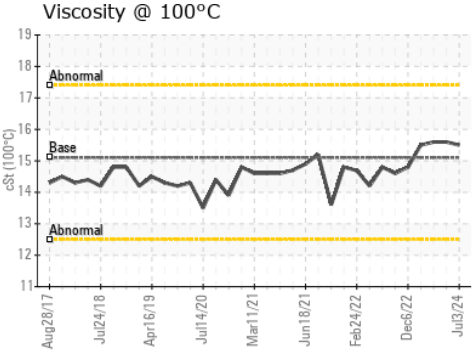

Base Number

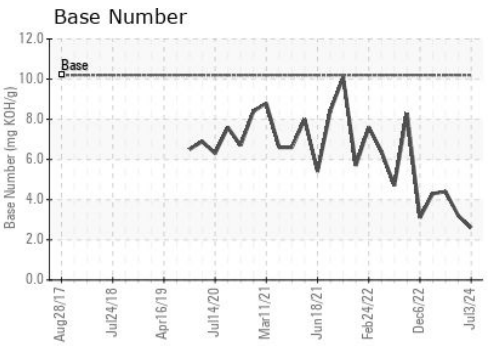

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : GFL0125694
Lab Number : 06229962
Unique Number : 11113455
Test Package : FLEET

Received : 08 Jul 2024
Tested : 09 Jul 2024
Diagnosed : 09 Jul 2024 - Don Baldridge

Certificate L2367

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

GFL Environmental - 030 - Conway Myrtle Beach
3010 HWY 378
Conway, SC
US 29527
Contact: ARCILIO RUEZ
aruiz@gflenv.com
T:
F: