




# OIL ANALYSIS REPORT

Sample Rating Trend

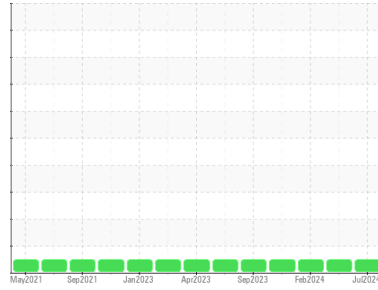

**NORMAL**



Area  
**(P8253B)**  
 Machine ID  
**849001- 101296**  
 Component  
**Natural Gas Engine**  
 Fluid  
**PETRO CANADA DURON GEO LD 15W40 (7 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>GFL0120944</b>	GFL0114571	GFL0081088
Sample Date	Client Info		<b>05 Jul 2024</b>	01 May 2024	20 Feb 2024
Machine Age	hrs	Client Info	<b>13334</b>	12910	12650
Oil Age	hrs	Client Info	<b>1200</b>	300	1200
Oil Changed	Client Info		<b>Changed</b>	Not Changd	Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>6</b>	7	9
Chromium	ppm	ASTM D5185m >4	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m >2	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Silver	ppm	ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >9	<b>2</b>	2	2
Lead	ppm	ASTM D5185m >30	<b>0</b>	<1	<1
Copper	ppm	ASTM D5185m >35	<b>&lt;1</b>	0	0
Tin	ppm	ASTM D5185m >4	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 50	<b>19</b>	3	12
Barium	ppm	ASTM D5185m 5	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 50	<b>50</b>	53	53
Manganese	ppm	ASTM D5185m 0	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m 560	<b>584</b>	535	546
Calcium	ppm	ASTM D5185m 1510	<b>1424</b>	1681	1601
Phosphorus	ppm	ASTM D5185m 780	<b>931</b>	819	755
Zinc	ppm	ASTM D5185m 870	<b>1011</b>	958	999
Sulfur	ppm	ASTM D5185m 2040	<b>2587</b>	2954	2360

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >+100	<b>4</b>	4	4
Sodium	ppm	ASTM D5185m	<b>5</b>	6	6
Potassium	ppm	ASTM D5185m >20	<b>5</b>	<1	5

## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	<b>0</b>	0	0
Nitration	Abs/cm	*ASTM D7624 >20	<b>7.8</b>	8.1	10.9
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>19.2</b>	18.8	22.8


## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>15.6</b>	15.5	18.6
Base Number (BN)	mg KOH/g	ASTM D2896 10.2	<b>7.5</b>	6.5	5.2




# OIL ANALYSIS REPORT


FT-IR (Direct Trend)

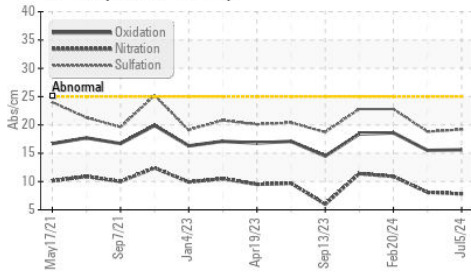

Base Number

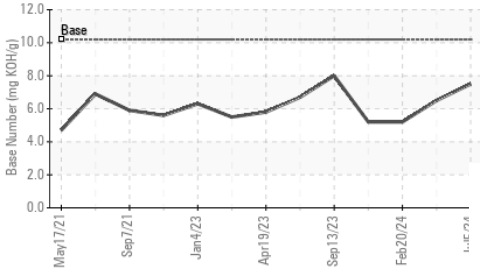

Viscosity @ 100°C

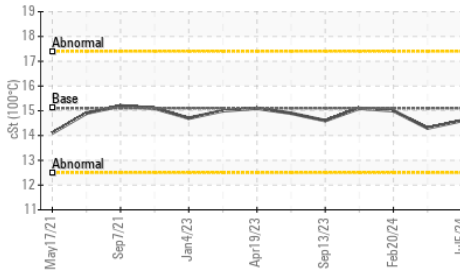


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.1	14.6	14.3

## GRAPHS


Ferrous Alloys

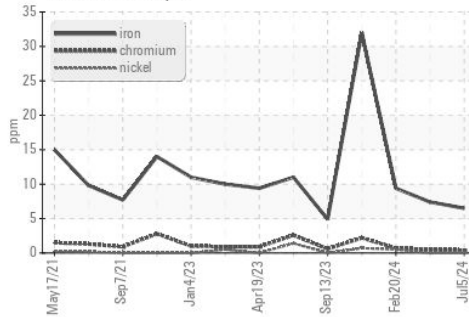


Non-ferrous Metals

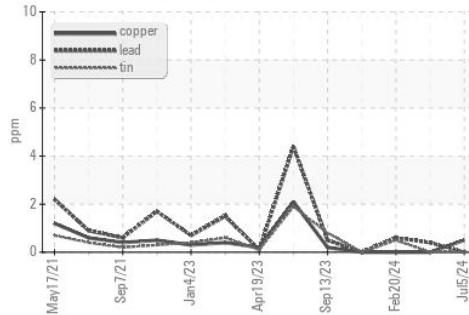

Viscosity @ 100°C

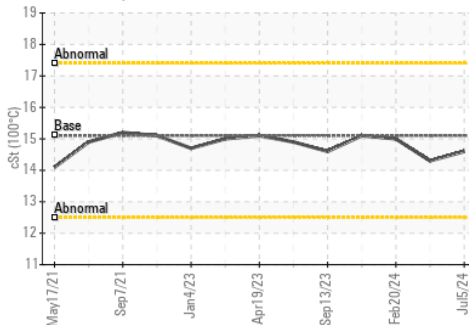

Base Number

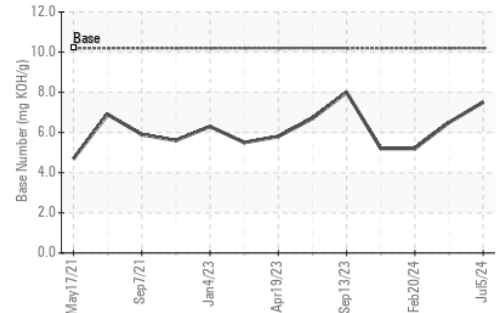

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : GFL0120944  
**Lab Number** : 06229969  
**Unique Number** : 11113462  
**Test Package** : FLEET

**GFL Environmental - 884 - Lake County - Tavares**  
 321 Southridge Industrial Way  
 Tavares, FL  
 US 32778  
 Contact: JEFF COOPERSMITH

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: