

# OIL ANALYSIS REPORT

**Sample Rating Trend**

**NORMAL**


Machine Id  
**PRIMARY 5 SECONDARY**  
 Component  
**Gearbox**  
 Fluid  
**GEAR OIL ISO 460 (--- GAL)**

**DIAGNOSIS**
**Recommendation**

Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment. Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) GEAR OIL ISO 460. Please confirm.

NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

**Wear**

All component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>PCAI2002723</b>	---	---
Sample Date	Client Info			<b>08 Jul 2024</b>	---	---
Machine Age	yrs	Client Info		<b>0</b>	---	---
Oil Age	yrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.2	<b>NEG</b>	---	---



WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	<b>13</b>	---	---
Chromium	ppm	ASTM D5185m	>15	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m	>15	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Aluminum	ppm	ASTM D5185m	>25	<b>2</b>	---	---
Lead	ppm	ASTM D5185m	>100	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>200	<b>4</b>	---	---
Tin	ppm	ASTM D5185m	>25	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	50	<b>&lt;1</b>	---	---
Barium	ppm	ASTM D5185m	15	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	15	<b>2</b>	---	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m	50	<b>3</b>	---	---
Calcium	ppm	ASTM D5185m	50	<b>&lt;1</b>	---	---
Phosphorus	ppm	ASTM D5185m	350	<b>203</b>	---	---
Zinc	ppm	ASTM D5185m	100	<b>8</b>	---	---
Sulfur	ppm	ASTM D5185m	12500	<b>13418</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<b>1</b>	---	---
Sodium	ppm	ASTM D5185m		<b>0</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	<b>0.43</b>	---	---

# OIL ANALYSIS REPORT

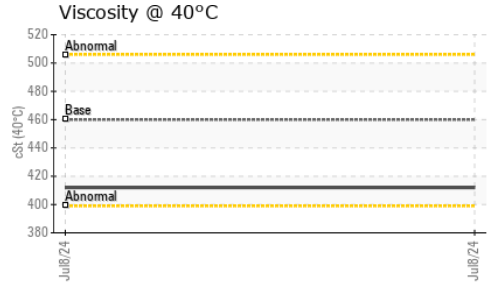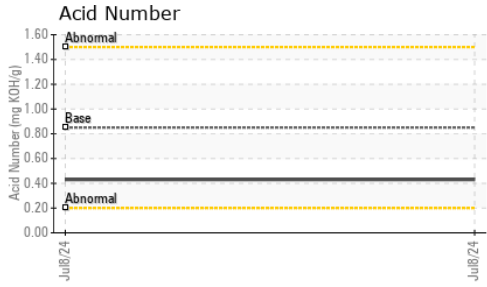





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	460	<b>412</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

## GRAPHS

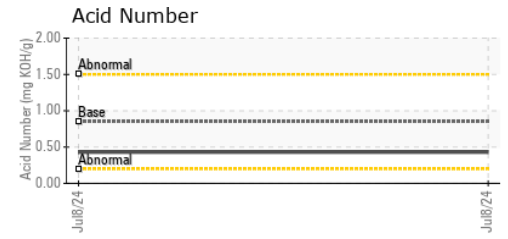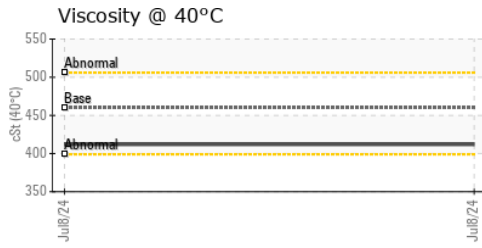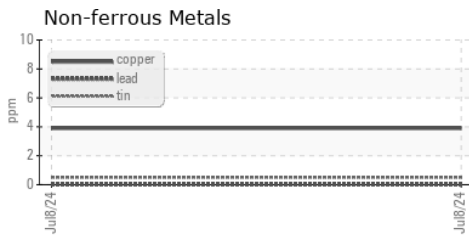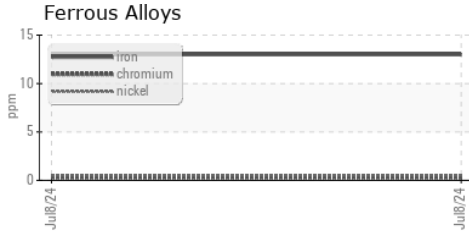

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCAI2002723      **Received** : 08 Jul 2024  
**Lab Number** : **06230307**      **Tested** : 09 Jul 2024  
**Unique Number** : 11113800      **Diagnosed** : 09 Jul 2024 - Wes Davis  
**Test Package** : IND 2

**LOWELL REGIONAL WASTE WATER UTILITY**  
 451 FIRST ST BLVD, ROUTE 110  
 LOWELL, MA  
 US 01850  
 Contact: FRED HAMEL  
 fhamel@lowellma.gov  
 T: (978)606-8483  
 F: (978)441-9578

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)