

# OIL ANALYSIS REPORT

Area  
**1002-ELEVATOR-TRANSFER HOUSE-4 HOUSE BRIDGE**  
 Machine Id  
**24501-CONV DRAG #1 BRIDGE E-812**  
 Component  
**Gearbox**  
 Fluid  
**HYDROTEX Ultra-Kleen ISO 220 (--- GAL)**

### Sample Rating Trend



## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

Elemental level of silicon (Si) above normal indicating ingress of seal material.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PCA0115157</b>	---	---
Sample Date	Client Info		<b>02 Jul 2024</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.2	<b>NEG</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >200	<b>153</b>	---	---
Chromium	ppm	ASTM D5185m >15	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m >15	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	---	---
Lead	ppm	ASTM D5185m >100	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >200	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m >25	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>64</b>	---	---
Barium	ppm	ASTM D5185m	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	<b>2</b>	---	---
Magnesium	ppm	ASTM D5185m	<b>2</b>	---	---
Calcium	ppm	ASTM D5185m	<b>2</b>	---	---
Phosphorus	ppm	ASTM D5185m	<b>447</b>	---	---
Zinc	ppm	ASTM D5185m	<b>3</b>	---	---
Sulfur	ppm	ASTM D5185m	<b>11942</b>	---	---




## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>▲ 85</b>	---	---
Sodium	ppm	ASTM D5185m	<b>1</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.83</b>	---	---

# OIL ANALYSIS REPORT

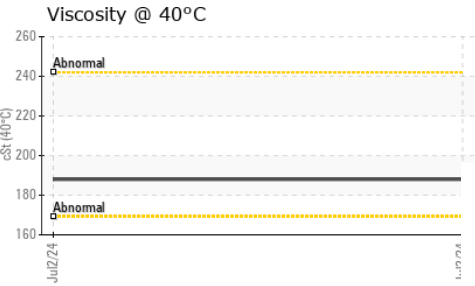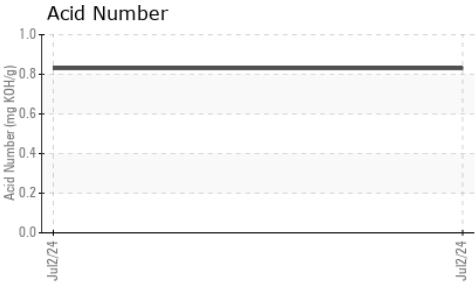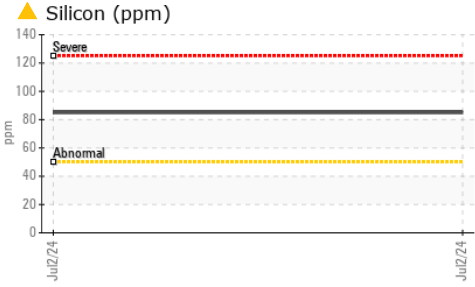




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	MODER	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	188	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

## GRAPHS

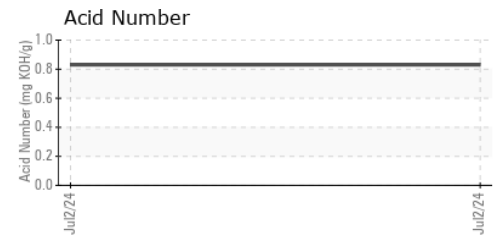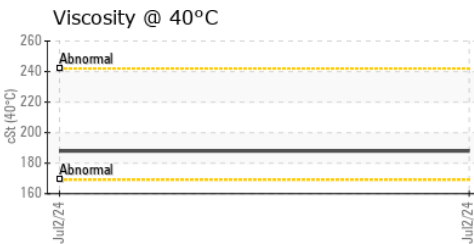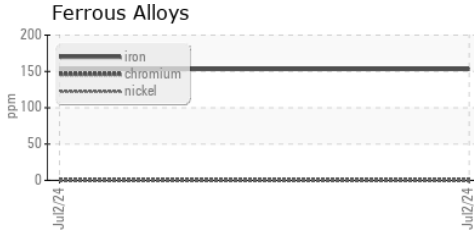

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0115157  
**Lab Number** : 06232369  
**Unique Number** : 11115862  
**Test Package** : PLANT

**Received** : 10 Jul 2024  
**Tested** : 11 Jul 2024  
**Diagnosed** : 12 Jul 2024 - Sean Felton

**Ardent Mills-Alton**

145 W. Broadway  
 Alton, IL  
 US 62002

Contact: Chad Bates  
 Chad.Bates@Ardenmills.com  
 T: (618)416-9155

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: