


# OIL ANALYSIS REPORT

## Sample Rating Trend



## VISCOSITY

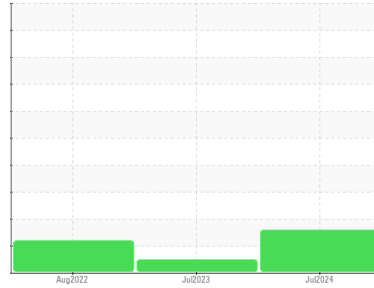

Area

**STUFF ROOM D [98923661]**

Machine Id

**KR-GR-003453 - LOADER RACK CONVEYOR - SOUTH (S/N STUFF D - 11513144)**

Component

**Gearbox**

Fluid

**SCHAEFFER 293A SUPREME GEAR LUBE NO TACK 220 (--- GAL)**

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. ( Customer Sample Comment: 98923661 )

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The oil viscosity is higher than normal. Confirm oil type. The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PCA0125510</b>	PCA0103229	PCA0079792
Sample Date	Client Info		<b>09 Jul 2024</b>	31 Jul 2023	06 Aug 2022
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>Not Chngd</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	NORMAL	ATTENTION

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.2	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >200	<b>16</b>	<1	0
Chromium	ppm	ASTM D5185m >15	<b>0</b>	1	0
Nickel	ppm	ASTM D5185m >15	<b>0</b>	1	0
Titanium	ppm	ASTM D5185m	<b>0</b>	1	0
Silver	ppm	ASTM D5185m	<b>0</b>	3	0
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m >100	<b>0</b>	8	0
Copper	ppm	ASTM D5185m >200	<b>0</b>	2	0
Tin	ppm	ASTM D5185m >25	<b>0</b>	2	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	2	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	<1	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>5</b>	1	3
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>52</b>	1	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>3</b>	19	0
Calcium	ppm	ASTM D5185m	<b>8</b>	0	3
Phosphorus	ppm	ASTM D5185m	<b>657</b>	186	435
Zinc	ppm	ASTM D5185m	<b>13</b>	0	2
Sulfur	ppm	ASTM D5185m	<b>4843</b>	1248	803

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>&lt;1</b>	3	1
Sodium	ppm	ASTM D5185m	<b>3</b>	42	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	100	0





## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>▲ 98949</b>	---	● 19040
Particles >6µm	ASTM D7647	>2500	<b>▲ 17303</b>	---	● 2902
Particles >14µm	ASTM D7647	>640	<b>160</b>	---	85
Particles >21µm	ASTM D7647	>160	<b>19</b>	---	19
Particles >38µm	ASTM D7647	>40	<b>0</b>	---	5
Particles >71µm	ASTM D7647	>10	<b>0</b>	---	3
Oil Cleanliness	ISO 4406 (c)	>20/18/16	<b>▲ 24/21/14</b>	---	● 21/19/14

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.77</b>	0.44	0.51


# OIL ANALYSIS REPORT

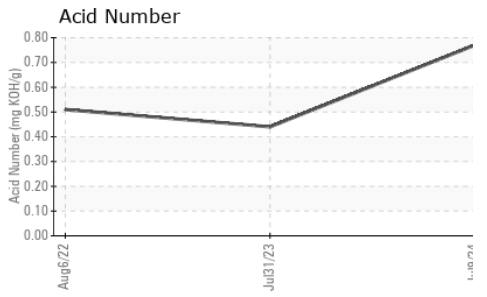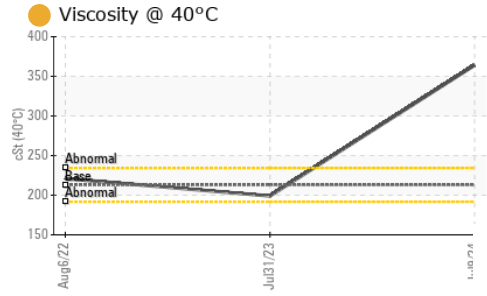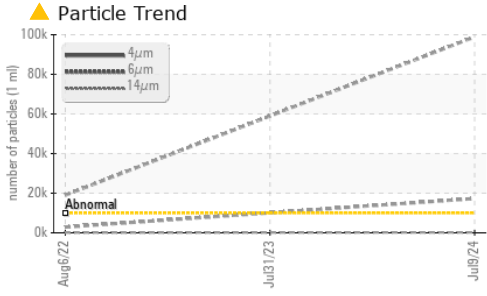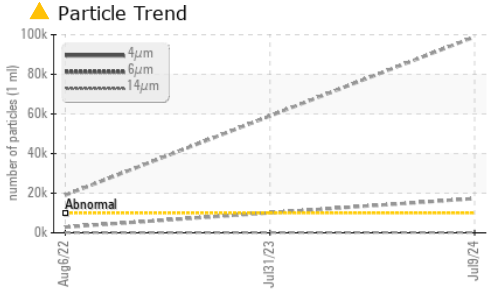





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 213	● 364	199	221

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

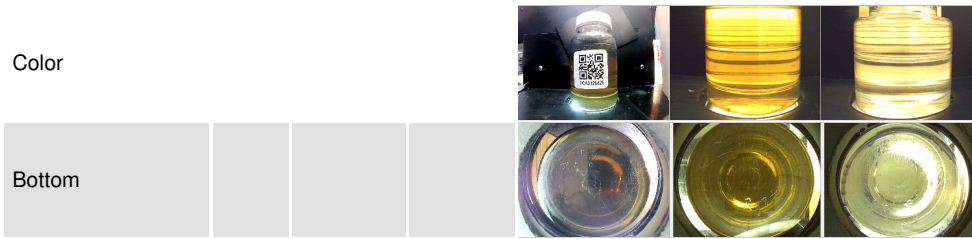

## GRAPHS

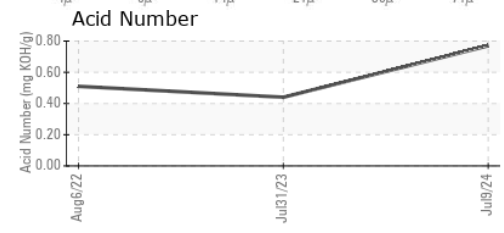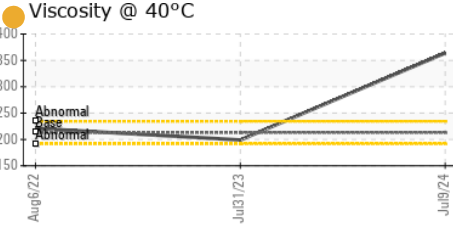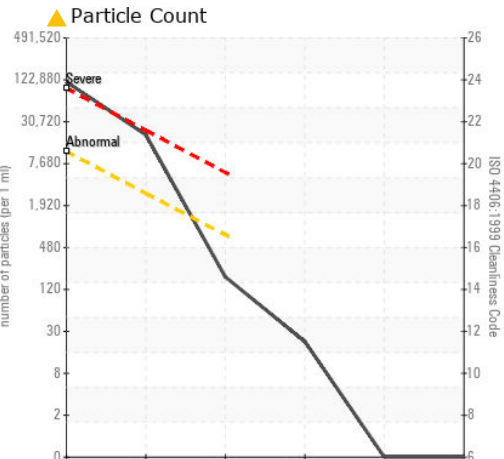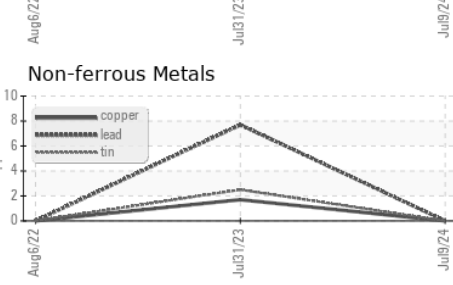

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0125510 **Received** : 11 Jul 2024  
**Lab Number** : 06233242 **Tested** : 12 Jul 2024  
**Unique Number** : 11116735 **Diagnosed** : 12 Jul 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**KraftHeinz - Kirksville - Plant 8333 PCA**  
 2504 INDUSTRIAL DR  
 KIRKSVILLE, MO  
 US 63501  
 Contact: WALLACE WARD  
 wallace.ward@kraftheinzcompany.com  
 T: (660)627-1031  
 F: (660)627-5887

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)