


# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**

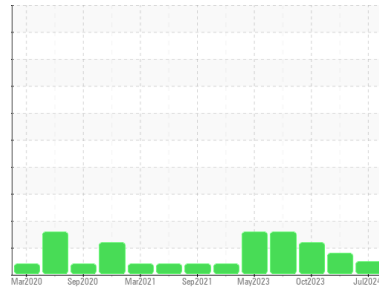

Machine Id  
**RC-4 (S/N R60182)**

Component  
**Reciprocating Compressor**

Fluid  
**CHEVRON REFRIGERATION OIL WF 68 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PCA0125476</b>	PCA0115276	PCA0106627
Sample Date	Client Info		<b>01 Jul 2024</b>	23 Feb 2024	09 Oct 2023
Machine Age	hrs	Client Info	<b>37768</b>	37768	37768
Oil Age	hrs	Client Info	<b>1</b>	1	1
Oil Changed	Client Info		<b>Not Changed</b>	Not Changd	Not Changed
Sample Status			<b>NORMAL</b>	ATTENTION	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>&lt;1</b>	0	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	<1
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>0</b>	0	0
Tin	ppm	ASTM D5185m >15	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	1
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	2
Calcium	ppm	ASTM D5185m	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>0</b>	0	<1
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	<b>103</b>	108	118

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	0	0
Sodium	ppm	ASTM D5185m	<b>0</b>	0	<1
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	0
Water	%	ASTM D6304 >0.1	<b>0.002</b>	0.001	0.002
ppm Water	ppm	ASTM D6304 >1000	<b>16</b>	11	15.7






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	<b>882</b>	● 2837	▲ 10625
Particles >6µm	ASTM D7647	>320	<b>117</b>	● 241	▲ 1200
Particles >14µm	ASTM D7647	>40	<b>6</b>	● 6	● 38
Particles >21µm	ASTM D7647	>10	<b>2</b>	● 0	● 9
Particles >38µm	ASTM D7647	>3	<b>0</b>	● 0	● 1
Particles >71µm	ASTM D7647	>3	<b>0</b>	● 0	● 0
Oil Cleanliness	ISO 4406 (c)	>18/15/12	<b>17/14/10</b>	● 19/15/10	▲ 21/17/12

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.014</b>	0.013	0.014


# OIL ANALYSIS REPORT

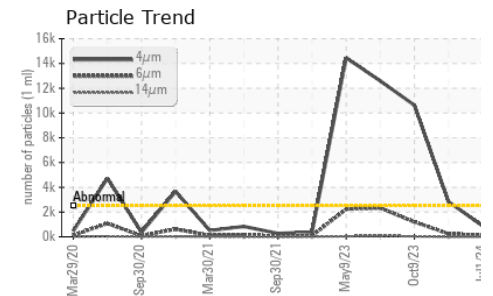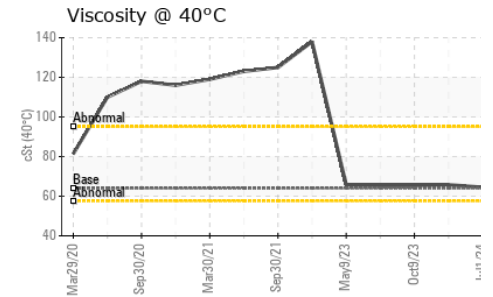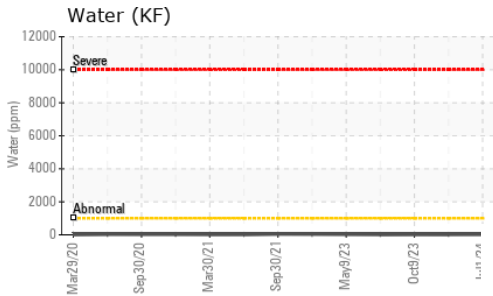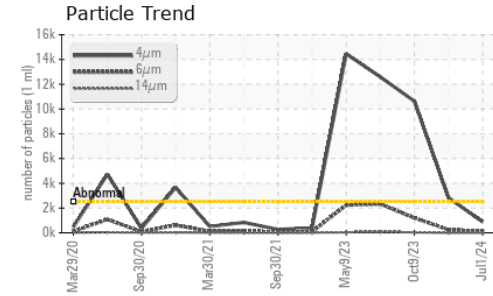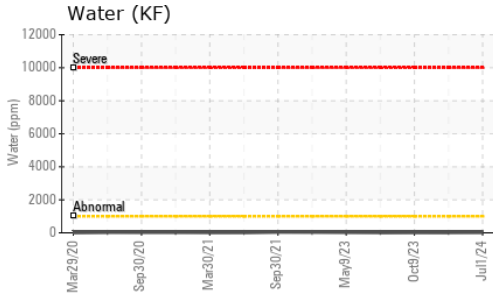






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	64.0	64.5	65.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

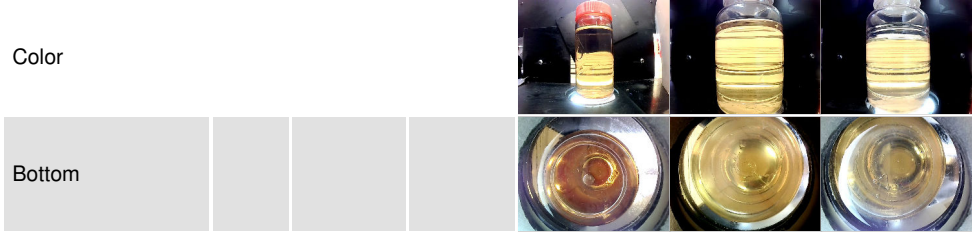

## GRAPHS

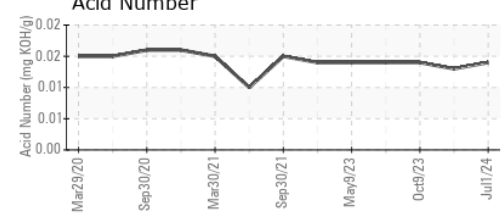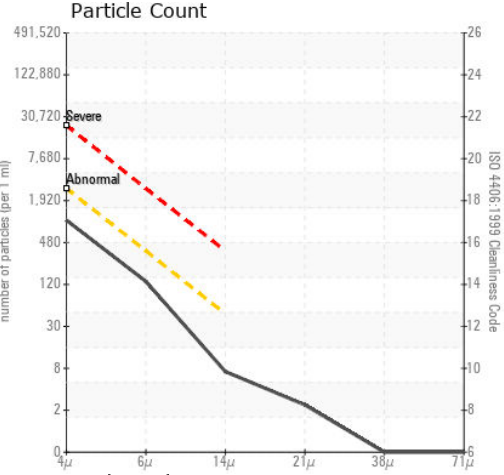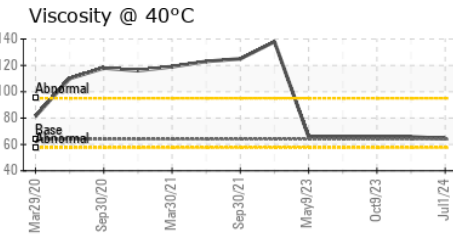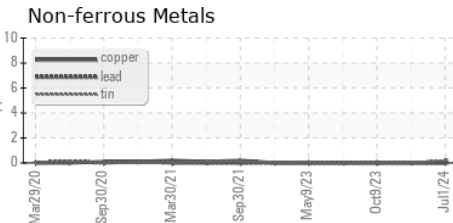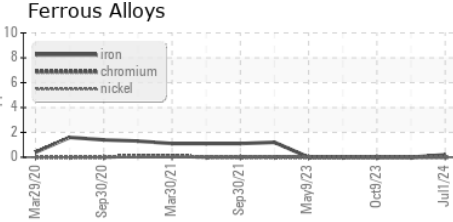

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0125476  
**Lab Number** : 06235024  
**Unique Number** : 11123858  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )  
**Received** : 12 Jul 2024  
**Tested** : 15 Jul 2024  
**Diagnosed** : 15 Jul 2024 - Don Baldrige

**Lactalis Heritage Dairy - Walton - Plant UNK**  
 261 Delaware St.  
 Walton, NY  
 US 13856

Contact: Cindy Scofield  
 cindy.scofield@kraft.com  
 T: (607)865-2330  
 F: (607)865-8863